

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id KAESER SM 15 8713816 (S/N 1397)

Component Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC121273	KC110514	
Sample Date		Client Info		08 Apr 2024	30 Oct 2023	
Machine Age	hrs	Client Info		5384	2957	
Oil Age	hrs	Client Info		0	2957	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	4	10	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	52	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	52	3	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		0	2	
Zinc	ppm	ASTM D5185m		2	0	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		21	2	
Potassium	ppm	ASTM D5185m	>20	4	<1	
Water	%	ASTM D6304	>0.05	0.017	0.010	
ppm Water	ppm	ASTM D6304	>500	178	100.7	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6147	19163	
Particles >6µm		ASTM D7647	>1300	<mark> </mark> 1987	1 1421	
Particles >14µm		ASTM D7647	>80	<mark> </mark> 144	🔺 1375	
Particles >21µm		ASTM D7647	>20	<mark> </mark> 30	<u> </u>	
Particles >38µm		ASTM D7647	>4	1	6	
Particles >71µm		ASTM D7647	>3	0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	e 20/18/14	▲ 21/21/18	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.31	



OIL ANALYSIS REPORT

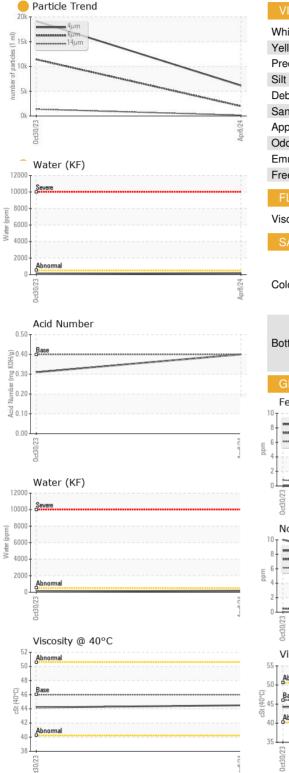

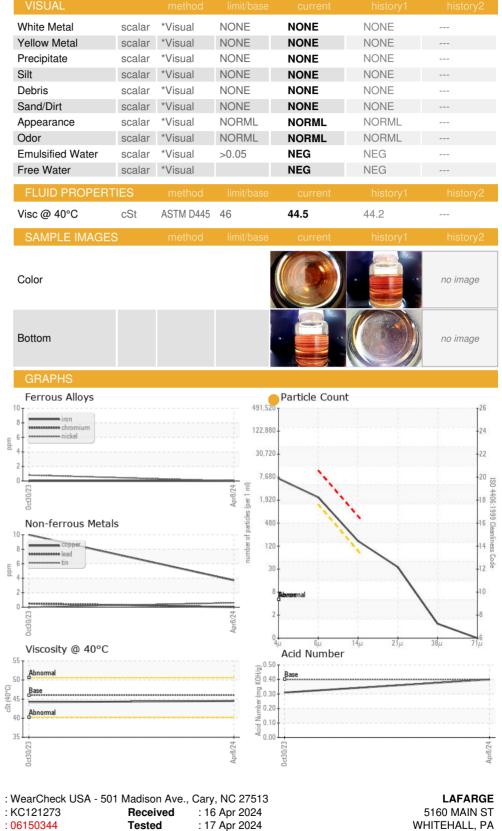

: 18 Apr 2024 - Don Baldridge



Certificate 12367

Laboratory

Sample No.

Lab Number

Unique Number : 10980422

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2

Diagnosed

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: SERVICE MANAGER ? - LAFWHIKC

US 18052

T:

F:

Contact: SERVICE MANAGER