




# OIL ANALYSIS REPORT

## Sample Rating Trend

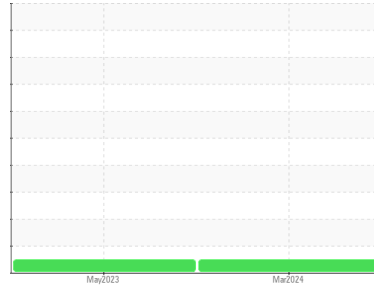

Machine Id  
**KAESER CSD 125 8348592 (S/N 1100)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC06150362</b>	KC101364	---
Sample Date	Client Info		<b>15 Mar 2024</b>	21 May 2023	---
Machine Age	hrs	Client Info	<b>6975</b>	3137	---
Oil Age	hrs	Client Info	<b>0</b>	3137	---
Oil Changed		Client Info	<b>N/A</b>	Changed	---
Sample Status			<b>NORMAL</b>	NORMAL	---

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	1	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>7</b>	6	---
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m 100	<b>&lt;1</b>	4	---
Calcium	ppm	ASTM D5185m 0	<b>0</b>	<1	---
Phosphorus	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	---
Zinc	ppm	ASTM D5185m 0	<b>8</b>	1	---

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m	<b>2</b>	3	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	3	---
Water	%	ASTM D6304 >0.05	<b>0.009</b>	0.007	---
ppm Water	ppm	ASTM D6304 >500	<b>92</b>	79.0	---






### FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>853</b>	582	---
Particles >6µm	ASTM D7647 >1300		<b>222</b>	277	---
Particles >14µm	ASTM D7647 >80		<b>17</b>	74	---
Particles >21µm	ASTM D7647 >20		<b>4</b>	28	---
Particles >38µm	ASTM D7647 >4		<b>0</b>	1	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>17/15/11</b>	16/15/13	---

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.45</b>	0.31	---


# OIL ANALYSIS REPORT

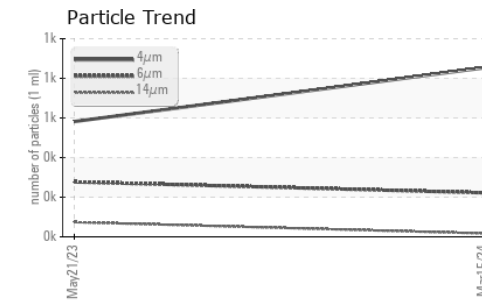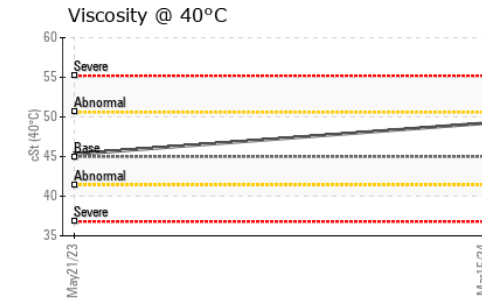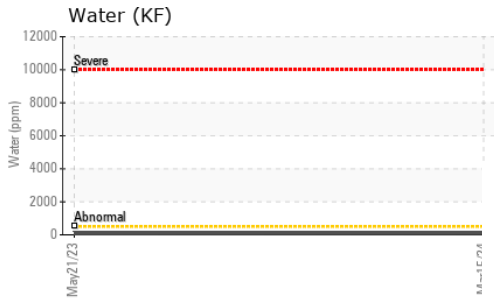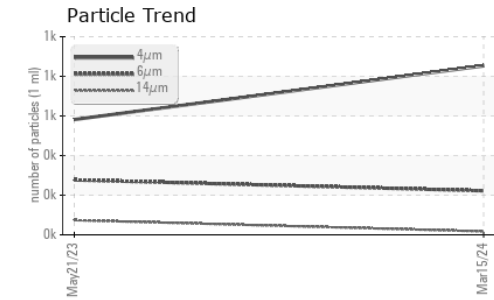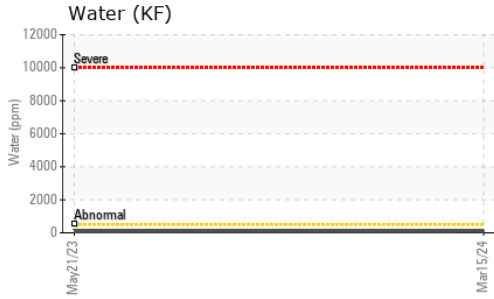






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	45	<b>49.2</b>	45.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

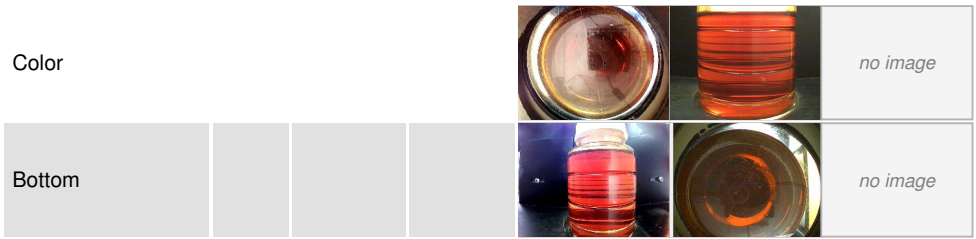

## GRAPHS

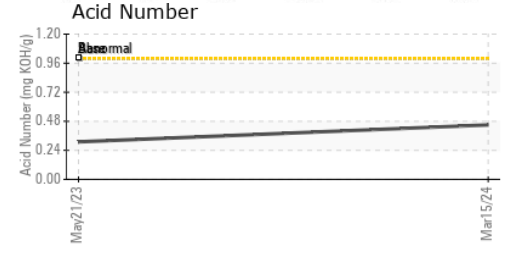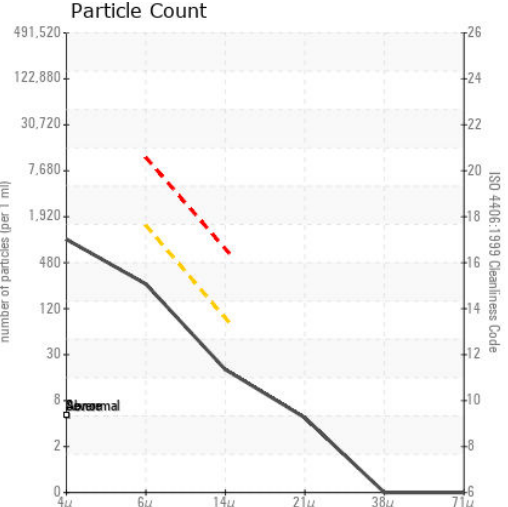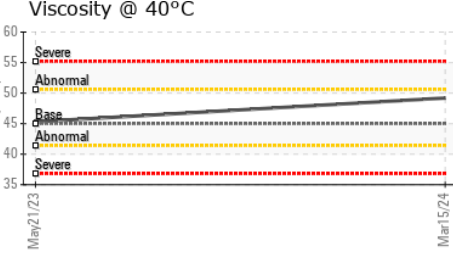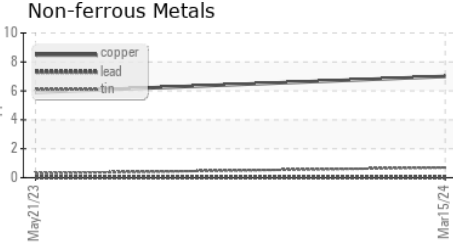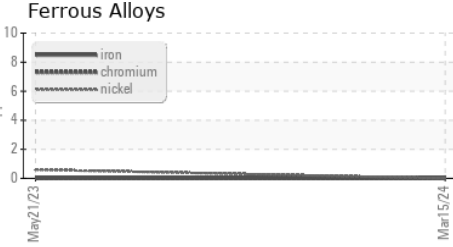

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06150362  
**Lab Number** : 06150362  
**Unique Number** : 10980440  
**Test Package** : IND 2  
**Received** : 16 Apr 2024  
**Tested** : 17 Apr 2024  
**Diagnosed** : 17 Apr 2024 - Doug Bogart

**CONSOLIDATED AGGREGATES**  
 1205 PALESTINE RD  
 PICAYUNE, MS  
 US 39466  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)