




# OIL ANALYSIS REPORT

Sample Rating Trend

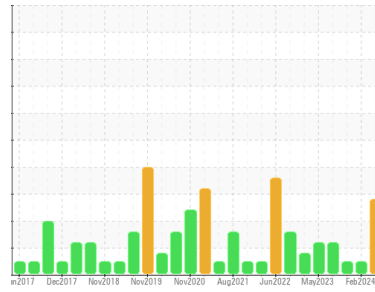

**WATER**



Machine Id  
**BUSCH VM9 / VP-3**  
 Component  
**Pump**  
 Fluid  
**USPI VAC 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil. There is a light concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0006790</b>	USPM30313	USPM31377
Sample Date	Client Info		<b>15 Apr 2024</b>	28 Feb 2024	26 Nov 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<b>2</b>	0	0
Chromium	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >5	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >7	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >12	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >30	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >9	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m 0	<b>2</b>	0	1
Phosphorus	ppm	ASTM D5185m 1800	<b>898</b>	759	819
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>0</b>	25	19

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<b>3</b>	4	4
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	1
Water	%	ASTM D6304 >.1	<b>▲ 0.117</b>	0.029	0.039
ppm Water	ppm	ASTM D6304 >1000	<b>▲ 1177</b>	294	396

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>▲ 13833</b>	3401	4103
Particles >6µm	ASTM D7647	>1300	<b>▲ 3132</b>	684	1263
Particles >14µm	ASTM D7647	>160	<b>109</b>	34	57
Particles >21µm	ASTM D7647	>40	<b>15</b>	7	9
Particles >38µm	ASTM D7647	>10	<b>0</b>	0	3
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>▲ 21/19/14</b>	19/17/12	19/17/13


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.164</b>	0.20	0.24




# OIL ANALYSIS REPORT


## ▲ Particle Trend

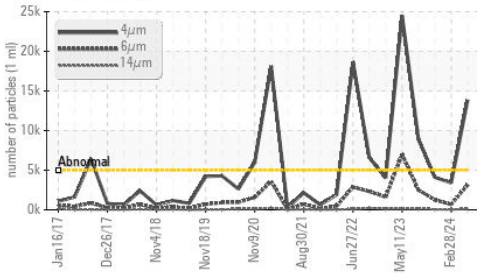


## ▲ Water (KF)

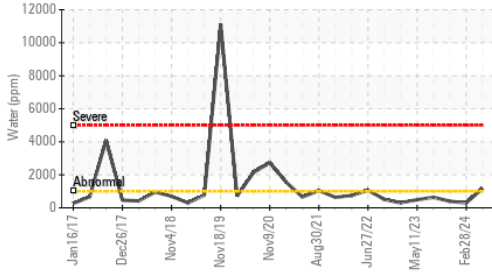


## ▲ Water (KF)

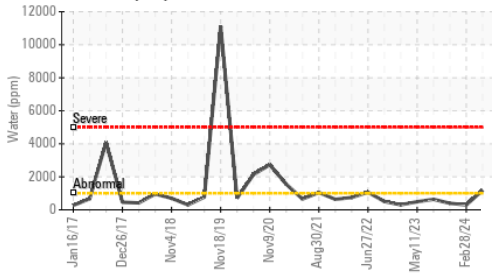

## Acid Number

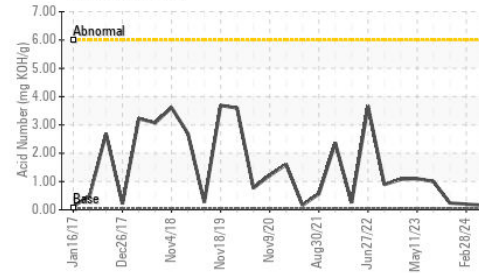


## Viscosity @ 40°C

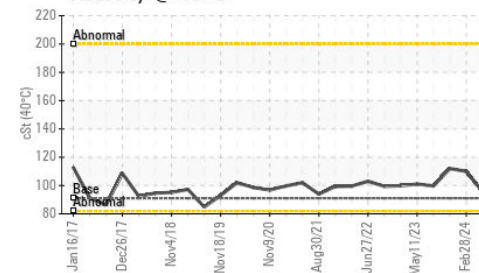

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	95.6	110	112

## SAMPLE IMAGES

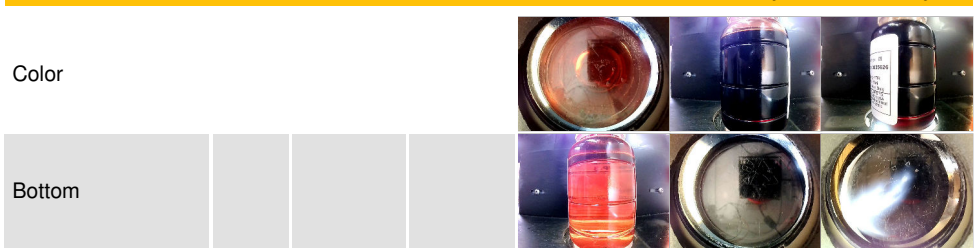


## GRAPHS


### Ferrous Alloys

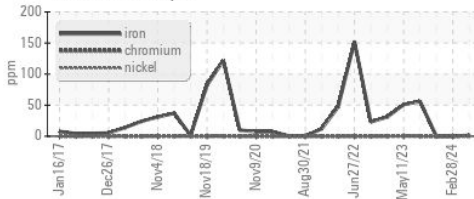


### Non-ferrous Metals

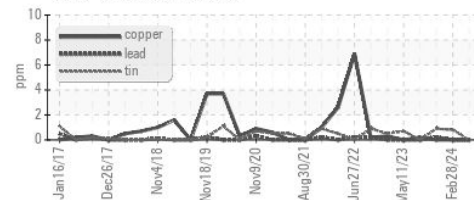


### Viscosity @ 40°C

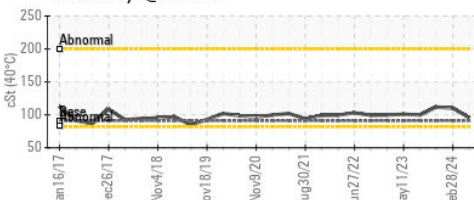

### ▲ Particle Count

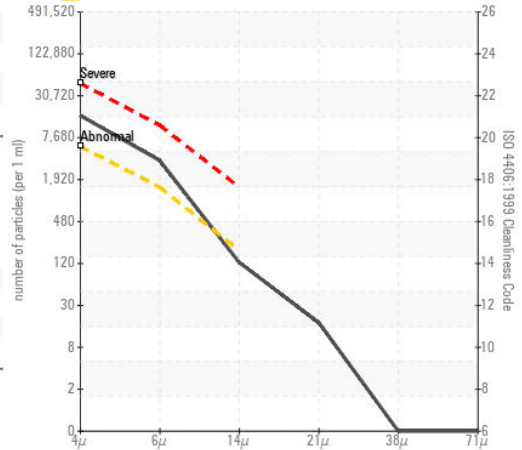

### Acid Number

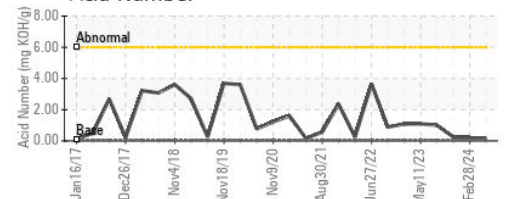

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : USP0006790

Lab Number : 06150397

Unique Number : 10980475

Test Package : IND 2

Received : 16 Apr 2024

Tested : 17 Apr 2024

Diagnosed : 17 Apr 2024 - Doug Bogart

TYSON-DAKOTA CITY-PRO

P.O. BOX 515

DAKOTA CITY, NE

US 68731

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (605)235-2960