




OIL ANALYSIS REPORT

Sample Rating Trend

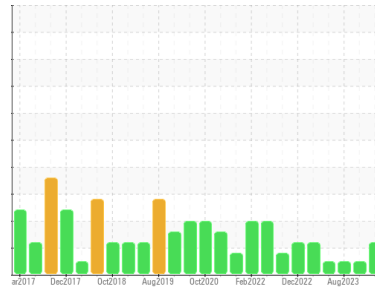

Machine Id
VM-1-VPS (S/N 400435-1)
 Component
Pump
 Fluid
USPI VAC 100 (--- GAL)

DIAGNOSIS

- Recommendation**
Resample at the next service interval to monitor.
- Wear**
All component wear rates are normal.
- Contamination**
There is a high amount of silt (particulates < 14 microns in size) present in the oil.
- Fluid Condition**
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USPM36691	USPM31670	USPM29460
Sample Date	Client Info	15 Apr 2024	26 Dec 2023	29 Aug 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	0	0
Chromium	ppm	ASTM D5185m >5	<1	0
Nickel	ppm	ASTM D5185m >5	0	0
Titanium	ppm	ASTM D5185m >3	0	0
Silver	ppm	ASTM D5185m >3	0	0
Aluminum	ppm	ASTM D5185m >7	0	0
Lead	ppm	ASTM D5185m >12	0	0
Copper	ppm	ASTM D5185m >30	0	0
Tin	ppm	ASTM D5185m >9	<1	0
Vanadium	ppm	ASTM D5185m	0	0
Cadmium	ppm	ASTM D5185m	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	
Barium	ppm	ASTM D5185m 0	0	2	
Molybdenum	ppm	ASTM D5185m 0	0	0	
Manganese	ppm	ASTM D5185m	<1	0	
Magnesium	ppm	ASTM D5185m 0	0	<1	
Calcium	ppm	ASTM D5185m 0	<1	0	
Phosphorus	ppm	ASTM D5185m 1800	988	827	855
Zinc	ppm	ASTM D5185m 0	0	0	
Sulfur	ppm	ASTM D5185m 0	0	20	0

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >60	17	17	16
Sodium	ppm	ASTM D5185m	<1	0	0
Potassium	ppm	ASTM D5185m >20	0	0	<1
Water	%	ASTM D6304 >.1	0.052	0.059	0.092
ppm Water	ppm	ASTM D6304 >1000	529	600	924.0






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	8039	1813	742
Particles >6µm	ASTM D7647 >1300	2761	206	202
Particles >14µm	ASTM D7647 >160	132	7	10
Particles >21µm	ASTM D7647 >40	15	1	3
Particles >38µm	ASTM D7647 >10	0	0	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	20/19/14	18/15/10	17/15/10

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	0.28	0.23	0.19


OIL ANALYSIS REPORT

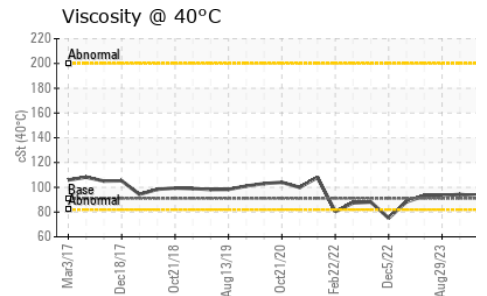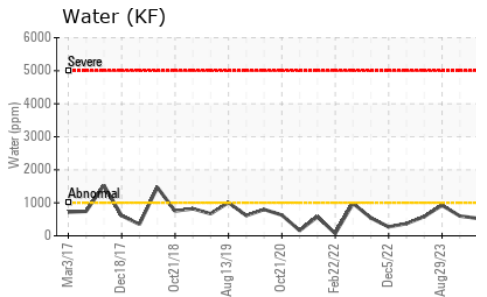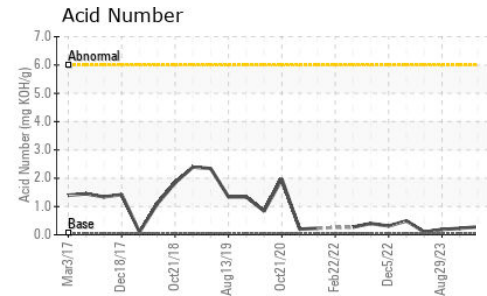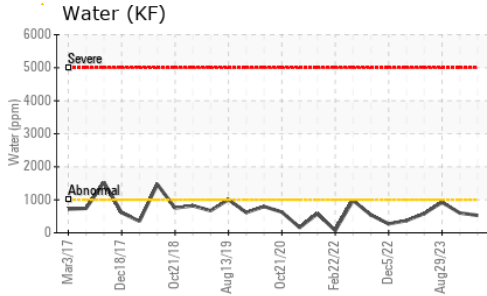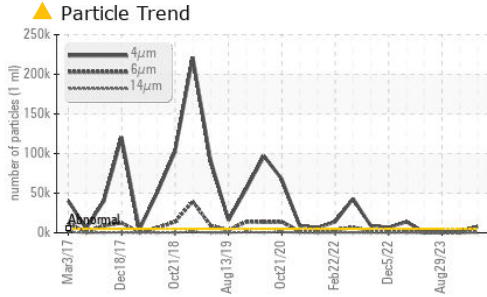






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	93.1	94.2	93.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

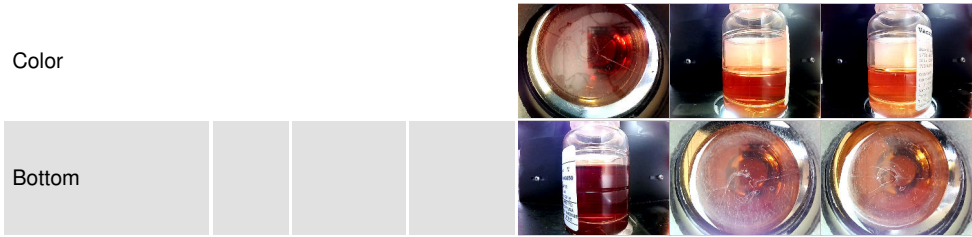

GRAPHS

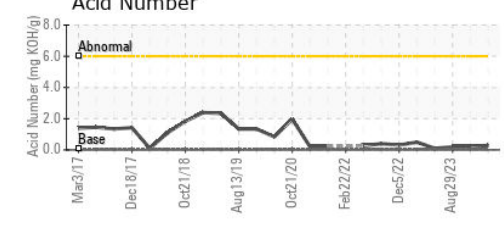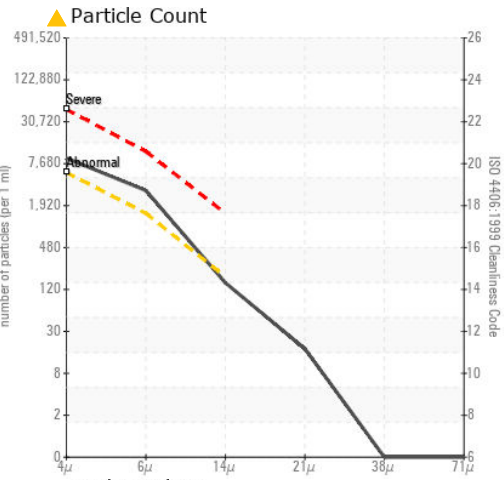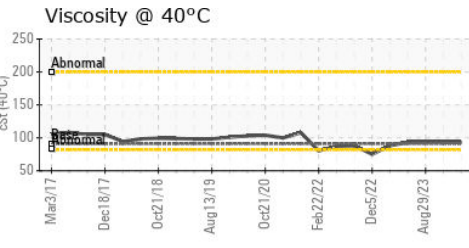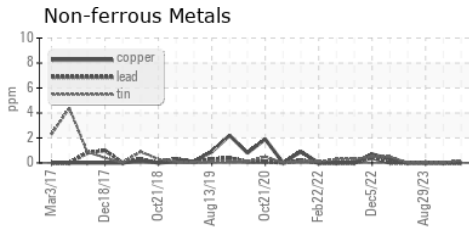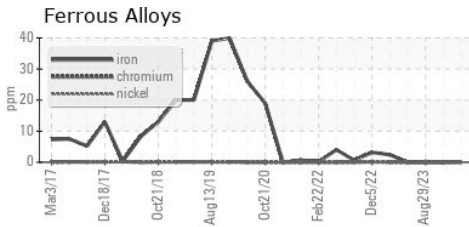

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM36691
Lab Number : 06150429
Unique Number : 10980507
Test Package : IND 2
Received : 16 Apr 2024
Tested : 17 Apr 2024
Diagnosed : 17 Apr 2024 - Doug Bogart

TYSON - PROCESS/SLAUGHTER - MAIN PLANT
 28424 38TH AVE N
 JOSLIN, IL
 US 61257
 Contact: RICK DUVALL

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)