




# OIL ANALYSIS REPORT

Sample Rating Trend

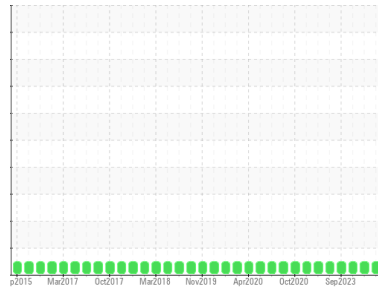

**NORMAL**



Area  
**CRANE**  
 Machine Id  
**ABILITY**  
 Component  
**Starboard Genset**  
 Fluid  
**CHEVRON DELO 400 MULTIGRADE 15W40 (5 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0791879</b>	WC0791874	WC0791873
Sample Date	Client Info		<b>02 Apr 2024</b>	20 Feb 2024	24 Jan 2024
Machine Age	hrs	Client Info	<b>46599</b>	46275	45951
Oil Age	hrs	Client Info	<b>250</b>	324	291
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>3</b>	0	6
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >12	<b>2</b>	4	4
Lead	ppm	ASTM D5185m >17	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m >70	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 151	<b>369</b>	407	358
Barium	ppm	ASTM D5185m 0.4	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 250	<b>119</b>	133	134
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 0	<b>625</b>	700	733
Calcium	ppm	ASTM D5185m 2046	<b>1588</b>	1673	1818
Phosphorus	ppm	ASTM D5185m 1043	<b>674</b>	731	761
Zinc	ppm	ASTM D5185m 943	<b>810</b>	860	897
Sulfur	ppm	ASTM D5185m 5012	<b>2842</b>	2803	3181

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>4</b>	5	6
Sodium	ppm	ASTM D5185m	<b>2</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>7</b>	0	0

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.2</b>	0.4	0.3
Nitration	Abs/cm	*ASTM D7624 >20	<b>5.2</b>	6.5	6.3
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>22.6</b>	22.8	22.8


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>15.6</b>	16.5	16.2
Base Number (BN)	mg KOH/g	ASTM D2896 12.5	<b>9.5</b>	9.1	9.1




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

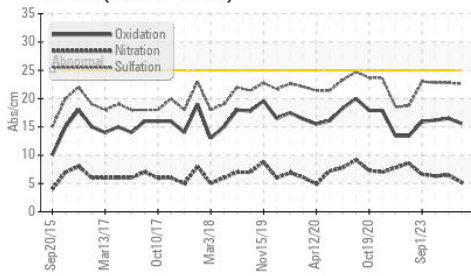

Base Number

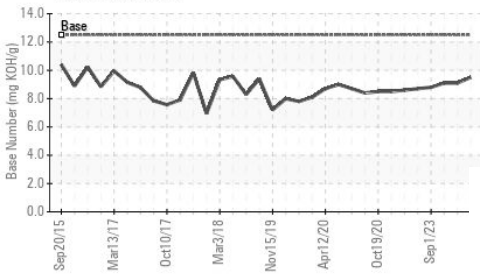

Viscosity @ 100°C

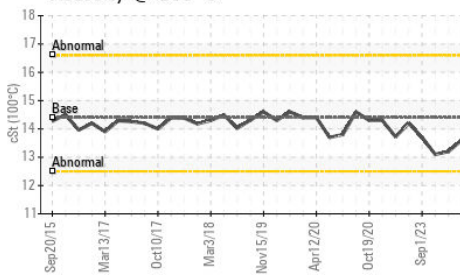


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>13.6</b>	13.2	13.1

## GRAPHS


Ferrous Alloys

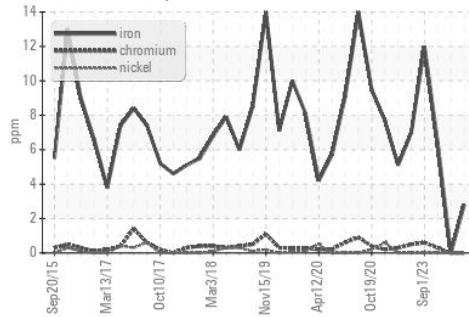


Non-ferrous Metals

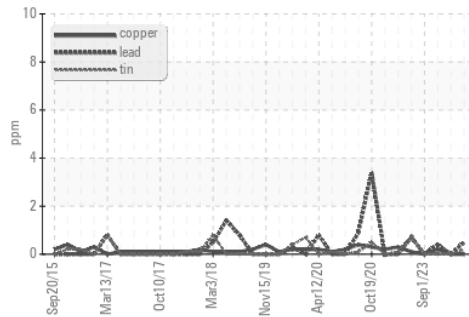

Viscosity @ 100°C

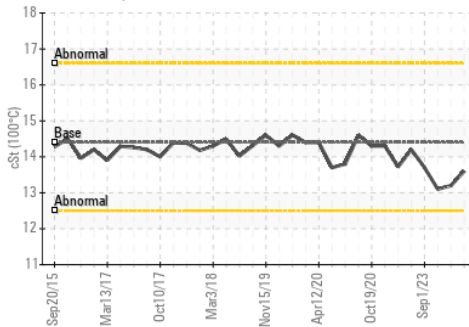

Base Number

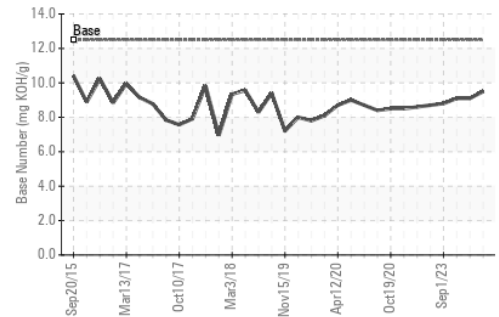

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0791879  
**Lab Number** : **06150975**  
**Unique Number** : 10981053  
**Test Package** : FLEET

**Received** : 16 Apr 2024  
**Tested** : 17 Apr 2024  
**Diagnosed** : 17 Apr 2024 - Wes Davis

**ASSOCIATED TERMINALS - CRANE**

CONVENT, LA  
 US 70723

Contact: GREG JOSEY  
 gjosey@associatedterminals.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (225)562-3515