




OIL ANALYSIS REPORT

Sample Rating Trend

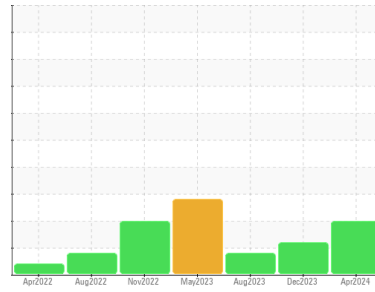

ISO



Machine Id
BL-42
 Component
Inboard Bearing
 Fluid
PETRO CANADA SYNDURO SHB ISO 68 (1 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		SBP0001133	SBP0001829	SBP0001827
Sample Date	Client Info		08 Apr 2024	12 Dec 2023	31 Aug 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		16	20	14
Iron	ppm	ASTM D5185m >20	6	7	3
Chromium	ppm	ASTM D5185m >20	0	0	0
Nickel	ppm	ASTM D5185m >20	<1	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	<1	0	0
Lead	ppm	ASTM D5185m >20	0	0	0
Copper	ppm	ASTM D5185m >20	4	2	<1
Tin	ppm	ASTM D5185m >20	2	1	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 5.0	0	0	6
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	1	0	0
Magnesium	ppm	ASTM D5185m 5.0	<1	0	4
Calcium	ppm	ASTM D5185m 5.0	6	1	0
Phosphorus	ppm	ASTM D5185m 100	129	110	108
Zinc	ppm	ASTM D5185m 5.0	0	<1	8
Sulfur	ppm	ASTM D5185m 1900	2811	2198	2364

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	2	1	1
Sodium	ppm	ASTM D5185m	2	0	0
Potassium	ppm	ASTM D5185m >20	1	0	0
Water	%	ASTM D6304 >2	0.002	0.003	0.003
ppm Water	ppm	ASTM D6304	24	29	36.6

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 28070	▲ 32651	▲ 30818
Particles >6µm	ASTM D7647	>2500	▲ 2935	● 3021	2053
Particles >14µm	ASTM D7647	>160	▲ 183	105	80
Particles >21µm	ASTM D7647	>40	▲ 50	29	20
Particles >38µm	ASTM D7647	>10	2	1	1
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 22/19/15	▲ 22/19/14	▲ 22/18/13


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.3	0.46	0.41	0.36




OIL ANALYSIS REPORT


▲ Particle Trend

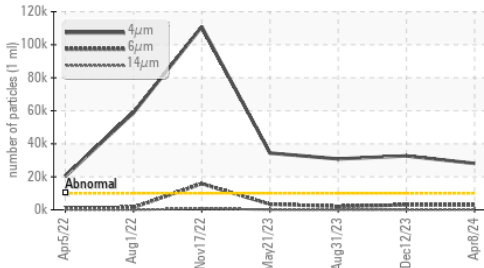


Water (KF)

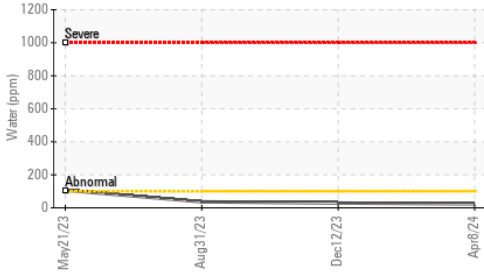


PQ

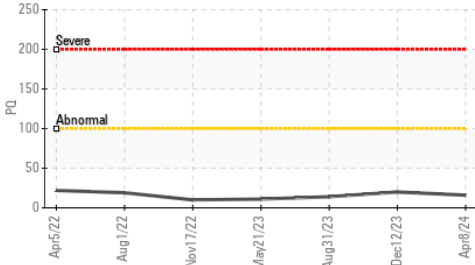

Water (KF)

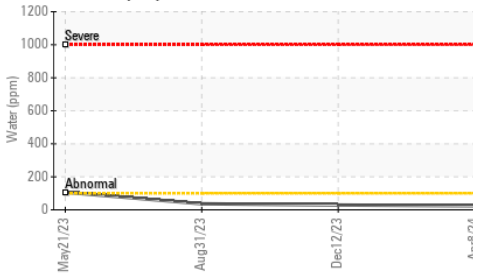

Viscosity @ 40°C

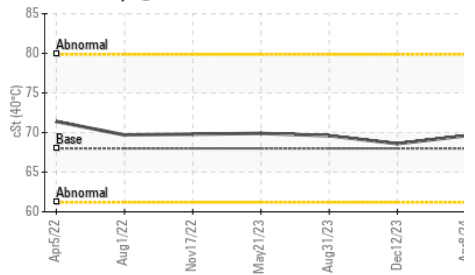


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.0	69.6	68.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

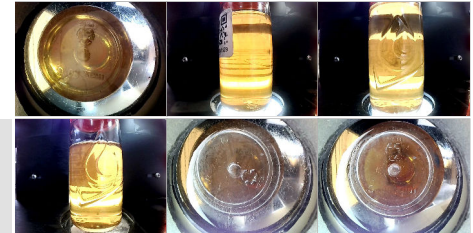


Bottom

GRAPHS


Ferrous Alloys

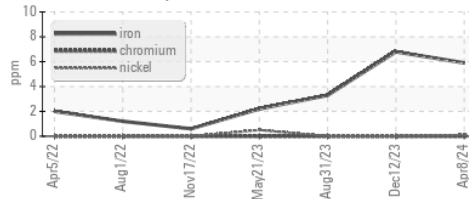


Non-ferrous Metals

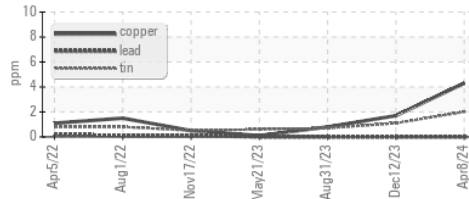


Viscosity @ 40°C

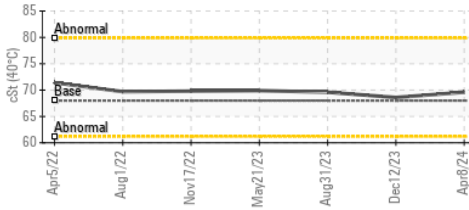

▲ Particle Count

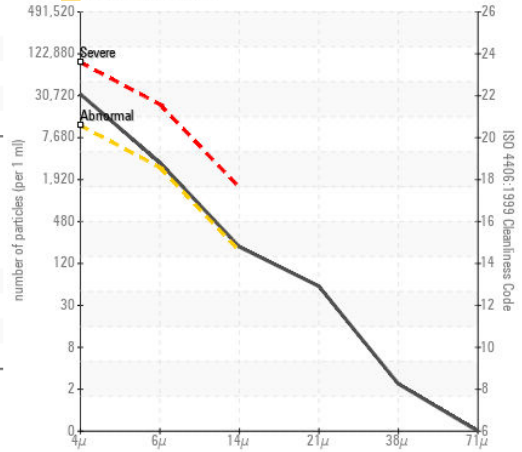

Acid Number

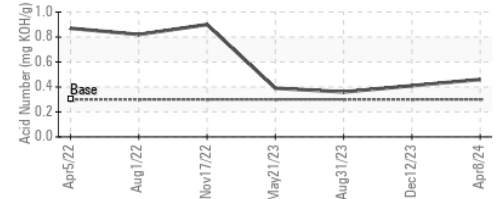

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : SBP0001133 **Received** : 16 Apr 2024
Lab Number : 06151076 **Tested** : 19 Apr 2024
Unique Number : 10981154 **Diagnosed** : 19 Apr 2024 - Don Baldrige
Test Package : PLANT

MONOLITH
 27077 SW 42ND ST
 HALLAM, NE
 US 68368

Contact: ALANA WALLACE
 alana.wallace@monolith-corp.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: