




# OIL ANALYSIS REPORT

Sample Rating Trend

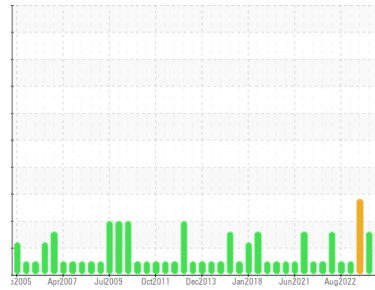

**WATER**



Machine Id  
**042CM12-601**

Component  
**Turbine**

Fluid  
**ROYAL PURPLE SYNFILM GT 32 (500 GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0027328</b>	RP0028198	RP0027338
Sample Date	Client Info		<b>15 Apr 2024</b>	15 Feb 2024	22 Oct 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>MARGINAL</b>	MARGINAL	ATTENTION

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185m	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >5	<b>2</b>	<1	0
Tin	ppm	ASTM D5185m >5	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>1</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>2</b>	1	4
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	2	1
Phosphorus	ppm	ASTM D5185m	<b>2715</b>	2224	2631
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>1</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	3
Water	%	ASTM D6304 >0.03	<b>▲ 0.100</b>	▲ 0.075	▲ 0.072
ppm Water	ppm	ASTM D6304 >300	<b>▲ 1006</b>	▲ 757	▲ 729.8






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>249</b>	197	1359
Particles >6µm	ASTM D7647	>640	<b>28</b>	75	619
Particles >14µm	ASTM D7647	>80	<b>2</b>	11	175
Particles >21µm	ASTM D7647	>20	<b>0</b>	4	62
Particles >38µm	ASTM D7647	>4	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>15/12/9</b>	15/13/11	18/16/15

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.26</b>	0.73	0.86


# OIL ANALYSIS REPORT

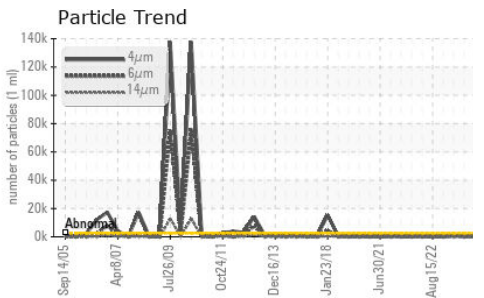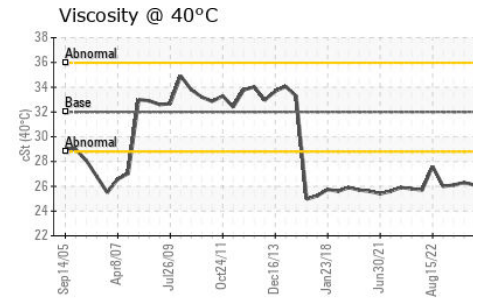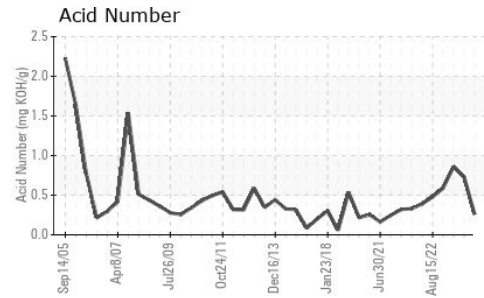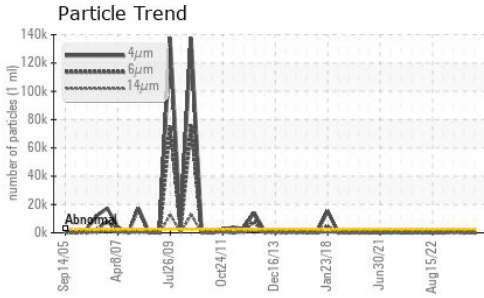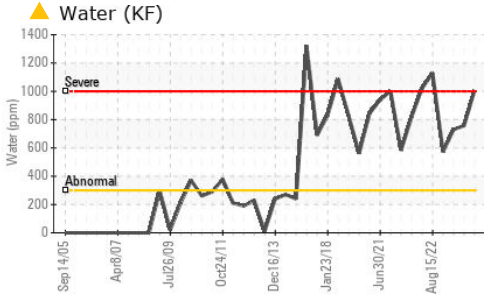






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	26.1	26.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

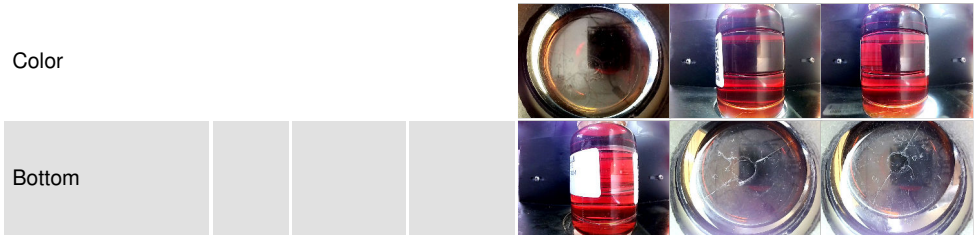

## GRAPHS

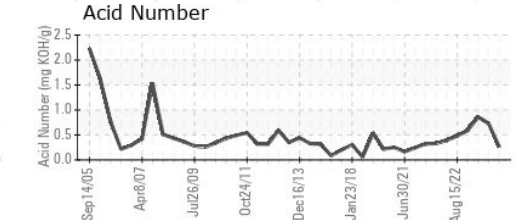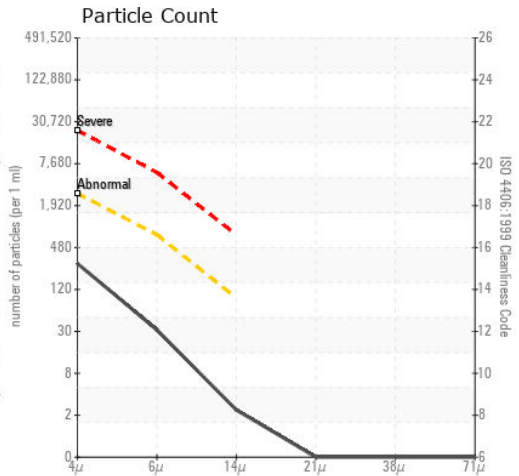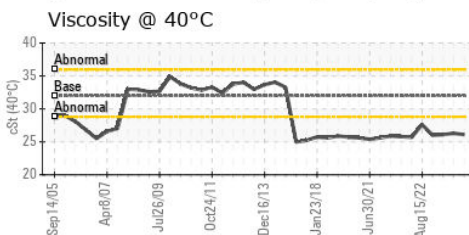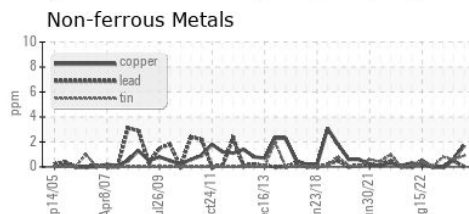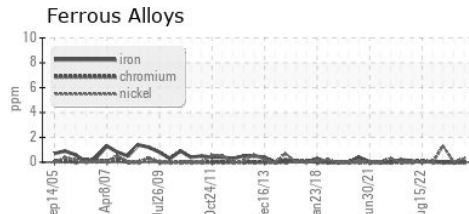

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0027328 **Received** : 16 Apr 2024  
**Lab Number** : 06151145 **Tested** : 19 Apr 2024  
**Unique Number** : 10981223 **Diagnosed** : 19 Apr 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**ENTERPRISE PRODUCTS**  
P.O. BOX 573  
MONT BELVIEU, TX  
US 77580  
Contact: TOMMY EDWARDS  
tedwards@eprod.com  
T: (281)217-1411  
F: (281)385-4327

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)