




# OIL ANALYSIS REPORT

## Sample Rating Trend

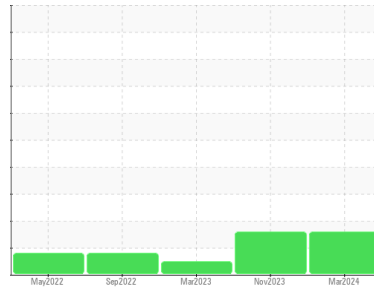

ISO



Machine Id  
**KAESER AS 25 7953768 (S/N 1515)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- LTR)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC06151148</b>	KC06007735	KC05792113
Sample Date	Client Info			<b>14 Mar 2024</b>	06 Nov 2023	08 Mar 2023
Machine Age	hrs	Client Info		<b>16324</b>	13184	9740
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>ATTENTION</b>	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>5</b>	3	5
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>52</b>	2	37
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>1</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>72</b>	3	59
Calcium	ppm	ASTM D5185m	2	<b>3</b>	0	3
Phosphorus	ppm	ASTM D5185m		<b>2</b>	0	<1
Zinc	ppm	ASTM D5185m		<b>0</b>	0	4

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>26</b>	28	21
Potassium	ppm	ASTM D5185m	>20	<b>10</b>	8	15
Water	%	ASTM D6304	>0.05	<b>0.017</b>	0.006	0.010
ppm Water	ppm	ASTM D6304	>500	<b>175</b>	64.6	107.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>5705</b>	15997	4014
Particles >6µm		ASTM D7647	>1300	<b>1688</b>	5423	926
Particles >14µm		ASTM D7647	>80	<b>147</b>	472	53
Particles >21µm		ASTM D7647	>20	<b>34</b>	123	14
Particles >38µm		ASTM D7647	>4	<b>2</b>	3	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/18/14</b>	21/20/16	19/17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.33</b>	0.26	0.29

# OIL ANALYSIS REPORT

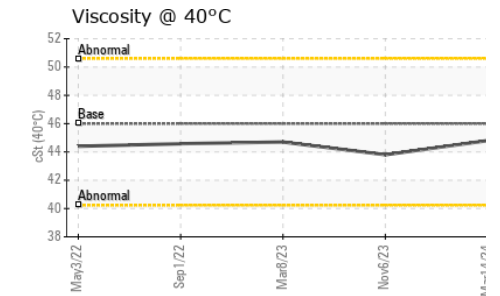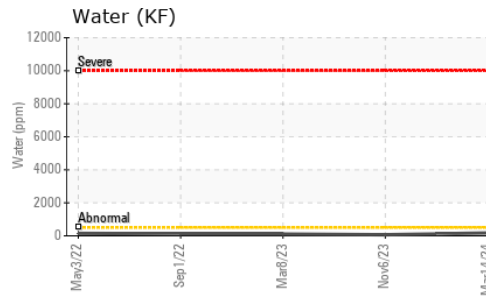
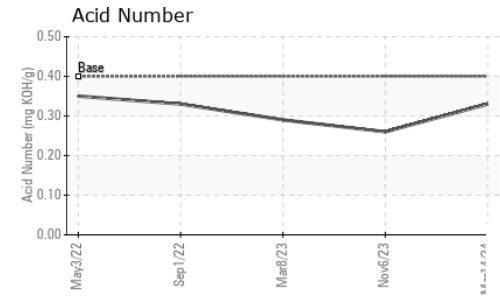
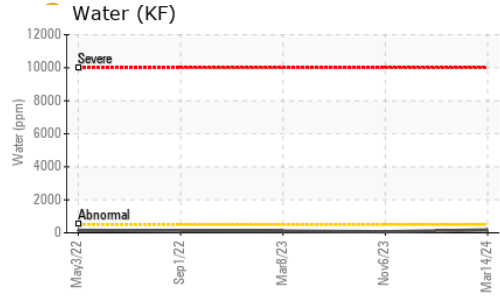
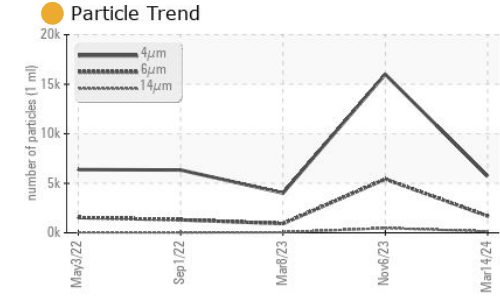


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.8	43.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

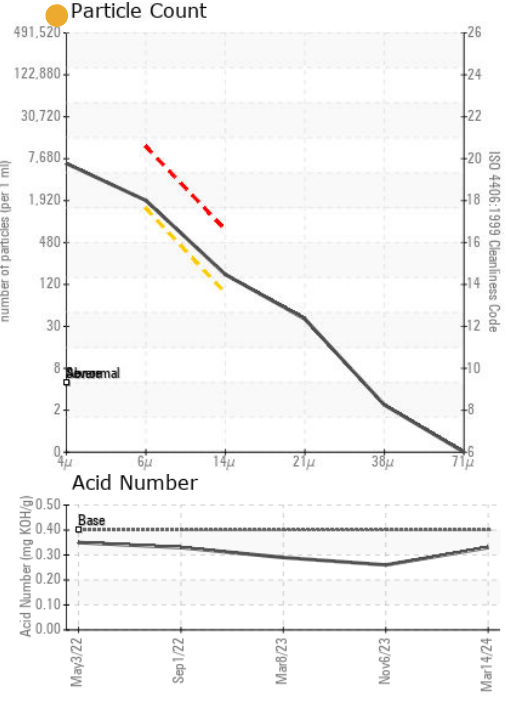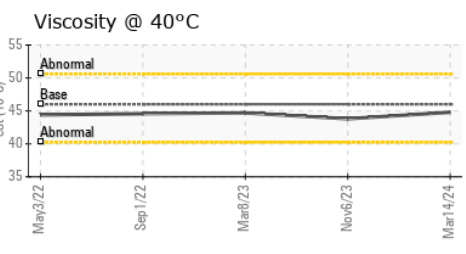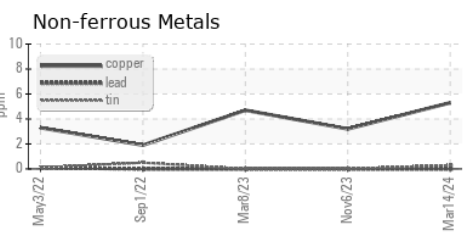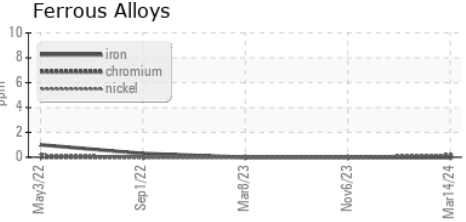

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06151148  
**Lab Number** : 06151148  
**Unique Number** : 10981226  
**Test Package** : IND 2  
**Received** : 16 Apr 2024  
**Tested** : 19 Apr 2024  
**Diagnosed** : 19 Apr 2024 - Don Baldrige

**WALGREENS DISTRIBUTION CENTER**  
 350 RACO PKWY  
 PENDERGRASS, GA  
 US 30567  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)