


OIL ANALYSIS REPORT

Sample Rating Trend

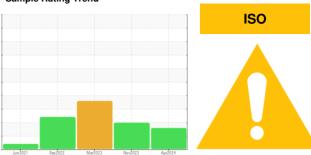

Machine Id

2037271 (S/N 1524)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jun2021	Sep2022	Mar2023 Nov2023	Apr2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013558	KCPA011846	KCP54276
Sample Date		Client Info		11 Apr 2024	29 Nov 2023	07 Mar 2023
Machine Age	hrs	Client Info		10006	155557	149343
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	N/A	Not Changd
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	3
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	6	3	2
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	19
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		1	<1	<1
Magnesium	ppm	ASTM D5185m	90	3	36	55
Calcium	ppm	ASTM D5185m	2	<1	<1	0
Phosphorus	ppm	ASTM D5185m		0	2	2
Zinc	ppm	ASTM D5185m		0	<1	6
Sulfur	ppm	ASTM D5185m		20422	17392	20803
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	11	13	△ 36
Sodium	ppm	ASTM D5185m		4	15	23
Potassium	ppm	ASTM D5185m	>20	1	0	2
Water	%	ASTM D6304	>0.05	0.002	0.009	0.012
ppm Water	ppm	ASTM D6304	>500	20	97	129.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7279	4966	34506
Particles >6µm		ASTM D7647	>1300	<u>^</u> 2618	<u>^</u> 2647	<u></u> 16891
Particles >14μm		ASTM D7647	>80	4 363	▲ 506	<u></u> 2108
Particles >21µm		ASTM D7647	>20	<u> 111</u>	▲ 189	419
Particles >38µm		ASTM D7647	>4	3	<u> </u>	▲ 33
Particles >71µm		ASTM D7647	>3	0	1	2
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/19/16	1 9/19/16	<u>22/21/18</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34	0.32	0.35



OIL ANALYSIS REPORT







Certificate 12367

Laboratory Sample No. Lab Number

: KCPA013558 : 06151168 Unique Number: 10981246

Received : 16 Apr 2024 **Tested** Diagnosed

: 19 Apr 2024

: 19 Apr 2024 - Don Baldridge Test Package : IND 2 (Additional Tests: KF, PrtCount)

US 95678 Contact: FERNANDO MOTA fernandomota@pptech.com T:

8801 WASHINGTON BLVD, SUITE 109

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F:

ROSEVILLE, CA