




# OIL ANALYSIS REPORT

## Sample Rating Trend

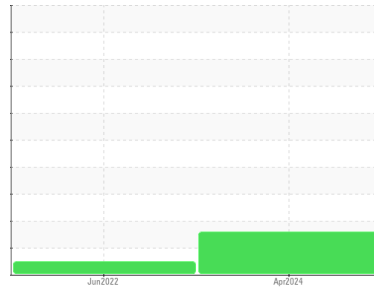

ISO



Machine Id

**7980878 (S/N 1174)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### ▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### ▲ Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA017071</b>	KCP51141	---
Sample Date	Client Info			<b>09 Apr 2024</b>	22 Jun 2022	---
Machine Age	hrs	Client Info		<b>9432</b>	3142	---
Oil Age	hrs	Client Info		<b>5825</b>	3142	---
Oil Changed	Client Info			<b>Changed</b>	Changed	---
Sample Status				<b>ABNORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>1</b>	1	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>15</b>	16	---
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>1</b>	0	---
Magnesium	ppm	ASTM D5185m	100	<b>5</b>	5	---
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	---
Phosphorus	ppm	ASTM D5185m	0	<b>0</b>	5	---
Zinc	ppm	ASTM D5185m	0	<b>73</b>	31	---
Sulfur	ppm	ASTM D5185m	23500	<b>22961</b>	16721	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>3</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	---
Water	%	ASTM D6304	>0.05	<b>0.008</b>	0.010	---
ppm Water	ppm	ASTM D6304	>500	<b>88</b>	100.3	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>14103</b>	2369	---
Particles >6µm		ASTM D7647	>1300	▲ <b>2808</b>	555	---
Particles >14µm		ASTM D7647	>80	▲ <b>124</b>	35	---
Particles >21µm		ASTM D7647	>20	▲ <b>33</b>	6	---
Particles >38µm		ASTM D7647	>4	<b>1</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>17/13	▲ <b>19/14</b>	16/12	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.43</b>	0.35	---


# OIL ANALYSIS REPORT

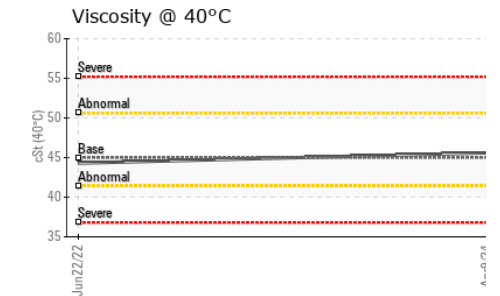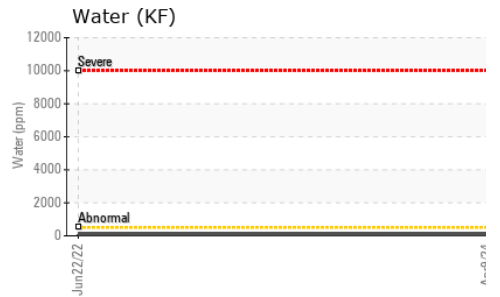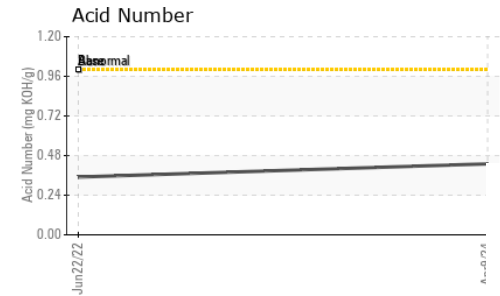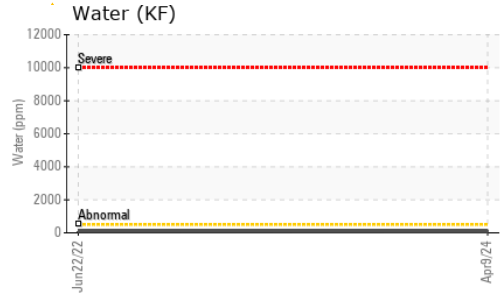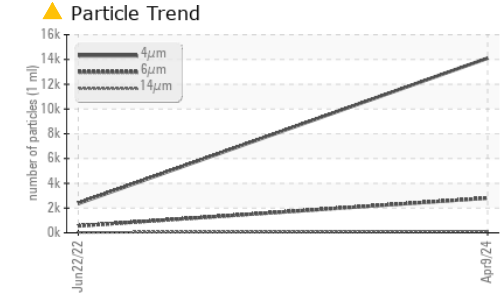






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.6	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

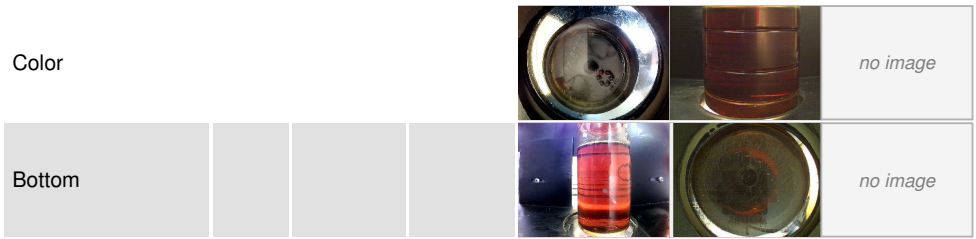

## GRAPHS

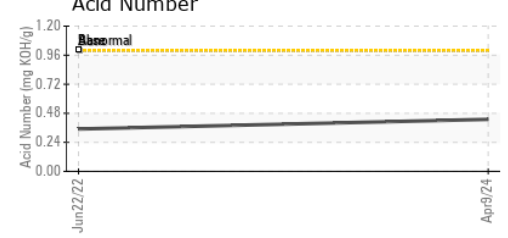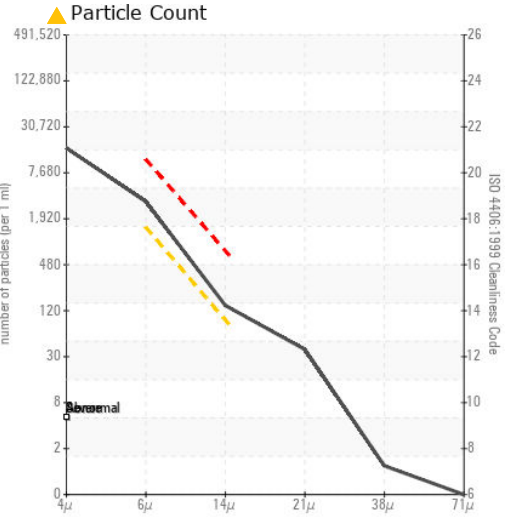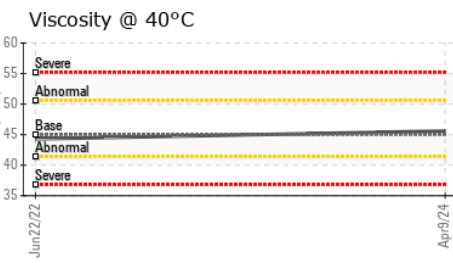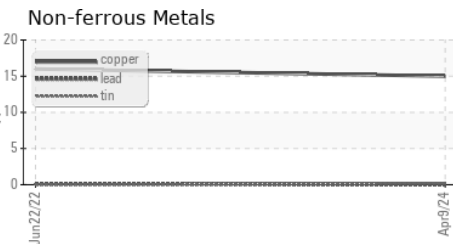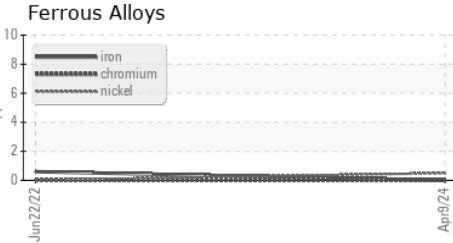

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA017071  
**Lab Number** : 06151188  
**Unique Number** : 10981266  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 16 Apr 2024  
**Tested** : 19 Apr 2024  
**Diagnosed** : 19 Apr 2024 - Don Baldrige

**STONE TRENDS**  
 18092 CHESTERFIELD AIRPORT RD  
 CHESTERFIELD, MO  
 US 63005  
 Contact: NATHAN B  
 NATHANB@STONETRENDLLC.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)