


# **OIL ANALYSIS REPORT**

Sample Rating Trend

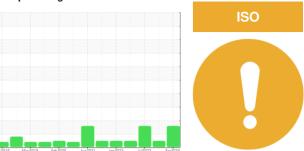

Machine Id

# KAESER ASD 40 6343480 (S/N 1483)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Sep2018	Vlay2019 Feb2020	Jun2021 Jan2023 Jul2023	Apr2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC123241	KC122710	KC122714
Sample Date		Client Info		04 Apr 2024	23 Oct 2023	10 Jul 2023
Machine Age	hrs	Client Info		19759	18446	17584
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ATTENTION	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	1	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	9	8	7
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	10
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		1	0	0
Magnesium	ppm	ASTM D5185m	90	6	<1	10
Calcium	ppm	ASTM D5185m	2	<1	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		49	0	1
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		6	3	0
Potassium	ppm	ASTM D5185m	>20	3	<1	2
Water	%	ASTM D6304	>0.05	0.007	0.007	0.009
ppm Water	ppm	ASTM D6304	>500	73	73.1	95.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5403	1652	9823
Particles >6μm		ASTM D7647	>1300	<b>1540</b>	338	<u>^</u> 2848
Particles >14μm		ASTM D7647	>80	<b>100</b>	38	<u>^</u> 209
Particles >21µm		ASTM D7647		<u> </u>	17	<b>△</b> 56
Particles >38μm		ASTM D7647	>4	1	1	2
Particles >71μm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>20/18/14</b>	18/16/12	<u>^</u> 20/19/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.38	0.34	0.36



## **OIL ANALYSIS REPORT**

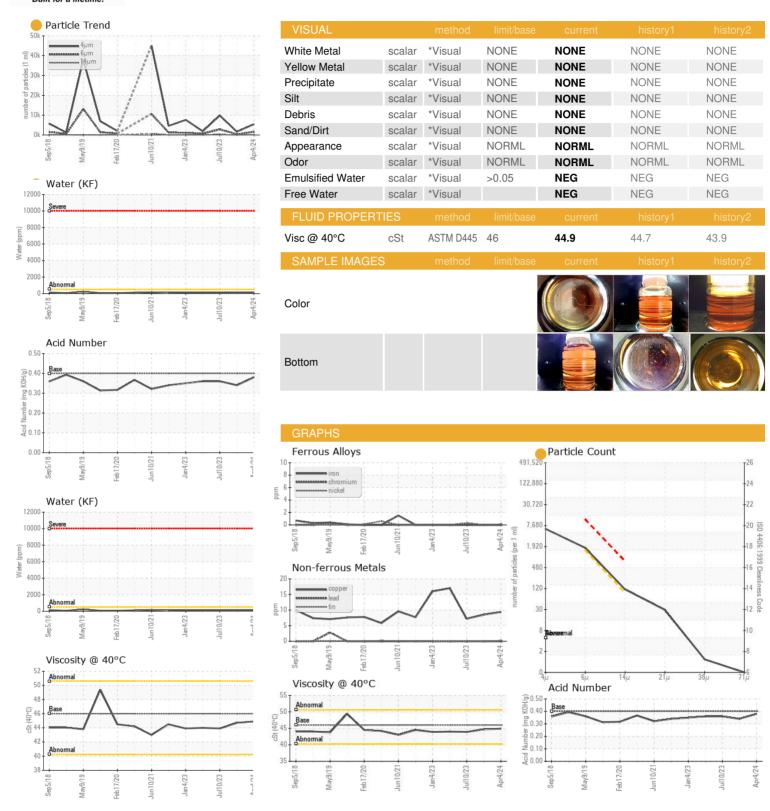





Certificate 12367

Laboratory Sample No. : KC123241 Lab Number : 06151219 Unique Number : 10981297 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 16 Apr 2024

Diagnosed

**Tested** : 19 Apr 2024 - Don Baldridge

: 19 Apr 2024

45150 US 27 DAVENPORT, FL US 33897 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**HUTTIG BUILDING - WOOD GRAIN** 

T:

F: