




OIL ANALYSIS REPORT

Sample Rating Trend

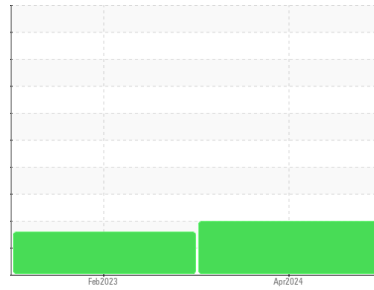

Machine Id
7285136 (S/N 1226)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

- Recommendation**
 The oil change at the time of sampling has been noted. We recommend you service the filters on this component. Resample at the next service interval to monitor.
- Wear**
 All component wear rates are normal.
- Contamination**
 There is a high amount of particulates present in the oil.
- Fluid Condition**
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA016813	KCP46356	---
Sample Date	Client Info		02 Apr 2024	20 Feb 2023	---
Machine Age	hrs	Client Info	6265	3469	---
Oil Age	hrs	Client Info	0	3469	---
Oil Changed	Client Info		Changed	Changed	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	<1	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	<1	<1	---
Lead	ppm	ASTM D5185m >10	0	0	---
Copper	ppm	ASTM D5185m >50	15	24	---
Tin	ppm	ASTM D5185m >10	<1	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	---
Barium	ppm	ASTM D5185m 90	0	2	---
Molybdenum	ppm	ASTM D5185m 0	0	0	---
Manganese	ppm	ASTM D5185m	1	0	---
Magnesium	ppm	ASTM D5185m 100	7	11	---
Calcium	ppm	ASTM D5185m 0	<1	0	---
Phosphorus	ppm	ASTM D5185m 0	2	10	---
Zinc	ppm	ASTM D5185m 0	0	12	---
Sulfur	ppm	ASTM D5185m 23500	24071	15966	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	<1	---
Sodium	ppm	ASTM D5185m	3	<1	---
Potassium	ppm	ASTM D5185m >20	3	3	---
Water	%	ASTM D6304 >0.05	0.005	0.006	---
ppm Water	ppm	ASTM D6304 >500	58	60.7	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		14190	56704	---
Particles >6µm	ASTM D7647	>1300	▲ 6790	▲ 23480	---
Particles >14µm	ASTM D7647	>80	▲ 764	▲ 479	---
Particles >21µm	ASTM D7647	>20	▲ 150	▲ 44	---
Particles >38µm	ASTM D7647	>4	▲ 6	1	---
Particles >71µm	ASTM D7647	>3	1	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/20/17	▲ 23/22/16	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.45	0.34	---


OIL ANALYSIS REPORT

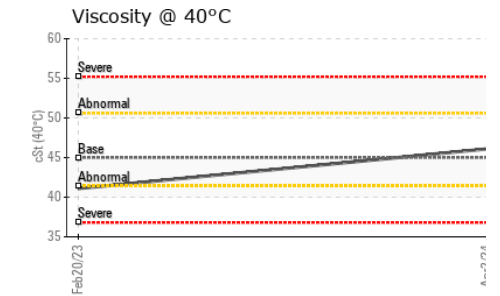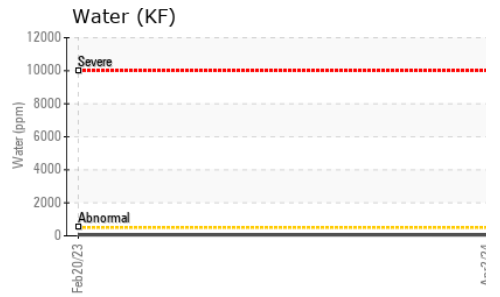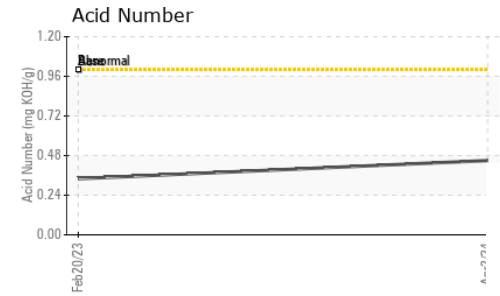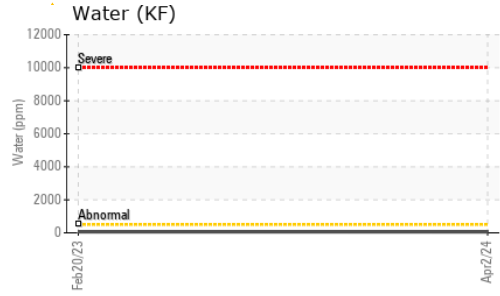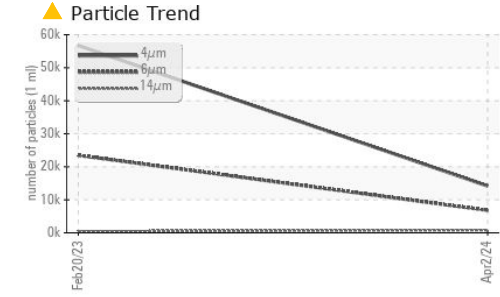





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.1	41.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

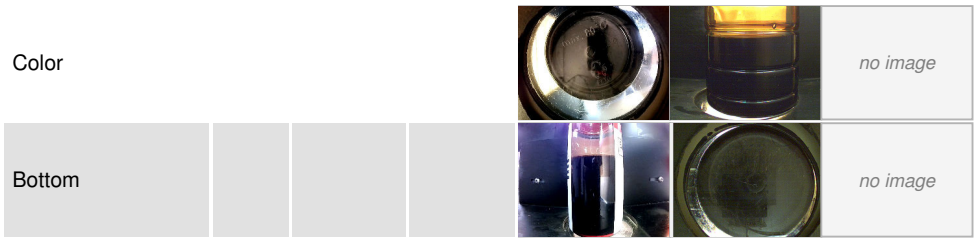

GRAPHS

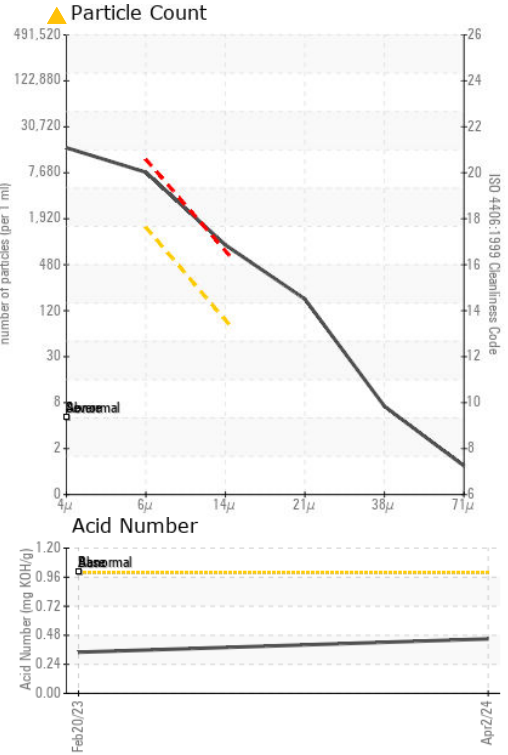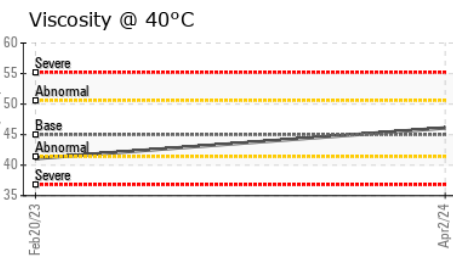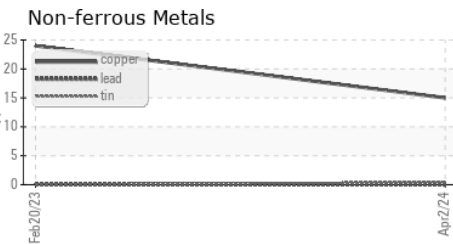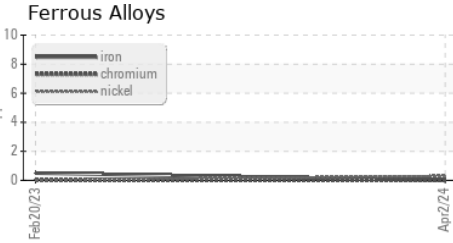

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016813 **Received** : 16 Apr 2024
Lab Number : 06151222 **Tested** : 19 Apr 2024
Unique Number : 10981300 **Diagnosed** : 19 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

SCW CORP - DAY-O-LITE
 126 CHESTNUT ST
 WARWICK, RI
 US 02888
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)