




OIL ANALYSIS REPORT

Sample Rating Trend

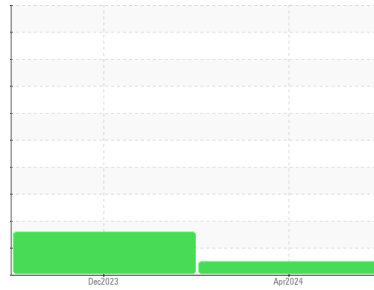

NORMAL



Machine Id
KAESER ASD 30T 8438391 (S/N 1141)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor. We were unable to perform a particle count due to insufficient sample.

Wear
 All component wear rates are normal.

Contamination
 There is no indication of any contamination in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA017179	KCPA011477	---
Sample Date	Client Info			08 Apr 2024	13 Dec 2023	---
Machine Age	hrs	Client Info		181	135	---
Oil Age	hrs	Client Info		181	0	---
Oil Changed	Client Info			Changed	N/A	---
Sample Status				NORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	0	<1	---
Nickel	ppm	ASTM D5185m	>3	<1	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	<1	2	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	2	<1	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	90	6	24	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		2	0	---
Magnesium	ppm	ASTM D5185m	100	68	85	---
Calcium	ppm	ASTM D5185m	0	2	2	---
Phosphorus	ppm	ASTM D5185m	0	<1	32	---
Zinc	ppm	ASTM D5185m	0	<1	0	---
Sulfur	ppm	ASTM D5185m	23500	22857	20230	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	---
Sodium	ppm	ASTM D5185m		9	3	---
Potassium	ppm	ASTM D5185m	>20	32	37	---
Water	%	ASTM D6304	>0.05	0.028	0.021	---
ppm Water	ppm	ASTM D6304	>500	288	215	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	80441	---
Particles >6µm		ASTM D7647	>1300	---	▲ 49317	---
Particles >14µm		ASTM D7647	>80	---	▲ 3842	---
Particles >21µm		ASTM D7647	>20	---	▲ 148	---
Particles >38µm		ASTM D7647	>4	---	0	---
Particles >71µm		ASTM D7647	>3	---	0	---
Oil Cleanliness		ISO 4406 (c)	>17/13	---	▲ 23/19	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.487	---


OIL ANALYSIS REPORT

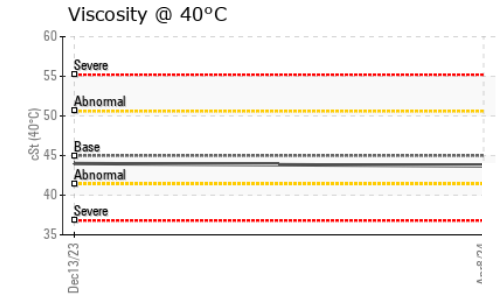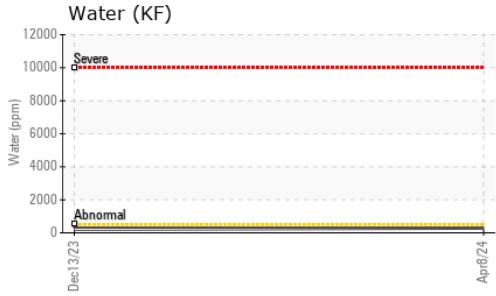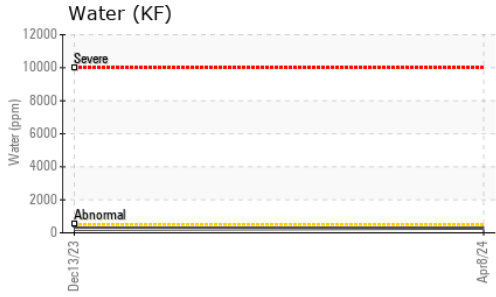






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	43.7	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

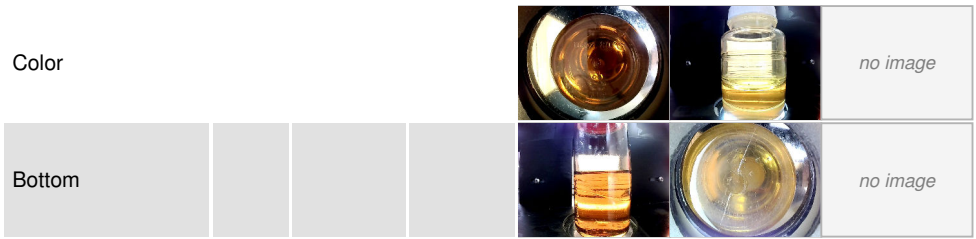

GRAPHS

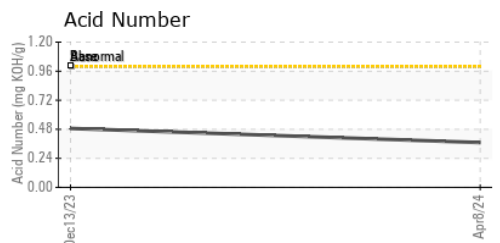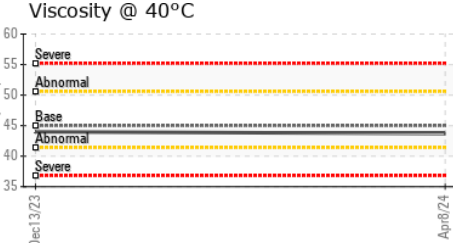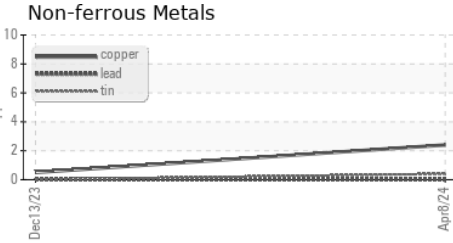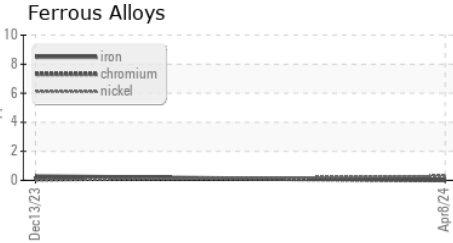

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA017179 **Received** : 16 Apr 2024
Lab Number : 06151227 **Tested** : 22 Apr 2024
Unique Number : 10981305 **Diagnosed** : 22 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AJ CEILING CO LLC
 9311 TROOST AVE
 KANSAS CITY, MO
 US 64131
 Contact: R HAAKE
 RHAAKE@AJMFG.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: