


# **OIL ANALYSIS REPORT**

# Preparation-Prep EB MILL

[Preparation-Prep EB MILL] 360014072 - EB MILL NON BUTYL TRANCHEUSE CUTTER

Hydraulic System

SHELL TELLUS S2 MX 46 (--- GAL)





## DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


## **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


| SAMPLE INFORM    | MATION   | method       | limit/base | current     | history1    | history2    |
|------------------|----------|--------------|------------|-------------|-------------|-------------|
| Sample Number    |          | Client Info  |            | TLC0001772  | TLC0001362  | TLC0001112  |
| Sample Date      |          | Client Info  |            | 11 Apr 2024 | 01 Feb 2024 | 30 Oct 2023 |
| Machine Age      | hrs      | Client Info  |            | 0           | 0           | 0           |
| Oil Age          | hrs      | Client Info  |            | 0           | 0           | 0           |
| Oil Changed      |          | Client Info  |            | N/A         | N/A         | N/A         |
| Sample Status    |          |              |            | NORMAL      | NORMAL      | NORMAL      |
| WEAR METALS      |          | method       | limit/base | current     | history1    | history2    |
| Iron             | ppm      | ASTM D5185m  | >20        | 0           | 0           | 0           |
| Chromium         | ppm      | ASTM D5185m  | >20        | 0           | 0           | 0           |
| Nickel           | ppm      | ASTM D5185m  | >20        | 0           | 0           | 0           |
| Titanium         | ppm      | ASTM D5185m  |            | 0           | 0           | 0           |
| Silver           | ppm      | ASTM D5185m  |            | 0           | 0           | 0           |
| Aluminum         | ppm      | ASTM D5185m  | >20        | 0           | 0           | 0           |
| Lead             | ppm      | ASTM D5185m  | >20        | 0           | 0           | 0           |
| Copper           | ppm      | ASTM D5185m  | >20        | <1          | <1          | 0           |
| Tin              | ppm      | ASTM D5185m  | >20        | 0           | 0           | 0           |
| Vanadium         | ppm      | ASTM D5185m  |            | 0           | 0           | 0           |
| Cadmium          | ppm      | ASTM D5185m  |            | 0           | 0           | 0           |
| ADDITIVES        |          | method       | limit/base | current     | history1    | history2    |
| Boron            | ppm      | ASTM D5185m  | 0          | 0           | 0           | 0           |
| Barium           | ppm      | ASTM D5185m  | 0          | 0           | 0           | 0           |
| Molybdenum       | ppm      | ASTM D5185m  | 0          | 0           | 0           | 0           |
| Manganese        | ppm      | ASTM D5185m  | 0          | 0           | 0           | 0           |
| Magnesium        | ppm      | ASTM D5185m  | 70         | 45          | 50          | 53          |
| Calcium          | ppm      | ASTM D5185m  | 10         | 13          | 12          | 15          |
| Phosphorus       | ppm      | ASTM D5185m  | 300        | 219         | 242         | 242         |
| Zinc             | ppm      | ASTM D5185m  | 325        | 250         | 292         | 300         |
| Sulfur           | ppm      | ASTM D5185m  | 665        | 873         | 882         | 880         |
| CONTAMINANTS     | ;        | method       | limit/base | current     | history1    | history2    |
| Silicon          | ppm      | ASTM D5185m  | >15        | 0           | 0           | 0           |
| Sodium           | ppm      | ASTM D5185m  |            | 4           | 2           | <1          |
| Potassium        | ppm      | ASTM D5185m  | >20        | 11          | 0           | 0           |
| Water            | %        | ASTM D6304   | >0.05      | NEG         | NEG         | NEG         |
| FLUID CLEANLIN   | IESS     | method       | limit/base | current     | history1    | history2    |
| Particles >4μm   |          | ASTM D7647   | >5000      | 1382        | 956         | 1387        |
| Particles >6µm   |          | ASTM D7647   | >1300      | 431         | 327         | 429         |
| Particles >14μm  |          | ASTM D7647   | >160       | 31          | 34          | 26          |
| Particles >21µm  |          | ASTM D7647   | >40        | 6           | 10          | 6           |
| Particles >38μm  |          | ASTM D7647   | >10        | 0           | 1           | 0           |
| Particles >71μm  |          | ASTM D7647   | >3         | 0           | 0           | 0           |
| Oil Cleanliness  |          | ISO 4406 (c) | >19/17/14  | 18/16/12    | 17/16/12    | 18/16/12    |
| FLUID DEGRADA    | ATION    | method       | limit/base | current     | history1    | history2    |
| Acid Number (AN) | mg KOH/g | ASTM D8045   | 0.35       | 0.26        | 0.22        | 0.25        |




# **OIL ANALYSIS REPORT**











| VISUAL                  |        | method  |            |         |          | history2 |
|-------------------------|--------|---------|------------|---------|----------|----------|
| White Metal             | scalar | *Visual | NONE       | NONE    | NONE     | NONE     |
| Yellow Metal            | scalar | *Visual | NONE       | NONE    | NONE     | NONE     |
| Precipitate             | scalar | *Visual | NONE       | NONE    | NONE     | NONE     |
| Silt                    | scalar | *Visual | NONE       | NONE    | NONE     | NONE     |
| Debris                  | scalar | *Visual | NONE       | NONE    | NONE     | NONE     |
| Sand/Dirt               | scalar | *Visual | NONE       | NONE    | NONE     | NONE     |
| Appearance              | scalar | *Visual | NORML      | NORML   | NORML    | NORML    |
| Odor                    | scalar | *Visual | NORML      | NORML   | NORML    | NORML    |
| <b>Emulsified Water</b> | scalar | *Visual | >0.05      | NEG     | NEG      | NEG      |
| Free Water              | scalar | *Visual |            | NEG     | NEG      | NEG      |
| FLUID PROPERT           | TIES   | method  | limit/base | current | history1 | history2 |

| I LOID I HOI LI | THES | memou     |      |      | Thistory i | HISTOLYZ |
|-----------------|------|-----------|------|------|------------|----------|
| Visc @ 40°C     | cSt  | ASTM D445 | 46.0 | 45.6 | 45.6       | 45.1     |

| SAIVII LL IIVIAGLS | memou |  |
|--------------------|-------|--|
|                    |       |  |
|                    |       |  |
|                    |       |  |
| Color              |       |  |





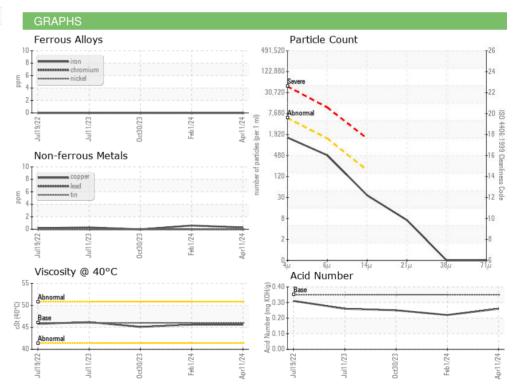





Certificate 12367

Laboratory Sample No.

: TLC0001772 Lab Number : 06151938

Unique Number : 10982016 Test Package : PLANT

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 17 Apr 2024 **Tested** : 19 Apr 2024

Diagnosed : 19 Apr 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Contact: TERRICK PRESLEY

terrick.presley@michelin.com T: (803)761-8053

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Submitted By: DUSTY LOLLIS

**MICHELIN US 10** 

ANDERSON, SC

16 BIBB WAY

US 29626