

OIL ANALYSIS REPORT

SAMPLE INFORMATION method

ISO

current

history1

historv2

Sample Rating Trend

limit/base

Machine Id

KAESER BSD 50 3892240 (S/N 2035)

Component Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130889	KC101517	KC105935
Sample Date		Client Info		16 Apr 2024	22 May 2023	10 Feb 2023
Machine Age	hrs	Client Info		69993	66265	63910
Oil Age	hrs	Client Info		6000	6000	2800
Oil Changed		Client Info		Changed	Not Changd	Not Changd
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	9	5	4
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	<1	0	16
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	<1	12	24
Calcium	ppm	ASTM D5185m	2	<1	0	0
Phosphorus	ppm	ASTM D5185m		<1	0	<1
Zinc	ppm	ASTM D5185m		0	4	0
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		<1	2	6
Potassium	ppm	ASTM D5185m	>20	<1	1	<1
Water	%	ASTM D6304	>0.05	0.005	0.004	0.009
ppm Water	ppm	ASTM D6304	>500	57	44.2	95.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		21975		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<mark>人</mark> 951		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	<mark>/</mark> 6		
Particles >71µm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 22/20/17		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.43	0.40	0.37





OIL ANALYSIS REPORT


50k	4μm 6μm			
30k		1		
20k -		$ \rangle$	Λ	
10k	IN	1		APPAPAT










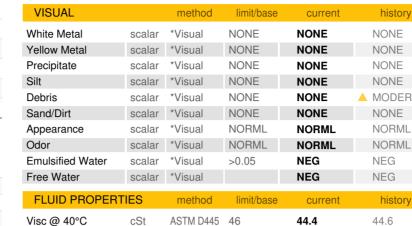

SAMPLE IMAGES method



history1

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

44.6

history

history2

NONE

NONE

NONE

NONE

MODER

NONE

NORML

NORML

history2


NEG

NEG

44.4

Bottom

Color

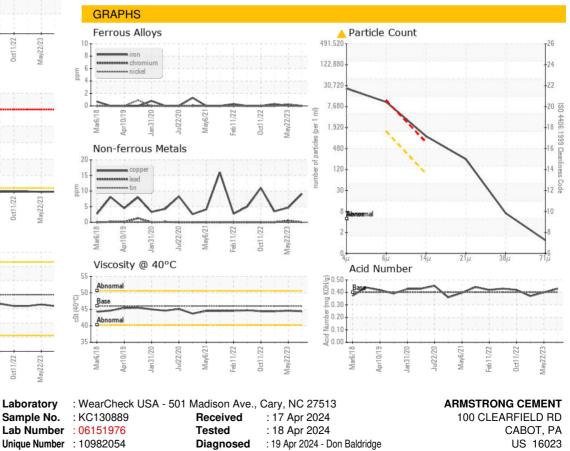

Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

Certificate 12367

Contact/Location: SERVICE MANAGER ? - ARMCAB

Contact: SERVICE MANAGER