




OIL ANALYSIS REPORT

Sample Rating Trend

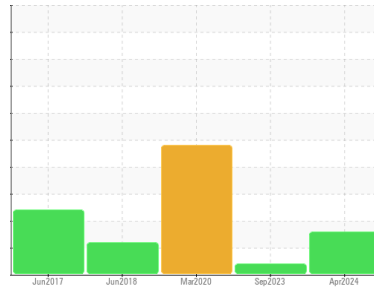

ISO



Machine Id
KAESER SX 6 2952002 (S/N 3286)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA016071	KCPA004016	KCP24417
Sample Date	Client Info		05 Apr 2024	04 Sep 2023	27 Mar 2020
Machine Age	hrs	Client Info	44572	44532	42556
Oil Age	hrs	Client Info	0	0	16
Oil Changed	Client Info		Not Chngd	N/A	Not Chngd
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	4	▲ 80
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	4	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	<1
Lead	ppm	ASTM D5185m >10	0	0	<1
Copper	ppm	ASTM D5185m >50	4	23	11
Tin	ppm	ASTM D5185m >10	0	<1	0
Antimony	ppm	ASTM D5185m	---	---	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	1
Barium	ppm	ASTM D5185m 90	60	2	<1
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 100	60	3	21
Calcium	ppm	ASTM D5185m 0	2	0	4
Phosphorus	ppm	ASTM D5185m 0	<1	4	1
Zinc	ppm	ASTM D5185m 0	2	7	14
Sulfur	ppm	ASTM D5185m 23500	19704	19551	21465

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	2
Sodium	ppm	ASTM D5185m	4	0	2
Potassium	ppm	ASTM D5185m >20	<1	<1	<1
Water	%	ASTM D6304 >0.05	0.012	0.008	▲ 0.371
ppm Water	ppm	ASTM D6304 >500	120	85.4	▲ 3710






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		13354	---	---
Particles >6µm	ASTM D7647	>1300	▲ 3697	---	---
Particles >14µm	ASTM D7647	>80	▲ 245	---	---
Particles >21µm	ASTM D7647	>20	▲ 51	---	---
Particles >38µm	ASTM D7647	>4	3	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/15	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.36	0.09	0.554


OIL ANALYSIS REPORT

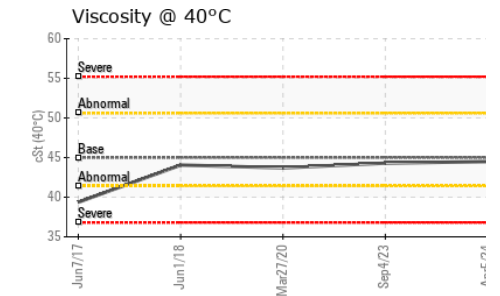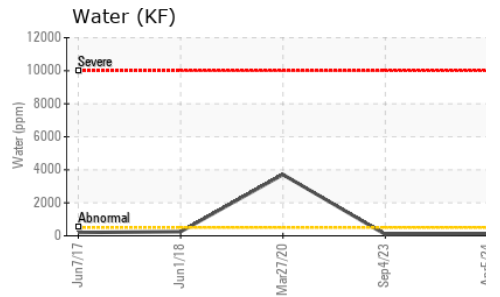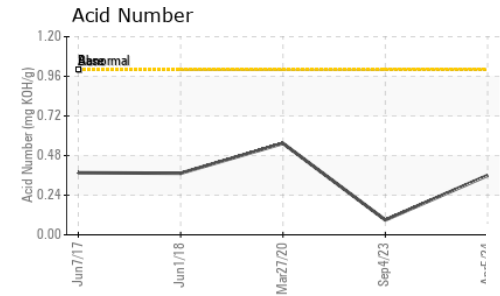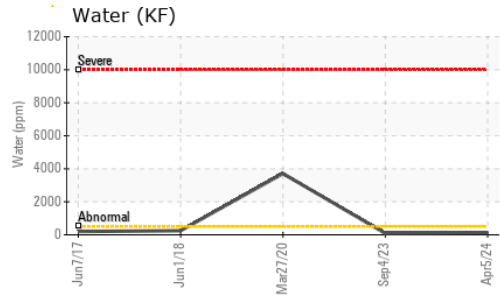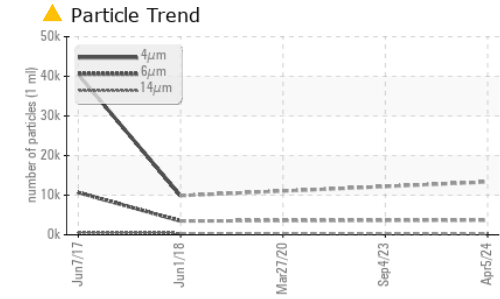






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	● HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	▲ 5.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.5	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

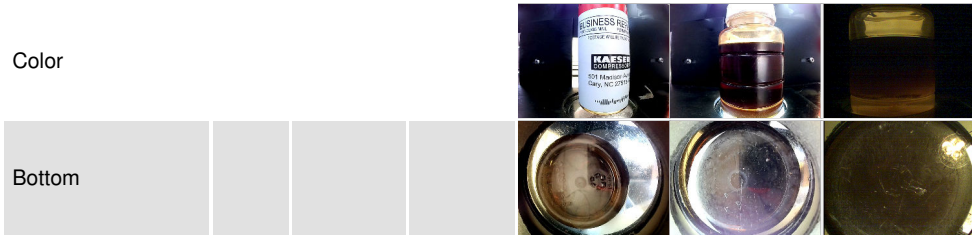

GRAPHS

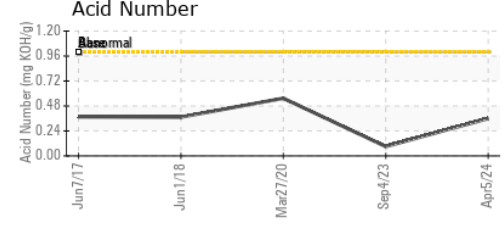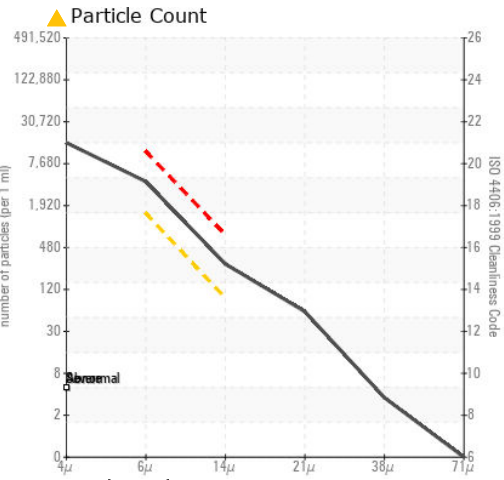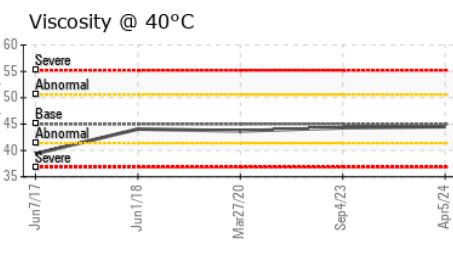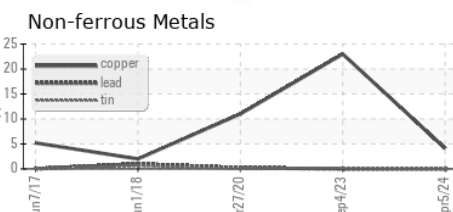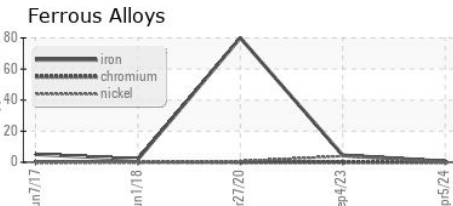

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016071 **Received** : 17 Apr 2024
Lab Number : 06151983 **Tested** : 18 Apr 2024
Unique Number : 10982061 **Diagnosed** : 19 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MCKESSON MEDICAL
 55 LYMAN ST
 NORTHBOROUGH, MA
 US 01532
 Contact: ERIC BERLO
 eric.berlo@mckesson.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)