




# OIL ANALYSIS REPORT

Sample Rating Trend

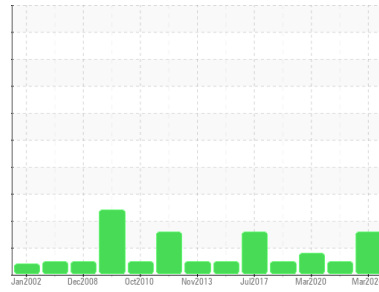

WATER



Machine Id  
**MCQUAY CAMALIER BLDG CH-1 (S/N 57A81082-00)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**EMKARATE RL 32H (8 GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a trace of moisture present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0660702</b>	WC05255045	WC0384345
Sample Date	Client Info		<b>18 Mar 2024</b>	16 Apr 2021	23 Mar 2020
Machine Age	hrs	Client Info	<b>55780</b>	48140	45240
Oil Age	hrs	Client Info	<b>55780</b>	0	0
Oil Changed	Client Info		<b>Not Changed</b>	Not Changed	Not Changed
Sample Status			<b>MARGINAL</b>	NORMAL	ATTENTION

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	<b>2</b>	0	2
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >50	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >100	<b>&lt;1</b>	0	6
Tin	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	5
Antimony	ppm	ASTM D5185m	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	<1	<1
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 5	<b>1598</b>	<1	1343
Zinc	ppm	ASTM D5185m 10	<b>10</b>	0	15
Sulfur	ppm	ASTM D5185m 50	<b>26</b>	0	8

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>2</b>	0	20
Sodium	ppm	ASTM D5185m	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304 >0.02	<b>▲ 0.022</b>	0.013	0.013
ppm Water	ppm	ASTM D6304 >250	<b>▲ 225</b>	132.4	135.0

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 .05	<b>0.041</b>	0.052	0.025




# OIL ANALYSIS REPORT

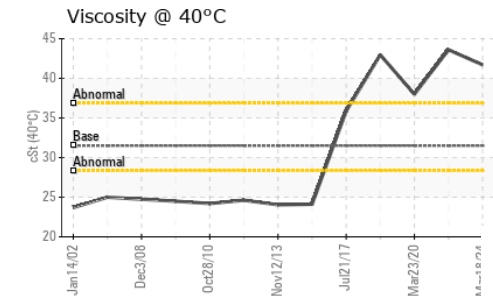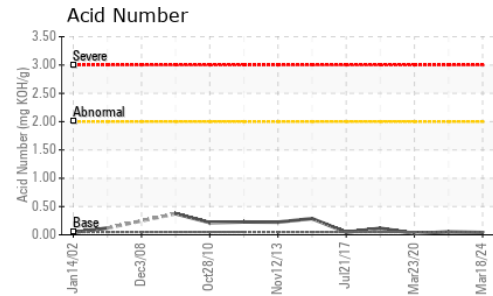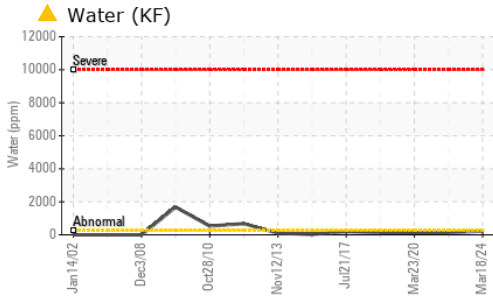





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.02	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	31.5	41.7	43.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

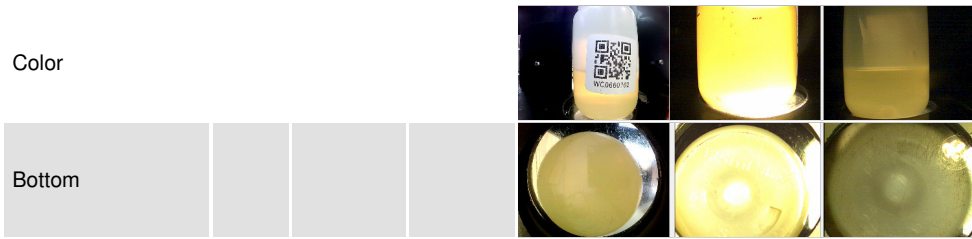

## GRAPHS

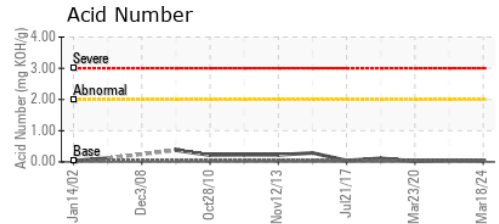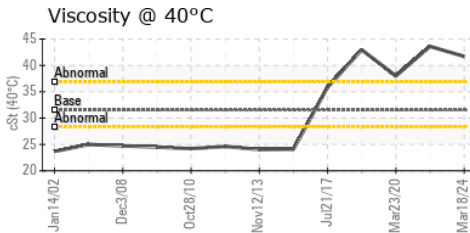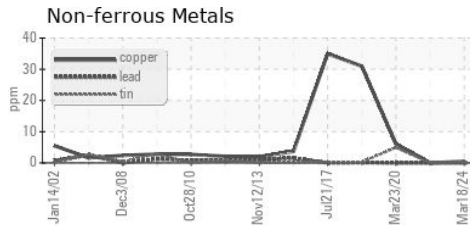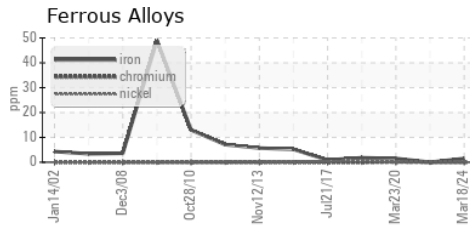

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0660702  
**Lab Number** : 06152037  
**Unique Number** : 10982115  
**Test Package** : IND 2  
**Received** : 17 Apr 2024  
**Tested** : 18 Apr 2024  
**Diagnosed** : 22 Apr 2024 - Jonathan Hester

**DAIKIN APPLIED**  
 5021 HOWERTON WAY SUITE P  
 BOWIE, MD  
 US 20715  
 Contact: ANDREW TURLINGTON  
 andrew.turlington@daikinapplied.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (301)735-1440  
F: (301)735-1838