


OIL ANALYSIS REPORT

VISION 8000 **HODGE 2104050218 - PRINT SAVE REPEAT**

Component Compressor



Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2				
Sample Number		Client Info		UHC0001103						
Sample Date		Client Info		15 Apr 2024						
Machine Age	hrs	Client Info		10115						
Oil Age	hrs	Client Info		0						
Oil Changed		Client Info		Changed						
Sample Status				NORMAL						
CONTAMINATION		method	limit/base	current	history1	history2				
Water		WC Method	>0.1	NEG						
WEAR METALS		method	limit/base	current	history1	history2				
Iron	ppm	ASTM D5185m	>50	0						
Chromium	ppm	ASTM D5185m	>10	<1						
Nickel	ppm	ASTM D5185m		0						
Titanium	ppm	ASTM D5185m		0						
Silver	ppm	ASTM D5185m		0						
Aluminum	ppm	ASTM D5185m	>25	<1						
Lead	ppm	ASTM D5185m	>25	0						
Copper	ppm	ASTM D5185m	>50	0						
Tin	ppm	ASTM D5185m	>15	<1						
Vanadium	ppm	ASTM D5185m		0						
Cadmium	ppm	ASTM D5185m		0						
ADDITIVES		method	limit/base	current	history1	history2				
Boron	ppm	ASTM D5185m		0						
Barium	ppm	ASTM D5185m		0						
Molybdenum	ppm	ASTM D5185m		0						
Manganese	ppm	ASTM D5185m		0						
Magnesium	ppm	ASTM D5185m		3						
Calcium	ppm	ASTM D5185m		2						
Phosphorus	ppm	ASTM D5185m		516						
Zinc	ppm	ASTM D5185m		68						
Sulfur	ppm	ASTM D5185m		1205						
CONTAMINANTS		method	limit/base	current	history1	history2				
Silicon	ppm	ASTM D5185m	>25	0						
Sodium	ppm	ASTM D5185m		0						
Potassium	ppm	ASTM D5185m	>20	0						
FLUID DEGRADA	TION	method	limit/base	current	history1	history2				
Acid Number (AN)	mg KOH/g	ASTM D8045		1.00						



OIL ANALYSIS REPORT

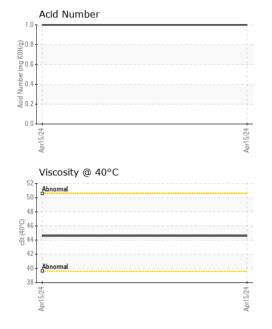

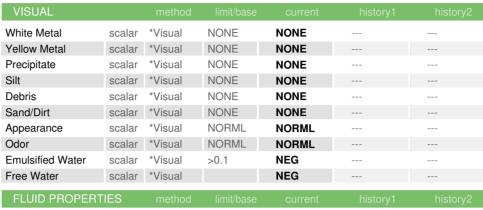


SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

44.6

GRAPHS


Visc @ 40°C




cSt

ASTM D445

Non-fe	errous	Me	tals								
8	copper	1									
E 6 -	non lead	J									
4											
0				 	 	 	 	 	 		
Apr15/24										Apr15/24	









Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Lab Number : 06152075

: UHC0001103 Unique Number : 10982153

Received : 17 Apr 2024 **Tested**

: 18 Apr 2024 Diagnosed : 19 Apr 2024 - Sean Felton

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ATLANTA AIR COMPRESSOR

123 MERCHANTS PARK DR HOSCHTON, GA

> US 30548 Contact: Derik Bray

Derik@atlantaaircompressor.com

T: (470)252-9952 F: x: