

OIL ANALYSIS REPORT

Area NOT GIVEN [8829] Machine Id KAESER 1051 - POWER PLANT SERVICES

Component Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

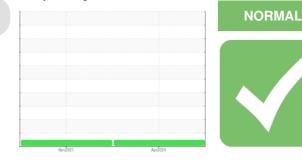


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI06152092	UCH05415578	
Sample Date		Client Info		02 Apr 2024	30 Nov 2021	
Machine Age	hrs	Client Info		54230	45511	
Oil Age	hrs	Client Info		3000	2162	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	١	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	2	
Chromium	ppm	ASTM D5185m	>10	<1	<1	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	2	4	
Tin	ppm	ASTM D5185m	>10	0	<1	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	17	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m		24	47	
Calcium	ppm	ASTM D5185m		1	0	
Phosphorus	ppm	ASTM D5185m		3	6	
Zinc	ppm	ASTM D5185m		41	40	
Sulfur	ppm	ASTM D5185m		20263	15522	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		4	19	
Potassium	ppm	ASTM D5185m	>20	1	5	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.42	0.396	

Sample Rating Trend



OIL ANALYSIS REPORT

VISUAL

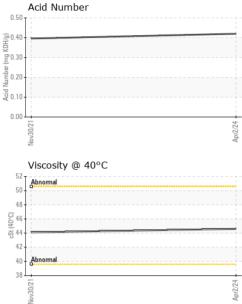

					NONE	
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate		*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	
Free Water	scalar	*Visual		NEG	NEG	
FLUID PROPERT	IES	method	limit/base	current	history1	history
Visc @ 40°C	cSt	ASTM D445		44.6	44.1	
SAMPLE IMAGES	S	method	limit/base	current	history1	history
Color						no image
Bottom						no image
GRAPHS						
Ferrous Alloys						
10 6 4 2 0 10 10 10 10 10 10 10 10 10			Api2/24			
Non-ferrous Metal	S		Apr2/24			
Non-ferrous Metal	S					
Non-ferrous Metal	S		Apr2/24			
Non-ferrous Metal	s		Apr2/24	Acid Number		
Non-ferrous Metal	s		Apr2/24			
Non-ferrous Metal	S		Apr2/24			
Non-ferrous Metal	S		Apr2/24			
Non-ferrous Metal	S		Apr2/24			
Non-ferrous Metal	S		Apr2/24 0000 0000 0000 0000 0000 0000 0000			
Non-ferrous Metal	S		Apr2/24 0000 0000 0000 0000 0000 0000 0000			
Non-ferrous Metal	S		Apr2/24			
Non-ferrous Metal			Apr2/24 Apr2/24 0000 Apr2/24 0000 Apr2/24 0000 Apr2/24 0000 Apr2/24	Nov30/21		
Non-ferrous Metal	1 Madison		(B)HQQ Bull adding 0.50 (B)HQQ Bull adding 0.20 (B)HQQ	Nov30/21	INDUSTRIES - DO 2201 CUR	
Non-ferrous Metal		ved : 17	Apr2/24 Apr2/24 0000 Apr2/24 0000 Apr2/24 0000 Apr2/24 0000 Apr2/24	Nov30/21	2201 CUR	WNERS GROVE
Non-ferrous Metal	1 Madison Receiv	red : 17 I : 18	(D)HQJ Bull addition (D)HQJ Bu	DELTA	2201 CUR	TISS STRE RS GROVE US 60

To discuss this sample report, • Denotes test methods that a Statements of conformity to sp

Report Id: UCDELDOW [WUSCAR] 06152092 (Generated: 04/20/2024 09:56:32) Rev: 1

Certificate L2367

Contact/Location: MICHAEL FERRIS - UCDELDOW