




# OIL ANALYSIS REPORT

Sample Rating Trend

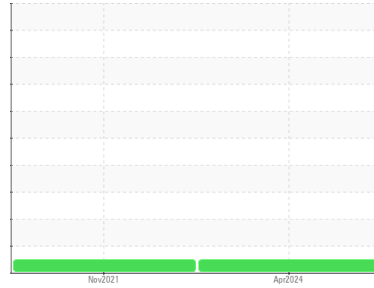

**NORMAL**



Area

**NOT GIVEN [8829]**

Machine Id

**GARDNER DENVER 5016268 - POWER PLANT SERVICES**

Component

**Compressor**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UDI06152094</b>	UCH05415585	---
Sample Date	Client Info		<b>02 Apr 2024</b>	03 Nov 2021	---
Machine Age	hrs	Client Info	<b>61313</b>	60707	---
Oil Age	hrs	Client Info	<b>30</b>	126	---
Oil Changed		Client Info	<b>Changed</b>	Changed	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>1</b>	<1	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >25	<b>1</b>	0	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m >50	<b>0</b>	<1	---
Tin	ppm	ASTM D5185m >15	<b>0</b>	<1	---
Antimony	ppm	ASTM D5185m	<b>---</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	<1	---
Barium	ppm	ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m	<b>1</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>296</b>	334	---
Zinc	ppm	ASTM D5185m	<b>87</b>	43	---
Sulfur	ppm	ASTM D5185m	<b>559</b>	243	---

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.26</b>	0.171	---



# OIL ANALYSIS REPORT

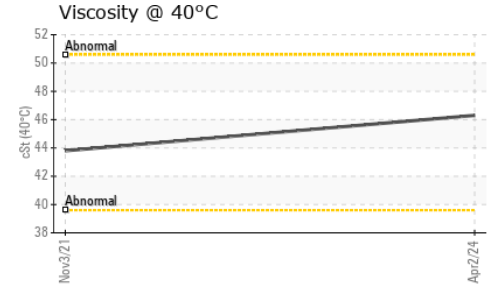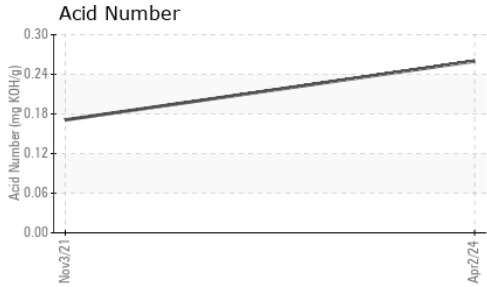





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	LIGHT
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>MODER</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>46.3</b>	43.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color						no image
Bottom						no image

## GRAPHS

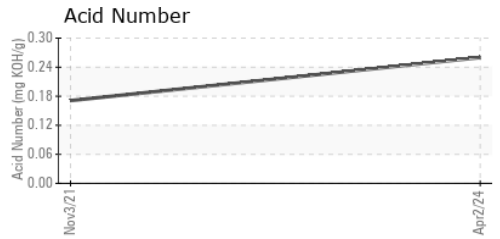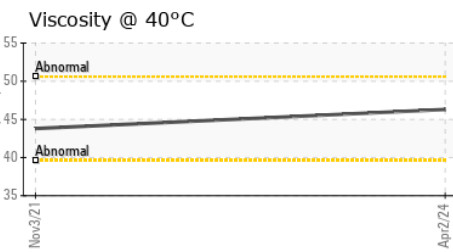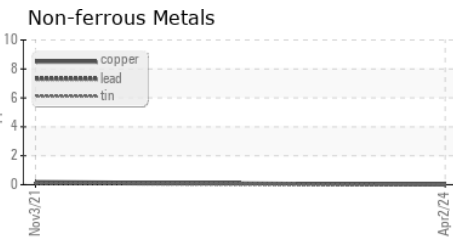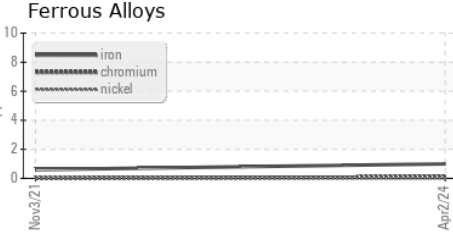

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UDI06152094      **Received** : 17 Apr 2024  
**Lab Number** : **06152094**      **Tested** : 18 Apr 2024  
**Unique Number** : 10982172      **Diagnosed** : 19 Apr 2024 - Sean Felton  
**Test Package** : IND 2

**DELTA INDUSTRIES - DOWNERS GROVE**  
 2201 CURTISS STREET  
 DOWNERS GROVE, IL  
 US 60515  
 Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (630)960-3931