

Area


PALASYN 45

Machine Id

SULLIVAN PALATEK 21EE002128 - AMPLIFY ENERGY

Component

Compressor

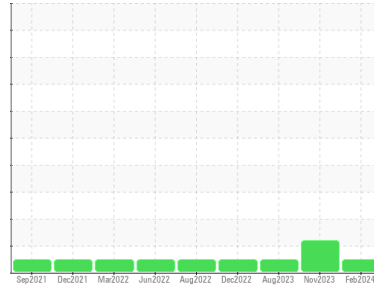

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info	UCS06152107	UCS06078386	UCS06152112	
Sample Date	Client Info	05 Feb 2024	07 Nov 2023	02 Aug 2023	
Machine Age	hrs	Client Info	11232	10223	9195
Oil Age	hrs	Client Info	2000	1100	3500
Oil Changed	Client Info	Not Chngd	Not Chngd	Changed	
Sample Status		NORMAL	ATTENTION	NORMAL	

CONTAMINATION method limit/base current history1 history2

Water	WC Method	>0.1	NEG	NEG	NEG
-------	-----------	------	------------	-----	-----

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	<1	<1
Lead	ppm	ASTM D5185m	>25	0	2	0
Copper	ppm	ASTM D5185m	>50	<1	2	<1
Tin	ppm	ASTM D5185m	>15	<1	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	<1	0

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m	0.0	0	0	0
Barium	ppm	ASTM D5185m	0.0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	<1	0
Manganese	ppm	ASTM D5185m	0	<1	2	<1
Magnesium	ppm	ASTM D5185m	0.0	0	2	0
Calcium	ppm	ASTM D5185m	0.0	<1	<1	<1
Phosphorus	ppm	ASTM D5185m	966	550	114	301
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	1309	1373	333	334



CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	2	2	1
Sodium	ppm	ASTM D5185m		<1	3	2
Potassium	ppm	ASTM D5185m	>20	1	4	2

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	0.17	0.53	0.83
------------------	----------	------------	-------	-------------	------	------


OIL ANALYSIS REPORT

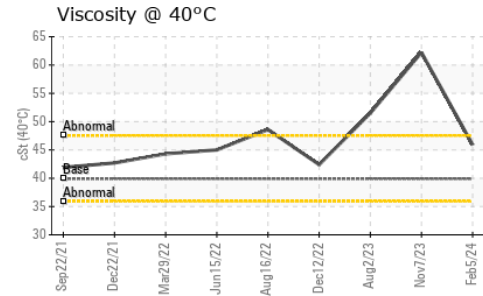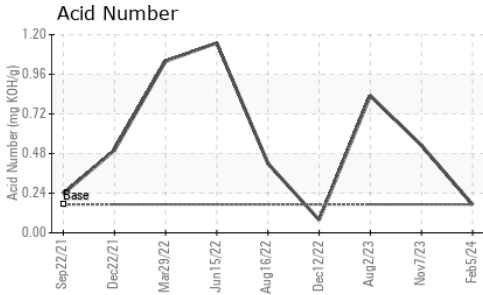





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	39.9	45.9	62.22

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

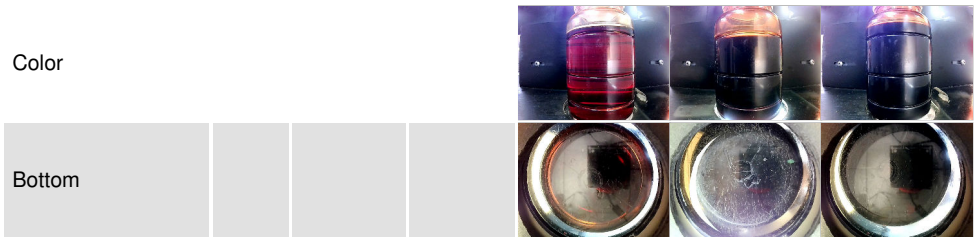

GRAPHS

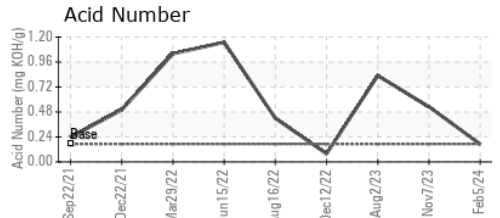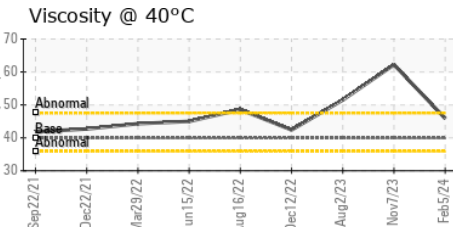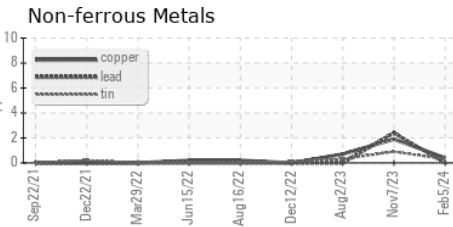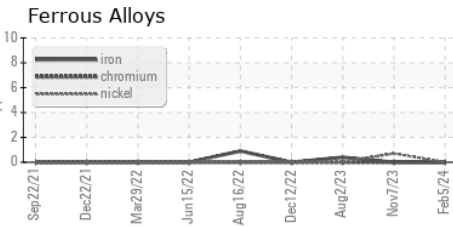

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCS06152107
Lab Number : 06152107
Unique Number : 10982185
Test Package : IND 2

Received : 17 Apr 2024
Tested : 18 Apr 2024
Diagnosed : 19 Apr 2024 - Sean Felton

COMPRESSION LEASING SERVICES, INC
 1935 N LOOP AVENUE & 1925 N LOOP AV
 CASPER, WY
 US 82601

Contact: ANGIE MANZANAREZ
 amanz@cls-inc.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (307)265-3242

F: (307)265-3221