




# OIL ANALYSIS REPORT

## Sample Rating Trend

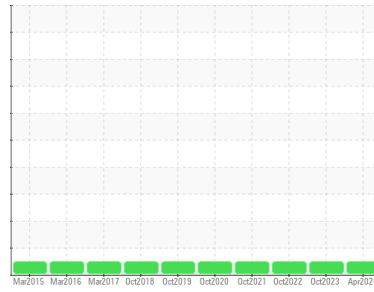

**NORMAL**



Area

[JL]

Machine Id

**P-304 (S/N 100098608)**

Component

**Pump**

Fluid

**MOBIL DTE ISO VG 46 (--- QTS)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0861268</b>	WC0861257	WC0749404
Sample Date	Client Info		<b>15 Apr 2024</b>	05 Oct 2023	12 Oct 2022
Machine Age	yrs	Client Info	<b>12</b>	11	12
Oil Age	yrs	Client Info	<b>1</b>	0	1
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>.1	<b>NEG</b>	NEG	NEG

### WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>75	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	0
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>117</b>	111	118
Zinc	ppm	ASTM D5185m		<b>76</b>	87	73
Sulfur	ppm	ASTM D5185m		<b>768</b>	663	535

### CONTAMINANTS



	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>2</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	<1	0

### FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.16</b>	0.14	0.16




# OIL ANALYSIS REPORT

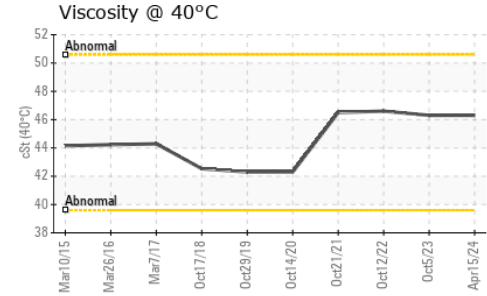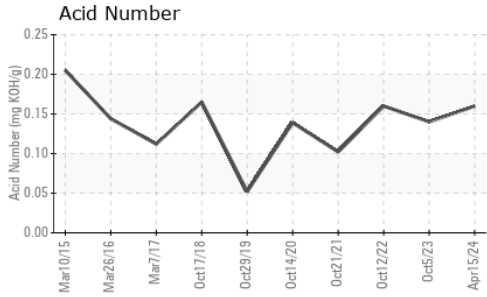





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.3	46.3	46.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

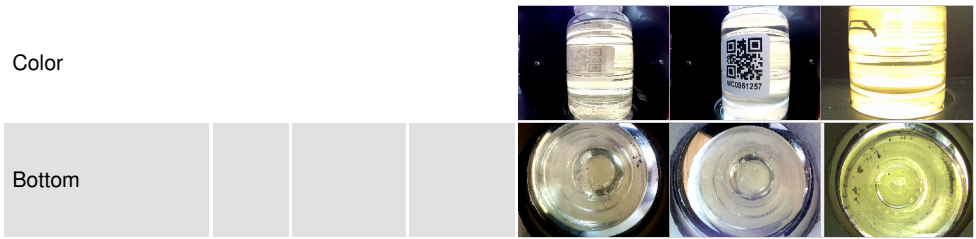

## GRAPHS

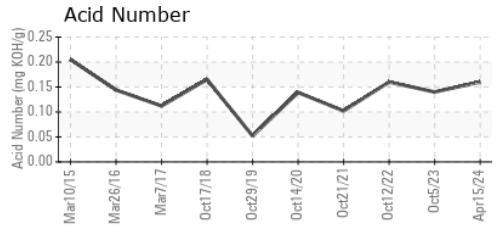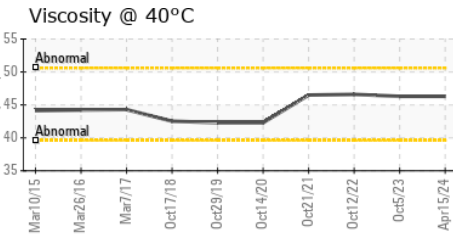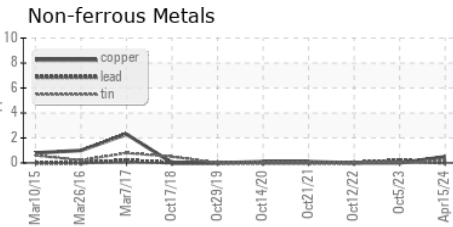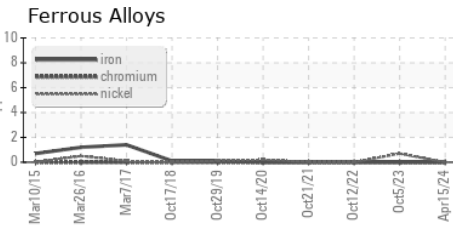

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0861268      **Received** : 17 Apr 2024  
**Lab Number** : 06152135      **Tested** : 18 Apr 2024  
**Unique Number** : 10982213      **Diagnosed** : 19 Apr 2024 - Sean Felton  
**Test Package** : IND 2

**PIEDMONT NATURAL GAS**  
 2256 HARPER HOUSE ROAD  
 FOUR OAKS, NC  
 US 27524  
 Contact: STEVE SMITH  
 steve.smith@duke-energy.com  
 T: (919)689-3907  
 F: (919)689-3360

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)