




# FUEL REPORT

## Sample Rating Trend

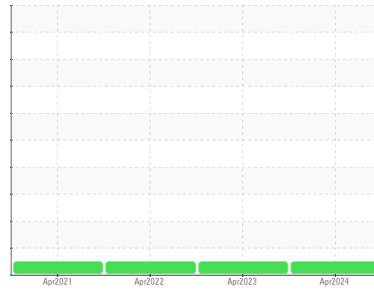

**NORMAL**



Area  
**[PMOAS53372589]**

Machine Id  
**100DSEJ 2115408**

Component  
**Diesel Fuel**

Fluid  
**No.2 DIESEL FUEL (LOW-SULPHUR) (--- GAL)**

### DIAGNOSIS

#### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

#### Corrosion

All metal levels are normal indicating no corrosion in the system.

#### Contaminants

There is no Bacteria, Yeast and/or Fungus indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel.

#### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>DC0035915</b>	DC0029072	DC0019528
Sample Date	Client Info			<b>08 Apr 2024</b>	03 Apr 2023	27 Apr 2022
Machine Age	hrs	Client Info		<b>0</b>	511	478
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		<b>L4.5</b>	L4.5	L5.0
Visc @ 40°C	cSt	ASTM D445	3.0	<b>2.46</b>	2.46	2.53


SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	250	<b>23</b>	56	61
Sulfur (UVF)	ppm	ASTM D5453		<b>32</b>	54	67

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	<b>36.7</b>	36.6	36.2

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	<1
Water	%	ASTM D6304	<0.05	<b>0.003</b>	0.003	0.003
ppm Water	ppm	ASTM D6304	<500	<b>26</b>	38.2	26.6
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	0.0	0.0
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	0.0	0.0


HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	0
Iron	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0

### SAMPLE IMAGES

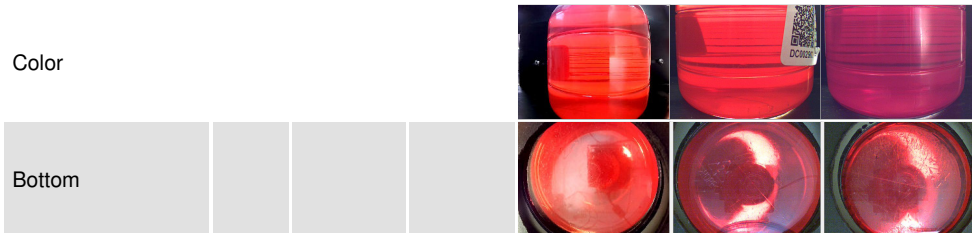




# FUEL REPORT

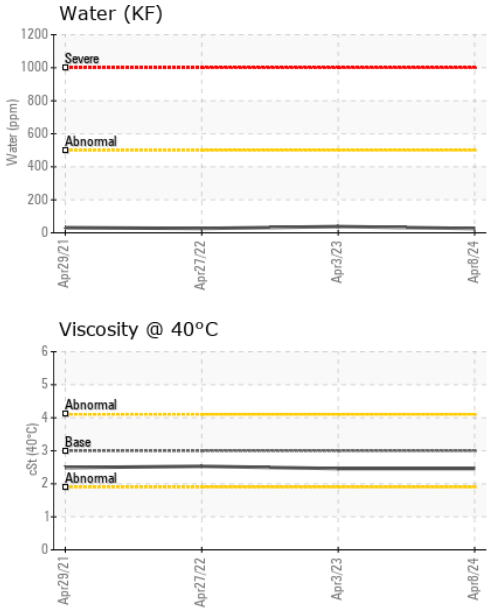

## GRAPHS

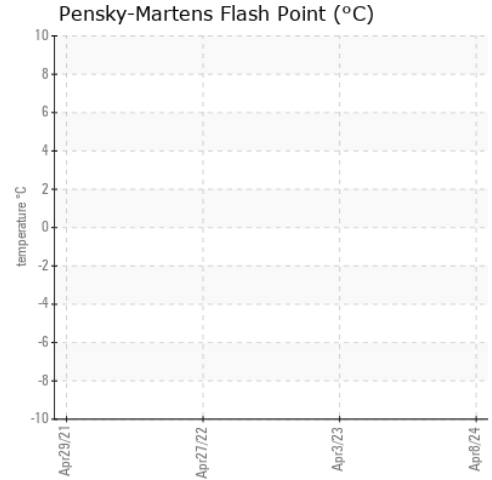

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : DC0035915  
**Lab Number** : 06152455  
**Unique Number** : 10982533  
**Test Package** : DF-5 ( Additional Tests: API, Cetane, Fuel, Screen )

**Received** : 17 Apr 2024  
**Tested** : 30 Apr 2024  
**Diagnosed** : 06 May 2024 - Doug Bogart

**KELLY GENERATOR & EQUIPMENT INC**  
 1955 DALE LN  
 OWINGS, MD  
 US 20736  
 Contact: LESLIE SNURR  
 LSNURR@KGE.COM  
 T: (410)257-5225  
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)