




COOLANT REPORT

Sample Rating Trend

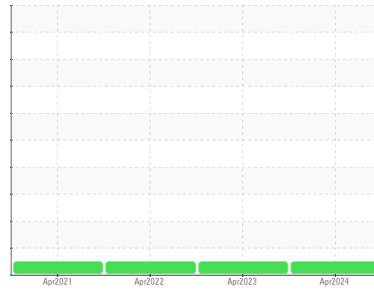

NORMAL



Area

[PMOAS3372439]

Machine Id

DIT 1 (S/N 0786787)

Component

Coolant

Fluid

HYBRID (HOAT) COOLANT (--- QTS)

DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.







SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		DC0035056	WC0026369	DC0021313
Sample Date	Client Info		12 Apr 2024	12 Apr 2023	28 Apr 2022
Machine Age	hrs	Client Info	2008	1971	1930
Oil Age	hrs	Client Info	0	0	0
Oil Changed		Client Info	N/A	Changed	Not Chngd
Sample Status			NORMAL	NORMAL	NORMAL

PHYSICAL TEST RESULTS








	method	limit/base	current	history1	history2
Glycol Type	FT-IR		---	---	---
Specific Gravity	*ASTM D1298		1.065	1.065	1.065
pH	Scale 0-14	ASTM D1287	8.13	8.17	8.25
Nitrites	ppm	AP-053:2009	1124	NT	936
Reserve Alkalinity	Scale 0-20	*ASTM D1121	---	---	---
Percentage Glycol	%	ASTM D3321	48.6	48.7	48.5
Freezing Point	°F	ASTM D3321	-31	-31	-31
Total Dissolved Solids			339.5	236.0	408.5
Carboxylate			n/a	fail	n/a

VISUAL

	method	limit/base	current	history1	history2
Coolant Color	*Visual		Yllow	Yllow	Yllow
Coolant Appearance	*Visual	Clear	normal	normal	normal
Color					
Bottom					



COOLANT REPORT

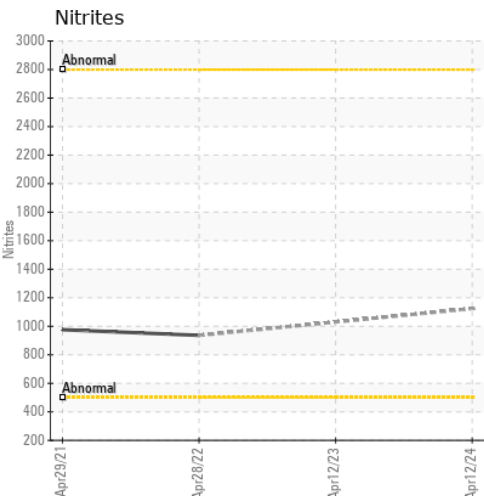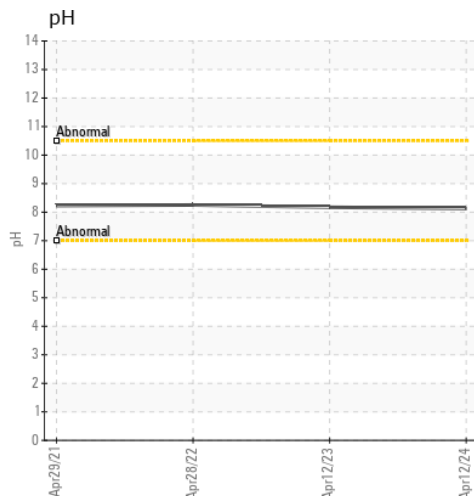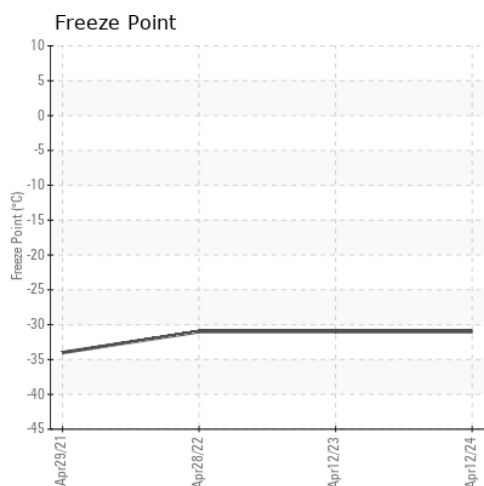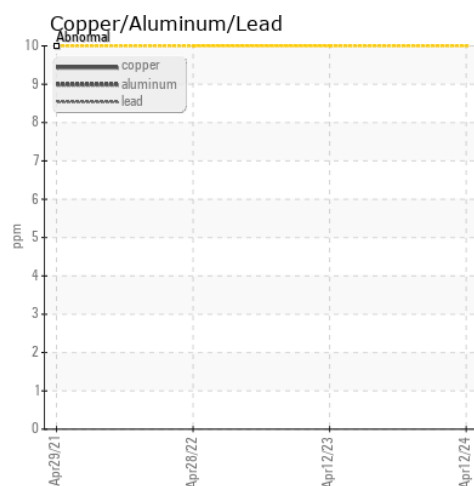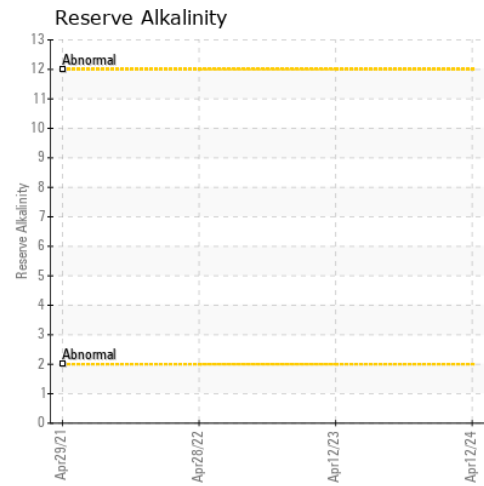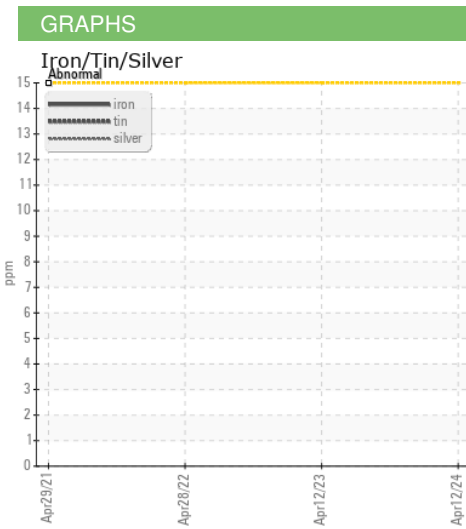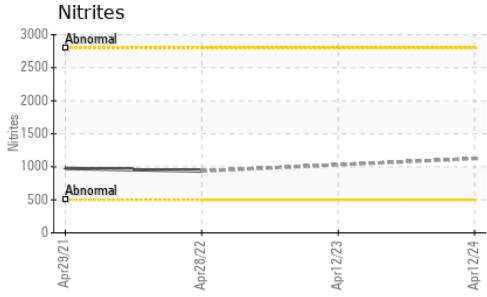

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0035056
Lab Number : 06152486
Unique Number : 10982564
Test Package : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)