


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

9720663 (S/N 1390) Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

וט	Δ		VI -		-
וטו	\sim	uі.	\sim	\sim	\cdot

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Apr2022	Apr7024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013749	KCP45451	
Sample Date		Client Info		11 Apr 2024	29 Apr 2022	
Machine Age	hrs	Client Info		27718	20256	
Oil Age	hrs	Client Info		0	3000	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	2	5	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	15	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	70	24	
Calcium	ppm	ASTM D5185m	0	3	0	
Phosphorus	ppm	ASTM D5185m	0	<1	0	
Zinc	ppm	ASTM D5185m	0	0	8	
Sulfur	ppm	ASTM D5185m	23500	22692	18325	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	3	
Sodium	ppm	ASTM D5185m		17	2	
Potassium	ppm	ASTM D5185m	>20	4	1	
Water	%	ASTM D6304	>0.05	0.019	0.010	
ppm Water	ppm	ASTM D6304	>500	192	103.2	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		748	3979	
Particles >6µm		ASTM D7647	>1300	164	938	
Particles >14μm		ASTM D7647	>80	12	70	
Particles >21µm		ASTM D7647	>20	3	22	
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/11	17/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A si al Niversala au (ANI)	VOLV-	ACTM DODAE	4.0	0.27	0.04	

Acid Number (AN)


mg KOH/g ASTM D8045 1.0

0.34

0.37



OIL ANALYSIS REPORT

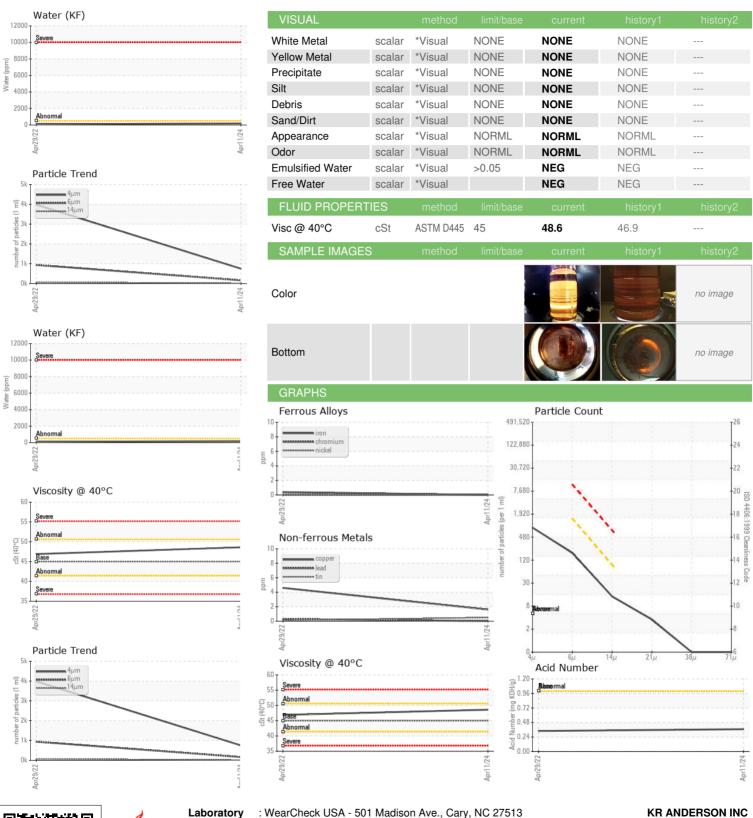





Certificate 12367

Laboratory Sample No.

: KCPA013749 Lab Number : 06152594 Unique Number : 10982672

Received : 17 Apr 2024 **Tested** Diagnosed

: 22 Apr 2024 : 22 Apr 2024 - Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

18300 SUTTER BLVD MORGAN HILL, CA US 95037

Contact: T. KEENAN tkeenan@krafab.com T:

F: