




OIL ANALYSIS REPORT

Sample Rating Trend

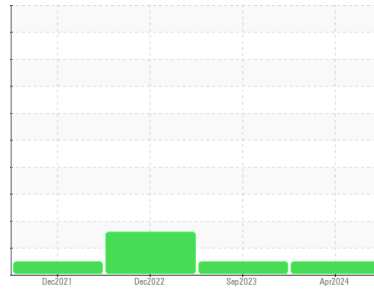

NORMAL



Machine Id
4603675 (S/N 1078)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) FG-460 (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA016155	KCPA003869	KCP52080
Sample Date	Client Info			08 Apr 2024	18 Sep 2023	12 Dec 2022
Machine Age	hrs	Client Info		34466	31251	26214
Oil Age	hrs	Client Info		3215	0	2000
Oil Changed	Client Info			Changed	N/A	Changed
Sample Status				NORMAL	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	4	2	7
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	1	<1	4
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	1	3	1
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Antimony	ppm	ASTM D5185m		---	---	---
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	<1
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		<1	1	2
Calcium	ppm	ASTM D5185m		2	<1	0
Phosphorus	ppm	ASTM D5185m	500	266	217	555
Zinc	ppm	ASTM D5185m		333	279	618
Sulfur	ppm	ASTM D5185m		2054	1778	2541

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		2	3	7
Potassium	ppm	ASTM D5185m	>20	2	1	1
Water	%	ASTM D6304	>0.05	0.005	0.001	0.011
ppm Water	ppm	ASTM D6304	>500	51	9.4	119.6

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3003	2598	9436
Particles >6µm		ASTM D7647	>1300	984	769	▲ 2462
Particles >14µm		ASTM D7647	>80	61	32	▲ 179
Particles >21µm		ASTM D7647	>20	10	5	▲ 53
Particles >38µm		ASTM D7647	>4	1	0	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>17/13	17/13	17/12	▲ 18/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.61	0.49	0.97


OIL ANALYSIS REPORT

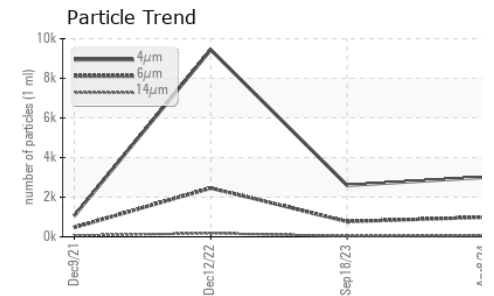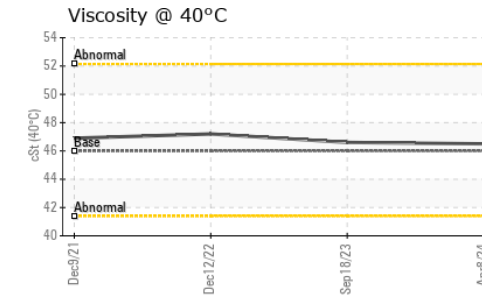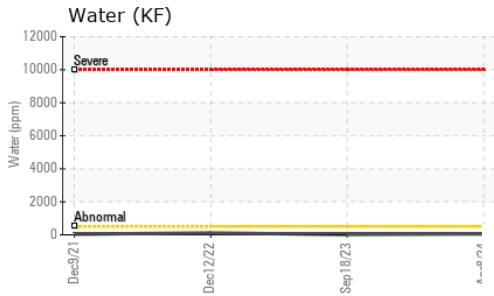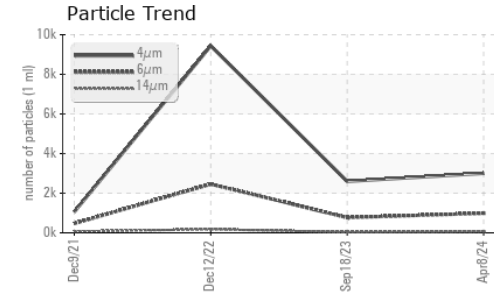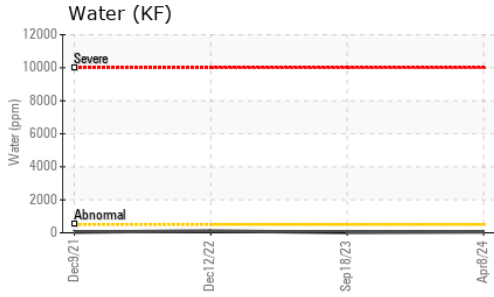






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	46.5	46.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

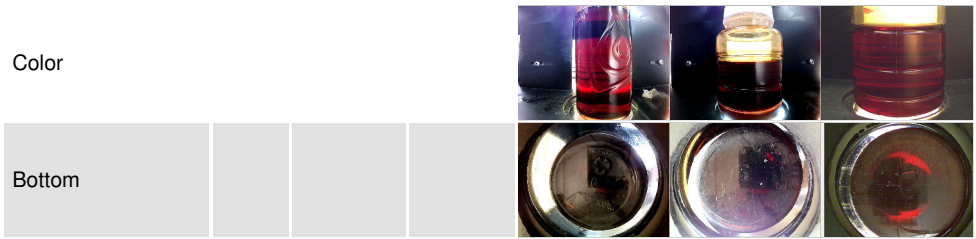

GRAPHS

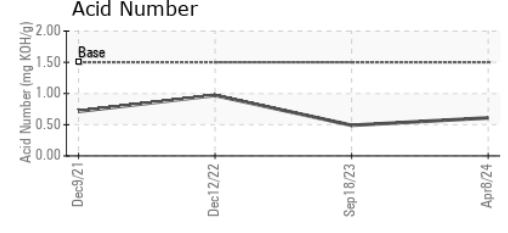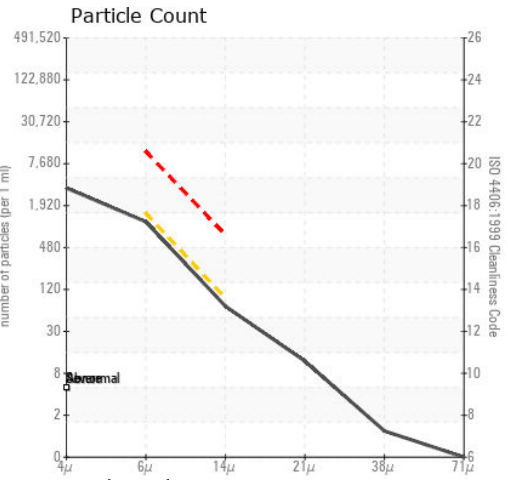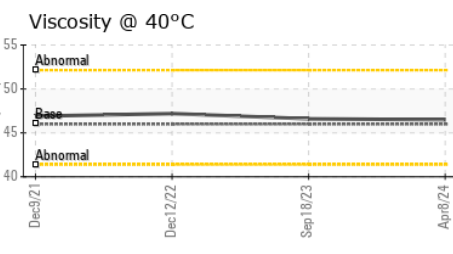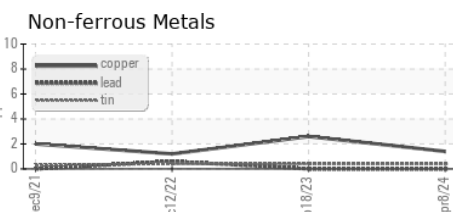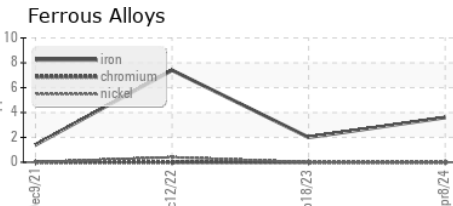

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016155 **Received** : 17 Apr 2024
Lab Number : 06152600 **Tested** : 22 Apr 2024
Unique Number : 10982678 **Diagnosed** : 22 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

SEMI FREDDIS BAKERS
 1980 N LOOP RD
 ALAMEDA, CA
 US 94502
 Contact: Z GONZALES
 ZGONZALES@SEMIFREDDIS.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)