

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER SFC 90 7732175 (S/N 3571)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- LTR)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Apr2023	Apr2024		
SAMPLE INFORM	//ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC125962	KC89923	
Sample Date		Client Info		01 Apr 2024	06 Apr 2023	
Machine Age	hrs	Client Info		0	14878	
Oil Age	hrs	Client Info		0	8468	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	6	6	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	1	3	
Calcium	ppm	ASTM D5185m	2	1	0	
Phosphorus	ppm	ASTM D5185m		<1	4	
Zinc	ppm	ASTM D5185m		0	3	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m		3	<1	
Potassium	ppm	ASTM D5185m	>20	2	<1	
Water	%	ASTM D6304	>0.05	0.004	0.006	
ppm Water	ppm	ASTM D6304	>500	47	66.6	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1371	180	
Particles >6µm		ASTM D7647	>1300	400	56	
Particles >14µm		ASTM D7647	>80	33	8	
Particles >21µm		ASTM D7647	>20	5	3	
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	15/13/10	
FLUID DEGRADA	ATION _	method	limit/base	current	history1	history2
A : 1 A 1 (A A 1)	1/011/	AOTH Doors	0.4		0.40	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.43

0.43



## **OIL ANALYSIS REPORT**

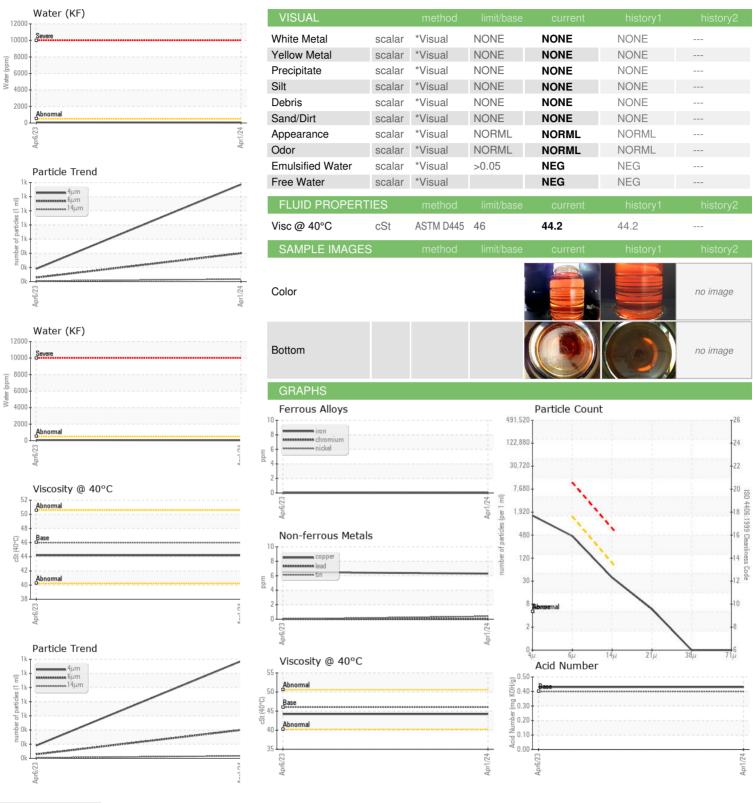





Laboratory Sample No.

Lab Number : 06152617 Unique Number : 10982695

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KC125962

Received : 17 Apr 2024 **Tested** : 22 Apr 2024 Diagnosed

: 22 Apr 2024 - Don Baldridge

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**WATCHTOWER - BILL MILLER** 

900 RED MILLS RD. WALLKILL, NY

US 12589 Contact: MNT SYSTEMS

mntsystemswkl.us@bethel.jw.org T:

Contact/Location: MNT SYSTEMS ? - WATWAL

F: