



OIL ANALYSIS REPORT

Sample Rating Trend



WEAR



Area
CAMERON [200004662]

Machine Id
C-23
Component
Wind Turbine Gearbox

Fluid
GEAR OIL ISO 320 (--- LTR)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear

The iron level is abnormal. All other component wear rates are normal.

● Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		NX06153126	---	---
Sample Date	Client Info		18 Mar 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS	method	limit/base	current	history1	history2
PQ	ASTM D8184	>50	15	---	---
Iron	ppm	ASTM D5185m	>30	▲ 40	---
Chromium	ppm	ASTM D5185m	>3	0	---
Nickel	ppm	ASTM D5185m	>3	0	---
Titanium	ppm	ASTM D5185m	>10	0	---
Silver	ppm	ASTM D5185m		0	---
Aluminum	ppm	ASTM D5185m	>30	0	---
Lead	ppm	ASTM D5185m	>15	2	---
Copper	ppm	ASTM D5185m	>10	<1	---
Tin	ppm	ASTM D5185m	>10	<1	---
Vanadium	ppm	ASTM D5185m		0	---
Cadmium	ppm	ASTM D5185m		0	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	<1	---
Barium	ppm	ASTM D5185m	15	0	---
Molybdenum	ppm	ASTM D5185m	15	0	---
Manganese	ppm	ASTM D5185m		<1	---
Magnesium	ppm	ASTM D5185m	50	2	---
Calcium	ppm	ASTM D5185m	50	5	---
Phosphorus	ppm	ASTM D5185m	350	185	---
Zinc	ppm	ASTM D5185m	100	56	---
Sulfur	ppm	ASTM D5185m	12500	5070	---






CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+15	0	---
Sodium	ppm	ASTM D5185m		14	---
Potassium	ppm	ASTM D5185m	>20	3	---
Water	%	ASTM D6304	>0.02	0.003	---
ppm Water	ppm	ASTM D6304	>200	39	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		1325	---	---
Particles >6µm	ASTM D7647	>320	● 410	---	---
Particles >14µm	ASTM D7647	>40	39	---	---
Particles >21µm	ASTM D7647	>10	9	---	---
Particles >38µm	ASTM D7647	>3	1	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>--/15/12	● 18/16/12	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	0.58	---



OIL ANALYSIS REPORT

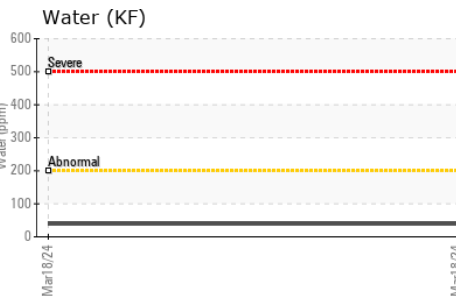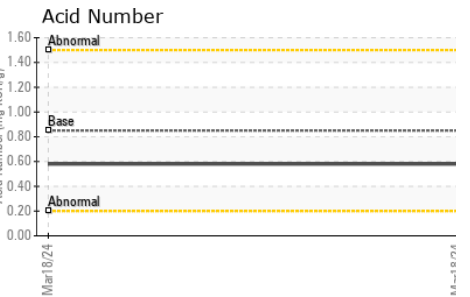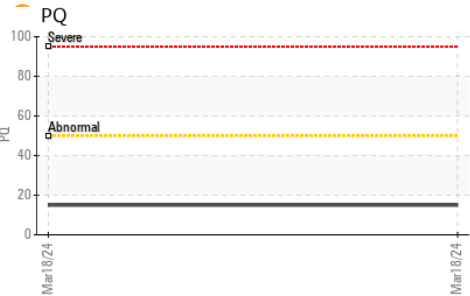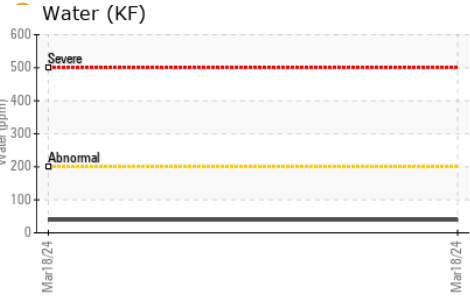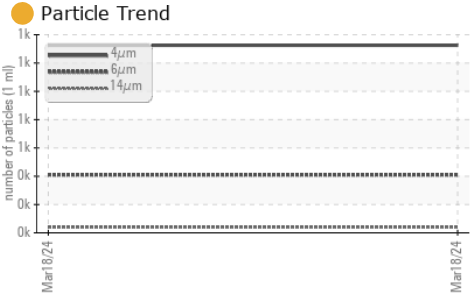






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.02	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	334	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

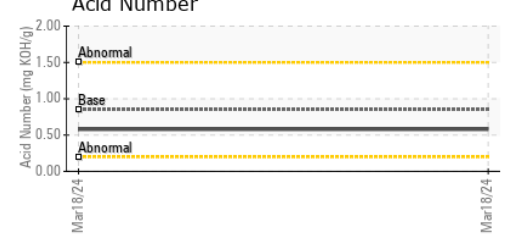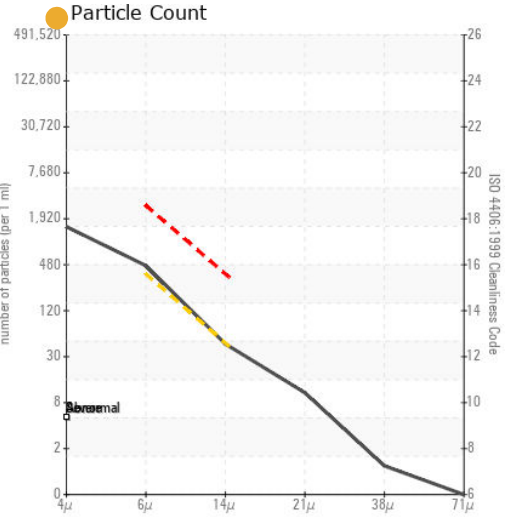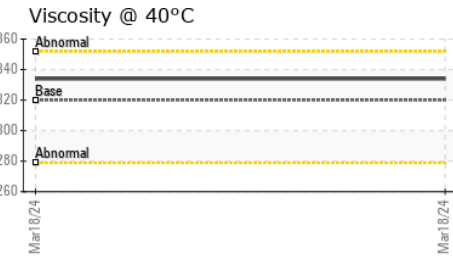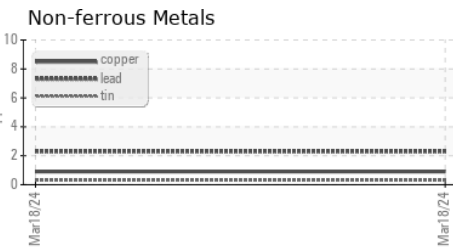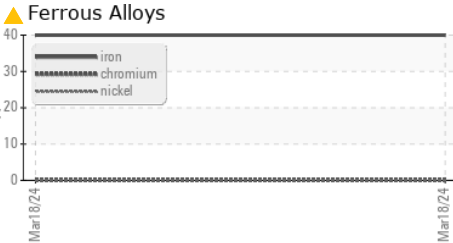

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX06153126 **Received** : 18 Apr 2024
Lab Number : 06153126 **Tested** : 19 Apr 2024
Unique Number : 10983204 **Diagnosed** : 22 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL 60606
 Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (312)386-4124
F: (312)386-7102