


OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id

KAESER 8626892

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGN	10 - 10
DIAGIN	

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Apr2023	Mar2024		
0.11.151.5.11.50.51	44-710-11					
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06153153	KC108248	
Sample Date		Client Info		25 Mar 2024	27 Apr 2023	
Machine Age	hrs	Client Info		11071	3933	
Oil Age	hrs	Client Info		0	3933	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	13	11	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	2	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	90	2	<1	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m	_	0	2	
Zinc	ppm	ASTM D5185m		0	5	
CONTAMINANTS			limit/base	current		history2
		method			history1	
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		3	0	
Potassium	ppm	ASTM D5185m	>20	2	<1	
Water	%	ASTM D6304	>0.05	0.004	0.003	
ppm Water	ppm	ASTM D6304	>500	45	26.4	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2073		
Particles >6µm		ASTM D7647	>1300	747		
Particles >14μm		ASTM D7647	>80	75		
Particles >21µm		ASTM D7647	>20	25		
Particles >38μm		ASTM D7647	>4	1		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/17/13		
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.31

0.34



OIL ANALYSIS REPORT

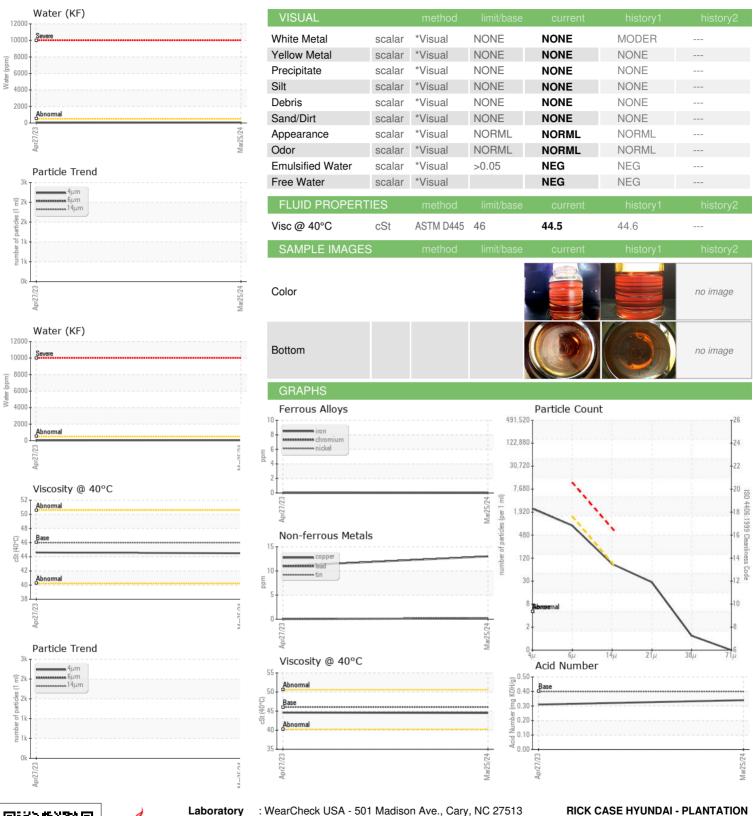





Certificate 12367

Laboratory Sample No. Lab Number : 06153153 Unique Number : 10983231

: KC06153153 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received **Tested** Diagnosed

: 18 Apr 2024 : 19 Apr 2024 : 22 Apr 2024 - Don Baldridge 925 N STATE RD 7 PLANTATION, FL US 33317

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: RICPLA [WUSCAR] 06153153 (Generated: 04/23/2024 15:46:28) Rev: 1

Contact/Location: Service Manager - RICPLA

T:

F: