

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER AS 30 8706137 (S/N 2050)

Component Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130660	KC101234	
Sample Date		Client Info		12 Apr 2024	23 May 2023	
Machine Age	hrs	Client Info		3948	2464	
Oil Age	hrs	Client Info		1100	2464	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	4	2	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	4	2	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	46	66	
Calcium	ppm	ASTM D5185m	2	2	0	
Phosphorus	ppm	ASTM D5185m		0	0	
Zinc	ppm	ASTM D5185m		0	0	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	2	
Sodium	ppm	ASTM D5185m		20	15	
Potassium	ppm	ASTM D5185m	>20	12	11	
Water	%	ASTM D6304	>0.05	0.016	0.023	
ppm Water	ppm	ASTM D6304	>500	161	235.2	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1979	13805	
Particles >6µm		ASTM D7647	>1300	441	4578	
Particles >14µm		ASTM D7647	>80	32	A 337	
Particles >21µm		ASTM D7647	>20	12	A 86	
Particles >38µm		ASTM D7647	>4	1	2	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	1 /19/16	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.38	



OIL ANALYSIS REPORT

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

cSt

*Visual

*Visual

*Visual

*Visual

*Visual

*Visual

*Visual

*Visual

ASTM D445

scalar *Visual

scalar *Visual

NONE

NONE


NONE

NONE

NONE

NONE

NORML

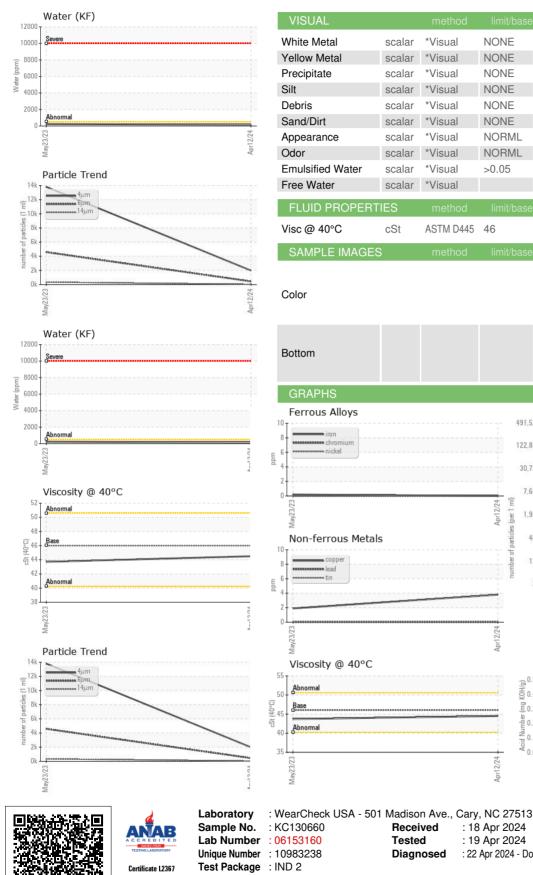

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received

Diagnosed

Tested

Report Id: YANFOU [WUSCAR] 06153160 (Generated: 04/22/2024 21:37:39) Rev: 1

Contact/Location: Service Manager - YANFOU Page 2 of 2

Apri
YANFENG
101 INTERNATIONAL BLVD
FOUNTAIN INN, SC
US 29644
Contact: Service Manager

28

Т: F:

2/24

4406

:1999 Cle

14



NONE

NONE

NONE

NONE

LIGHT

NONE

NORML

NONE

NONE


NONE

NONE

NONE

NONE

NORML

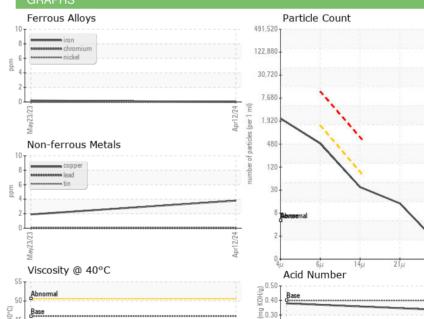

ੂੰ 0.20

0.10 Acid

0.00

Apr12/24 -

: 18 Apr 2024

: 19 Apr 2024

: 22 Apr 2024 - Don Baldridge