

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER AS 30 8670318 (S/N 2034)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			May2023	Apr2024		
SAMPLE INFORM	MATION	method				history2
Sample Number		Client Info		KC130645	KC101237	
Sample Date		Client Info		12 Apr 2024	23 May 2023	
Machine Age	hrs	Client Info		2620	1091	
Oil Age	hrs	Client Info		1100	1091	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	3	1	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	13	26	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	51	80	
Calcium	ppm	ASTM D5185m	2	2	0	
Phosphorus	ppm	ASTM D5185m		0	0	
Zinc	ppm	ASTM D5185m		0	0	
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		21	16	
Potassium	ppm	ASTM D5185m	>20	10	6	
Water	%	ASTM D6304	>0.05	0.017	0.027	
ppm Water	ppm	ASTM D6304	>500	179	279.0	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1428	3989	
Particles >6µm		ASTM D7647	>1300	343	1655	
Particles >14µm		ASTM D7647	>80	21	72	
Particles >21µm		ASTM D7647	>20	5	14	
Particles >38µm		ASTM D7647	>4	0	2	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	19/18/13	
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
A -! -! All wards - w (AAI)	1/011/	4.OTM D00.45	0.4		0.00	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.36

0.30



OIL ANALYSIS REPORT

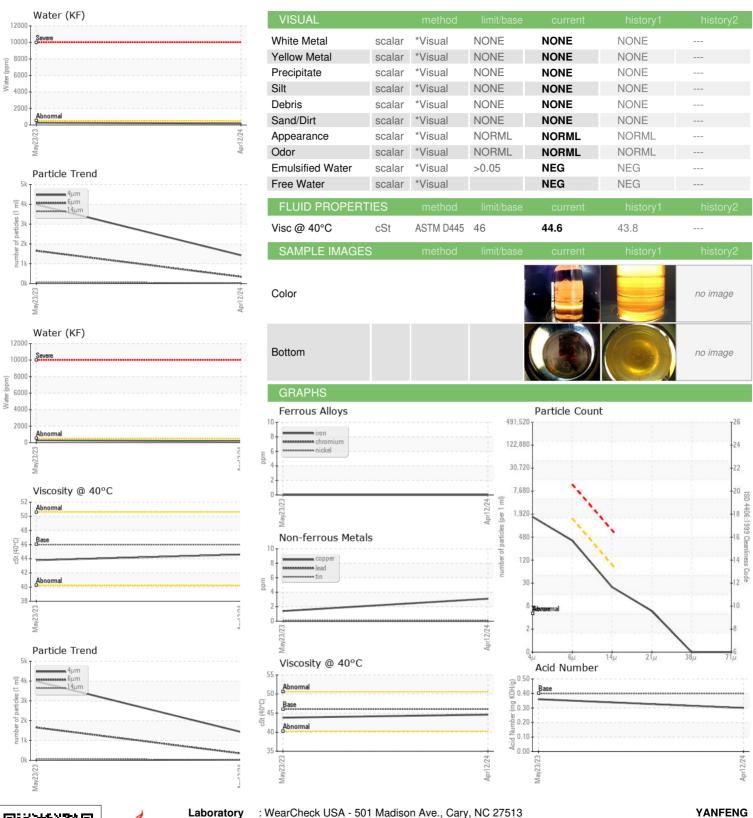



Certificate 12367

Sample No.

: KC130645 Lab Number : 06153161 Unique Number : 10983239

Test Package : IND 2

Received : 18 Apr 2024 **Tested** : 19 Apr 2024

Diagnosed : 22 Apr 2024 - Don Baldridge 101 INTERNATIONAL BLVD FOUNTAIN INN, SC US 29644

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) T:

F: