




# OIL ANALYSIS REPORT

Sample Rating Trend

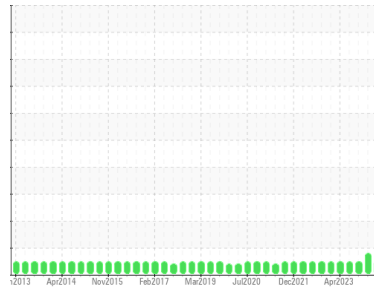

**NORMAL**



Machine Id  
**1FRK (S/N 59219)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI 1009-68 SC (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>USP0006433</b>	USP0005610	USP0002762	
Sample Date	Client Info	<b>15 Apr 2024</b>	18 Jan 2024	23 Oct 2023	
Machine Age	hrs	Client Info	<b>87963</b>	86721	85512
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A	
Sample Status		<b>NORMAL</b>	ABNORMAL	NORMAL	

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >8	<b>2</b>	6	7
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	<1
Sulfur	ppm	ASTM D5185m 50	<b>5</b>	7	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	1	<1
Potassium	ppm	ASTM D5185m >20	<b>2</b>	0	0
Water	%	ASTM D6304 >0.01	<b>0.003</b>	0.004	0.006
ppm Water	ppm	ASTM D6304 >100	<b>36</b>	42	66.9

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>1573</b>	51310	5011
Particles >6µm	ASTM D7647 >2500	<b>608</b>	▲ 5815	1163
Particles >14µm	ASTM D7647 >320	<b>22</b>	70	23
Particles >21µm	ASTM D7647 >80	<b>3</b>	15	4
Particles >38µm	ASTM D7647 >20	<b>0</b>	1	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/18/15	<b>18/16/12</b>	▲ 23/20/13	20/17/12

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.028</b>	0.014	0.015




# OIL ANALYSIS REPORT

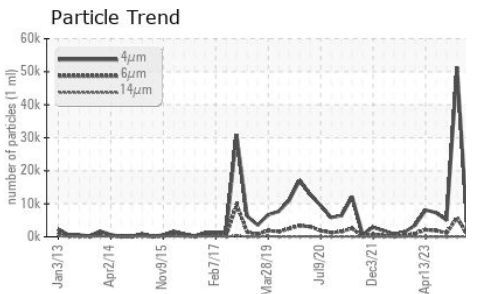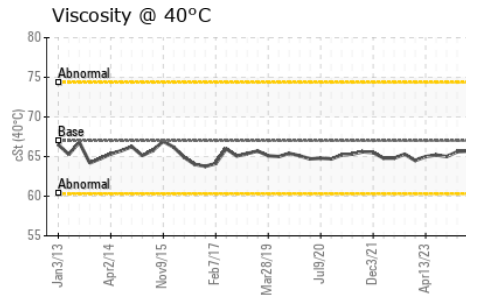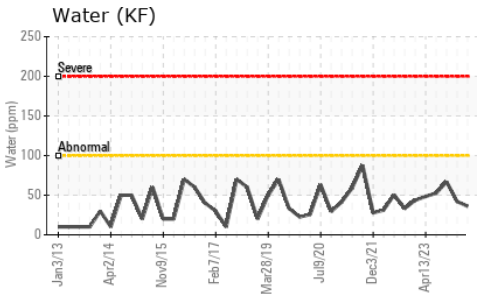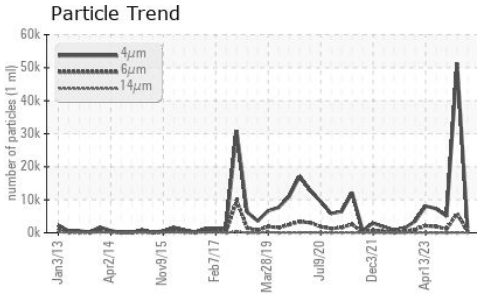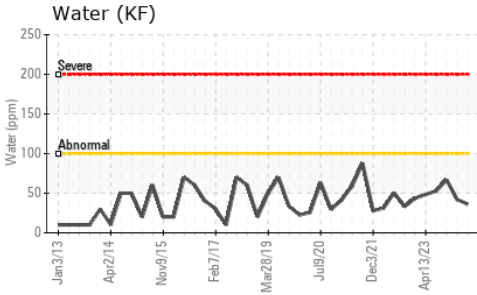






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	65.7	65.6	65.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

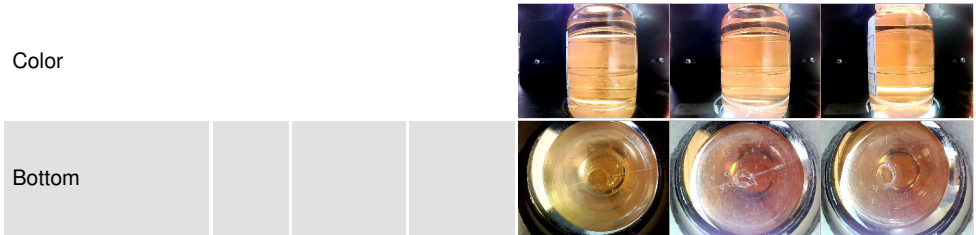

## GRAPHS

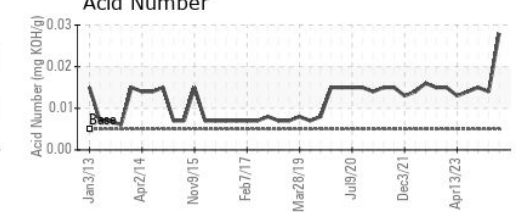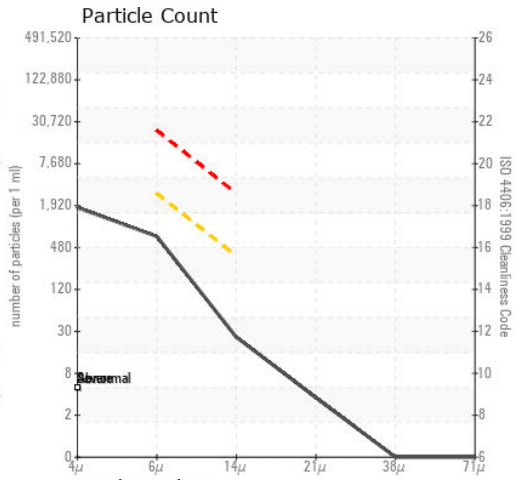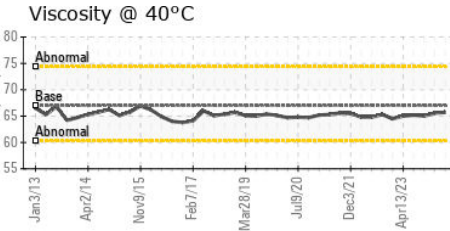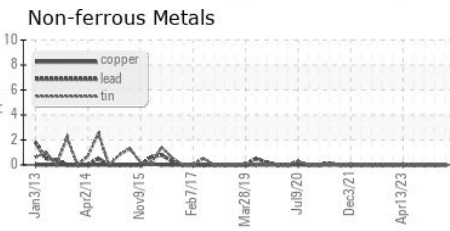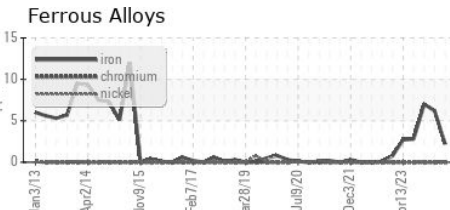

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USP0006433  
 Lab Number : 06153197  
 Unique Number : 10983275  
 Test Package : IND 2

Received : 18 Apr 2024  
 Tested : 19 Apr 2024  
 Diagnosed : 19 Apr 2024 - Doug Bogart

TYSON - DAKOTA CITY SLAUGHTER

DAKOTA CITY, NE

US

Contact:

doug.bogart@wearcheck.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)