




OIL ANALYSIS REPORT

Machine Id
HBKM02BE
 Component
Biogas Engine
 Fluid
SHELL MYSELLA S5 S (48 GAL)

Sample Rating Trend

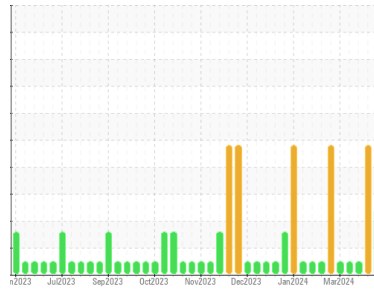

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. (Customer Sample Comment: Top Up Amount: 30 GAL)

Wear

The tin level is abnormal.

Contamination

Elemental level of silicon (Si) above normal.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0775176	WC0775174	WC0775501
Sample Date	Client Info		16 Apr 2024	11 Apr 2024	02 Apr 2024
Machine Age	hrs	Client Info	106040	105961	105749
Oil Age	hrs	Client Info	746	667	455
Oil Changed	Client Info		Oil Added	Oil Added	Oil Added
Sample Status			ABNORMAL	SEVERE	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >14	8	6	4
Chromium	ppm	ASTM D5185m >3	<1	<1	0
Nickel	ppm	ASTM D5185m	<1	<1	0
Titanium	ppm	ASTM D5185m	0	0	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >5	4	4	4
Lead	ppm	ASTM D5185m >8	0	0	0
Copper	ppm	ASTM D5185m >5	2	2	2
Tin	ppm	ASTM D5185m >3	▲ 4	3	3
Vanadium	ppm	ASTM D5185m	0	<1	<1
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	5	7
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	12	5	4
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	35	16	16
Calcium	ppm	ASTM D5185m	1858	1665	1609
Phosphorus	ppm	ASTM D5185m 300	377	325	310
Zinc	ppm	ASTM D5185m	474	401	428
Sulfur	ppm	ASTM D5185m	3928	3265	3455

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	▲ 199	▲ 200	158
Sodium	ppm	ASTM D5185m >20	2	2	1
Potassium	ppm	ASTM D5185m >20	2	0	0

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	5.4	5.3	4.9
Sulfation	Abs/.1mm	*ASTM D7415	23.1	22.8	21.5


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	16.6	16.4	14.8
Acid Number (AN)	mg KOH/g	ASTM D8045	1.27	1.46	1.10
Base Number (BN)	mg KOH/g	ASTM D2896 5.3	2.56	2.97	2.94




OIL ANALYSIS REPORT


Non-ferrous Metals

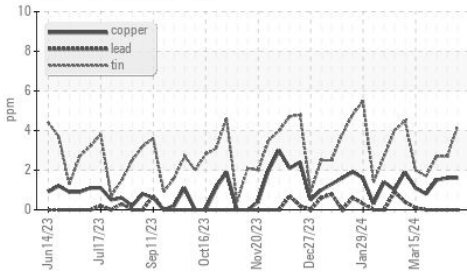


FT-IR (Direct Trend)

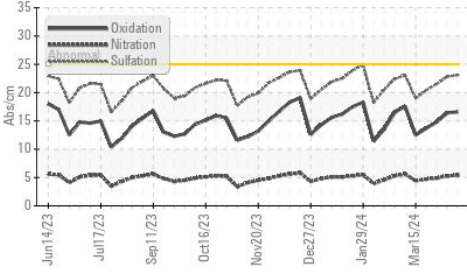


Acid Number

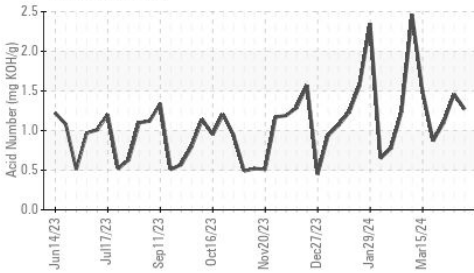

Acid Number

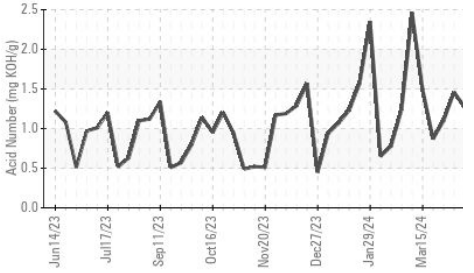









Base Number

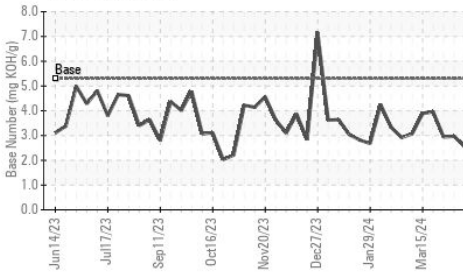

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.5	13.6	13.5

GRAPHS

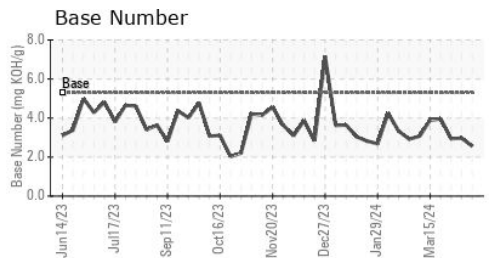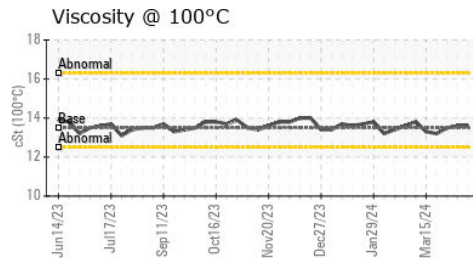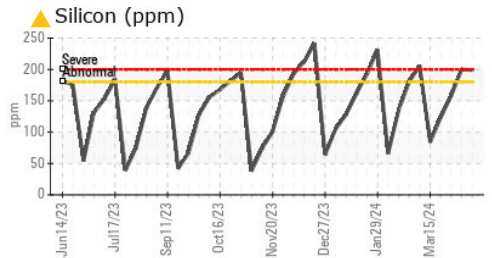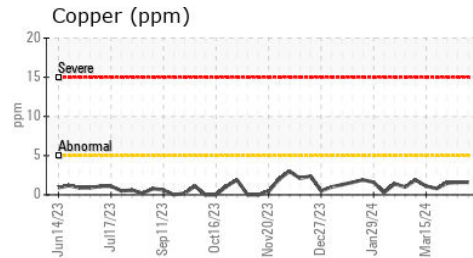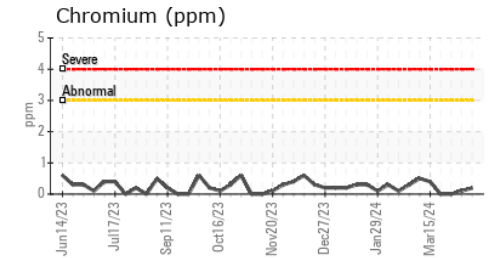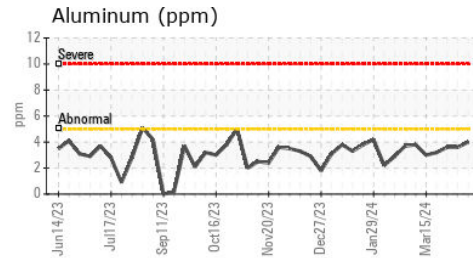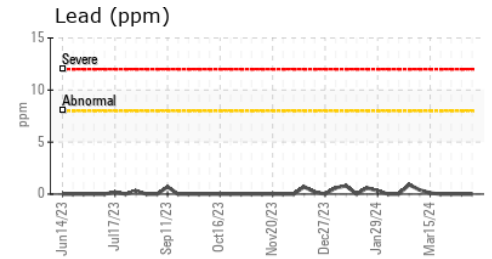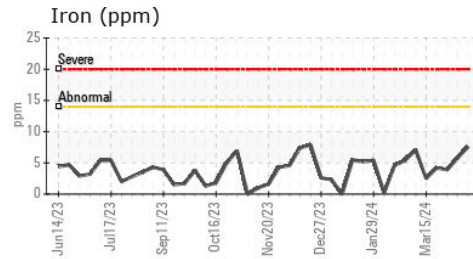

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0775176

Lab Number : 06153272

Unique Number : 10983350

Test Package : MOB 2

Received : 18 Apr 2024

Tested : 19 Apr 2024

Diagnosed : 22 Apr 2024 - Sean Felton

EDL NA Recips-Honeybrook

Honey Brook Powerstation, 481 S. Churchtown Road

Narvon, PA

US 17555-9574

Contact: Christian Adames

Christian.Adames@edlenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)