




# OIL ANALYSIS REPORT

Sample Rating Trend

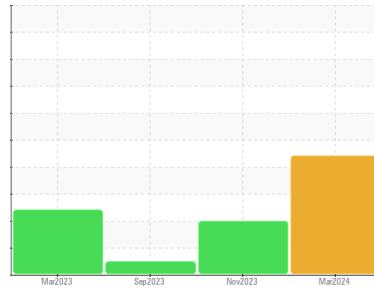

FUEL



Area  
**GUAY SON [CONHER]**  
 Machine Id  
**PERKINS Cozar I Aux-1 IBACO**  
 Component  
**Diesel Engine**  
 Fluid  
**RALOY 15W40 (8 LTR)**

## DIAGNOSIS

### ▲ Recommendation

We advise that you check the fuel injection system. We recommend that you drain the oil and perform a filter service on this component if not already done. We recommend an early resample to monitor this condition. ( Customer Sample Comment: Fluid: Raloy 15W40 )

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a moderate amount of particulates present in the oil. There is a high amount of fuel present in the oil.

### ▲ Fluid Condition

Fuel is present in the oil and is lowering the viscosity. The oil is no longer serviceable due to the presence of contaminants.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KL0014191</b>	KL0013370	KL0012790
Sample Date	Client Info		<b>20 Mar 2024</b>	06 Nov 2023	15 Sep 2023
Machine Age	hrs	Client Info	<b>0</b>	0	7822
Oil Age	hrs	Client Info	<b>0</b>	200	60
Oil Changed	Client Info		<b>N/A</b>	Changed	Not Chngd
Sample Status			<b>SEVERE</b>	ATTENTION	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>250	<b>75</b>	24	17
Chromium	ppm	ASTM D5185m	>10	<b>3</b>	2	1
Nickel	ppm	ASTM D5185m	>5	<b>1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>35	<b>7</b>	4	<1
Lead	ppm	ASTM D5185m	>100	<b>2</b>	<1	3
Copper	ppm	ASTM D5185m	>60	<b>2</b>	2	5
Tin	ppm	ASTM D5185m	>5	<b>1</b>	1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0	212
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>5</b>	<1	68
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	1
Magnesium	ppm	ASTM D5185m		<b>6</b>	0	306
Calcium	ppm	ASTM D5185m		<b>2855</b>	2731	2074
Phosphorus	ppm	ASTM D5185m		<b>1034</b>	1159	952
Zinc	ppm	ASTM D5185m		<b>1242</b>	1408	1146
Sulfur	ppm	ASTM D5185m		<b>3878</b>	3490	4233

## CONTAMINANTS






	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>35	<b>15</b>	21	21
Sodium	ppm	ASTM D5185m		<b>5</b>	2	1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	4	3
Fuel	%	ASTM D3524	>5	<b>▲ 10.4</b>	<1.0	<1.0

## INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	>3	<b>1.8</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>13.3</b>	6.7	6.9
Sulfation	Abs./1mm	*ASTM D7415	>30	<b>23.4</b>	15.3	20.7



# OIL ANALYSIS REPORT

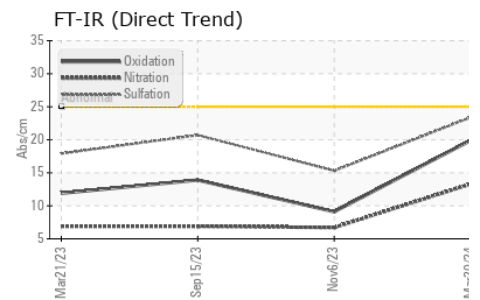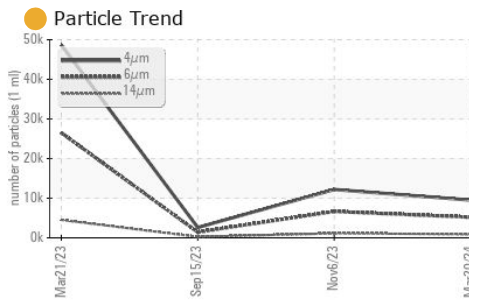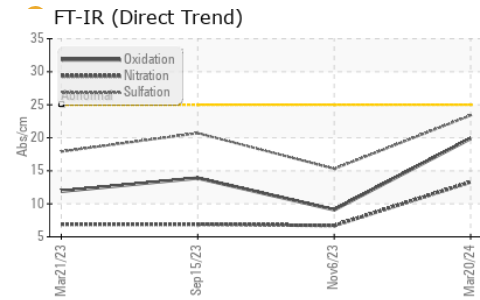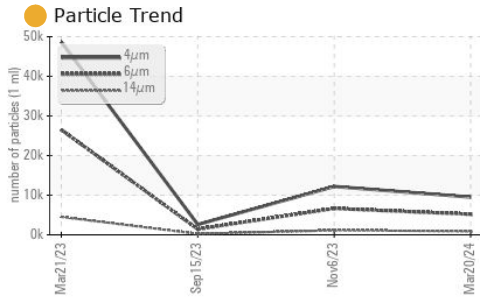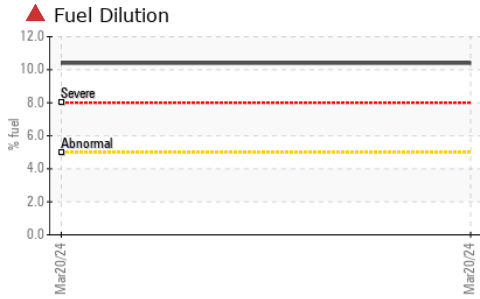





FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>9517</b>	12197	2601
Particles >6µm	ASTM D7647	>5000	<b>5185</b>	6644	1417
Particles >14µm	ASTM D7647	>640	<b>882</b>	1131	241
Particles >21µm	ASTM D7647	>160	<b>297</b>	381	81
Particles >38µm	ASTM D7647	>40	<b>46</b>	59	13
Particles >71µm	ASTM D7647	>10	<b>5</b>	6	1
Oil Cleanliness	ISO 4406 (c)	>19/16	<b>20/17</b>	20/17	18/15

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414	>25	<b>19.9</b>	9.1	13.9
Base Number (BN)	mg KOH/g ASTM D2896		<b>8.81</b>	10.97	8.73

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar *Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar *Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar *Visual	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar *Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt ASTM D445		<b>12.1</b>	12.7	12.6

## GRAPHS

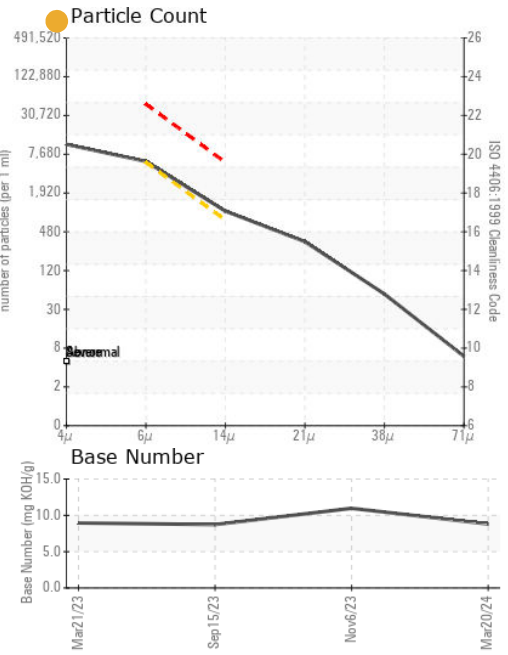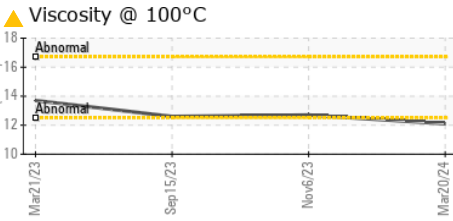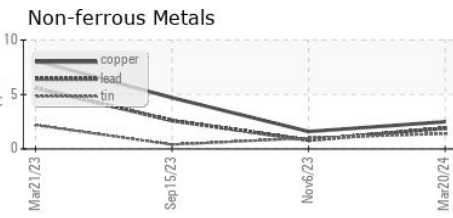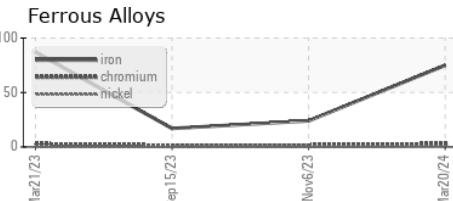

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KL0014191 **Received** : 18 Apr 2024  
**Lab Number** : **06153294** **Tested** : 23 Apr 2024  
**Unique Number** : 10983372 **Diagnosed** : 23 Apr 2024 - Don Baldrige  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**CONOR**  
 JUAREZ 348  
 HERMOSILLO,  
 MX 83140

Contact: EDUARDO GARCIA  
 egarcia.comsa@gmail.com

T: (526)622-1581 x:81

F: x: