




OIL ANALYSIS REPORT

Sample Rating Trend

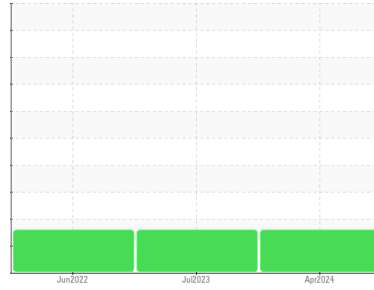

ISO



Machine Id

KAESER 5599864

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA017063	KCPA004487	KCP40484
Sample Date	Client Info			05 Apr 2024	25 Jul 2023	08 Jun 2022
Machine Age	hrs	Client Info		29689	24282	16434
Oil Age	hrs	Client Info		5407	0	0
Oil Changed	Client Info			Not Chngd	N/A	Changed
Sample Status				ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	<1	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	<1
Lead	ppm	ASTM D5185m	>10	1	<1	0
Copper	ppm	ASTM D5185m	>50	7	10	2
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	4	<1	0
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	92	29	0
Calcium	ppm	ASTM D5185m	0	5	0	0
Phosphorus	ppm	ASTM D5185m	0	15	27	352
Zinc	ppm	ASTM D5185m	0	19	22	1
Sulfur	ppm	ASTM D5185m	23500	30943	23856	378

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	1	<1
Sodium	ppm	ASTM D5185m		31	7	<1
Potassium	ppm	ASTM D5185m	>20	5	1	0
Water	%	ASTM D6304	>0.05	0.013	0.018	0.003
ppm Water	ppm	ASTM D6304	>500	137	181.8	38.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8163	5457	4901
Particles >6µm		ASTM D7647	>1300	2243	1411	1349
Particles >14µm		ASTM D7647	>80	227	87	91
Particles >21µm		ASTM D7647	>20	64	17	22
Particles >38µm		ASTM D7647	>4	0	0	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	20/18/15	20/18/14	19/18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.37	0.067

OIL ANALYSIS REPORT

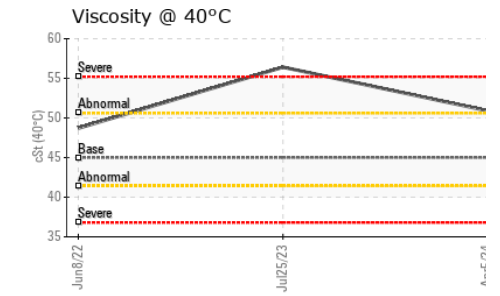
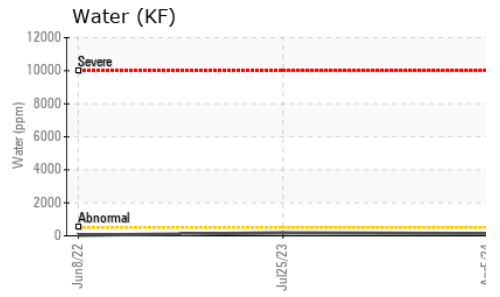
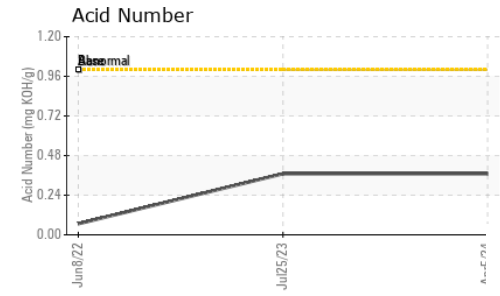
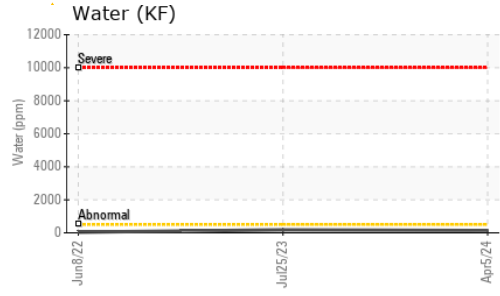
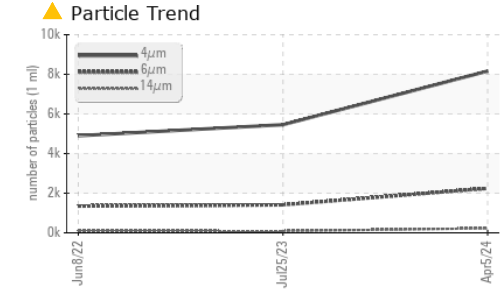


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	50.9	▲ 56.41	48.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

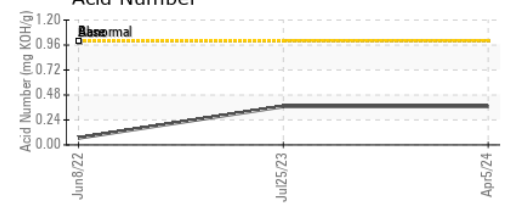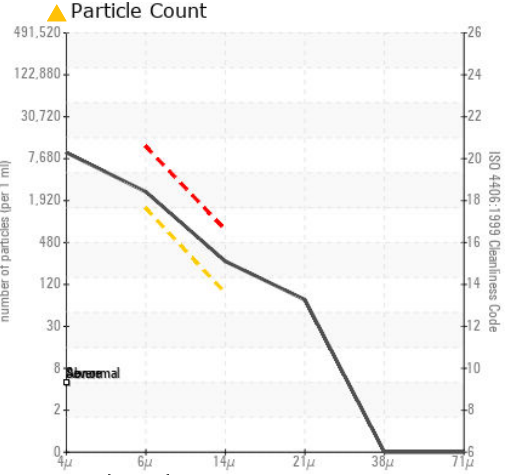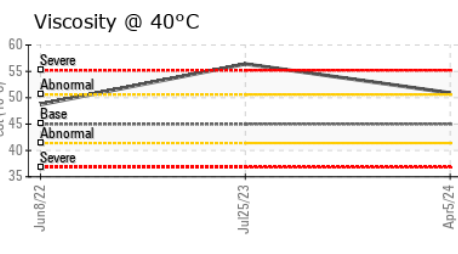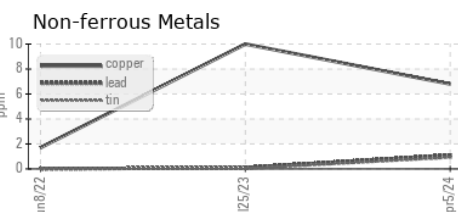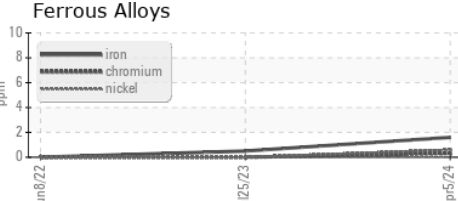

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA017063 **Received** : 18 Apr 2024
Lab Number : 06153776 **Tested** : 20 Apr 2024
Unique Number : 10989199 **Diagnosed** : 23 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

PEYTON'S MID-SOUTH
 120 KIRBY RD
 PORTLAND, TN
 US 37148
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)