

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER CSD 100S 8982464 (S/N 1224)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Apr2024		
CAMPLE INFORM	AATIONI		11		la facta a second	h'-t 0
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017160		
Sample Date		Client Info		10 Apr 2024		
Machine Age	hrs	Client Info		4537		
Oil Age	hrs	Client Info		4537		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	3		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	6		
Lead	ppm	ASTM D5185m	>10	1		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	2		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	2		
Calcium	ppm	ASTM D5185m	2	4		
Phosphorus	ppm	ASTM D5185m		57		
Zinc	ppm	ASTM D5185m		25		
Sulfur	ppm	ASTM D5185m		554		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m	<i>&gt;</i> 20	1		
Potassium	ppm	ASTM D5185m	>20	4		
Water	%	ASTM D5103111	>0.05	0.001		
ppm Water	ppm	ASTM D6304	>50.03	2		
FLUID CLEANLIN	ESS _	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1302		
Particles >6µm		ASTM D7647	>1300	215		
Particles >14µm		ASTM D7647	>80	23		
Particles >21µm		ASTM D7647		7		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/15/12		
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.45		
(, ", ",	g	00 10				



## **OIL ANALYSIS REPORT**

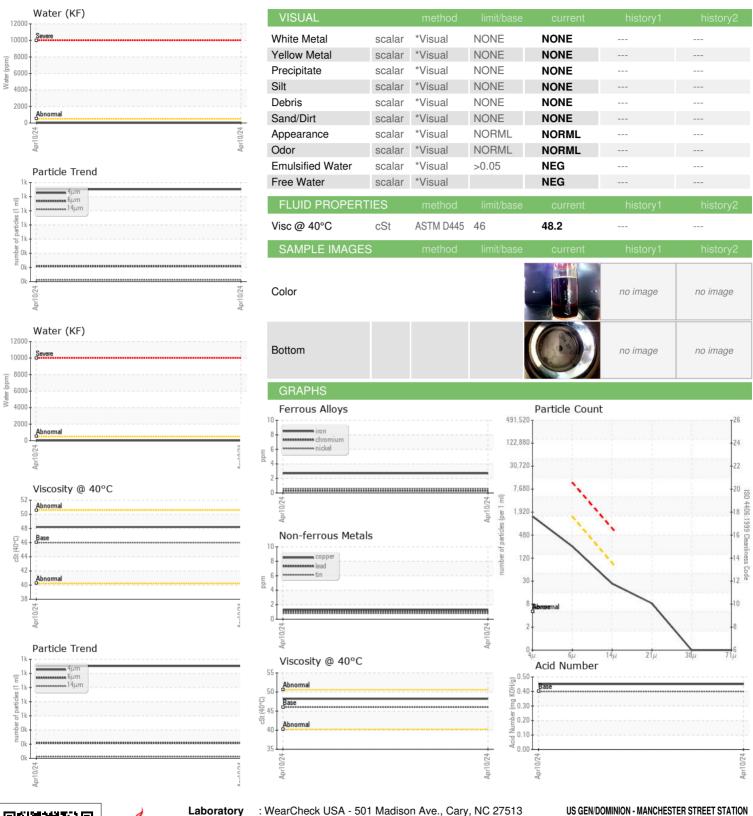





Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA017160 : 06153779 Unique Number : 10989202

Received **Tested** Diagnosed

: 18 Apr 2024 : 20 Apr 2024 Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 23 Apr 2024 - Don Baldridge

40 POINT ST. PROVIDENCE, RI US 02903 Contact: D. REBELLO drebello@manchestersps.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: