




OIL ANALYSIS REPORT

Sample Rating Trend

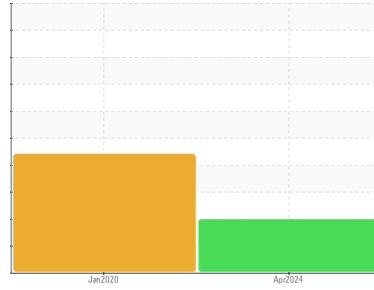

ISO



Machine Id
KAESER ASD 40 6701423 (S/N 1068)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA016810	KC86890	---
Sample Date	Client Info			01 Apr 2024	27 Jan 2020	---
Machine Age	hrs	Client Info		7090	1616	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	2	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m	>3	<1	<1	---
Titanium	ppm	ASTM D5185m	>3	<1	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	2	1	---
Lead	ppm	ASTM D5185m	>10	<1	<1	---
Copper	ppm	ASTM D5185m	>50	11	8	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		<1	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	---
Barium	ppm	ASTM D5185m	90	2	0	---
Molybdenum	ppm	ASTM D5185m		<1	0	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m	90	8	33	---
Calcium	ppm	ASTM D5185m	2	4	0	---
Phosphorus	ppm	ASTM D5185m		4	3	---
Zinc	ppm	ASTM D5185m		44	75	---
Sulfur	ppm	ASTM D5185m		20224	16876	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	---
Sodium	ppm	ASTM D5185m		5	9	---
Potassium	ppm	ASTM D5185m	>20	5	16	---
Water	%	ASTM D6304	>0.05	0.010	▲ 0.247	---
ppm Water	ppm	ASTM D6304	>500	109	▲ 2470	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		19397	35796	---
Particles >6µm		ASTM D7647	>1300	▲ 4758	▲ 19499	---
Particles >14µm		ASTM D7647	>80	▲ 502	▲ 3322	---
Particles >21µm		ASTM D7647	>20	▲ 183	▲ 1121	---
Particles >38µm		ASTM D7647	>4	▲ 9	▲ 173	---
Particles >71µm		ASTM D7647	>3	0	▲ 17	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/19/16	▲ 21/19	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.36	0.342	---


OIL ANALYSIS REPORT

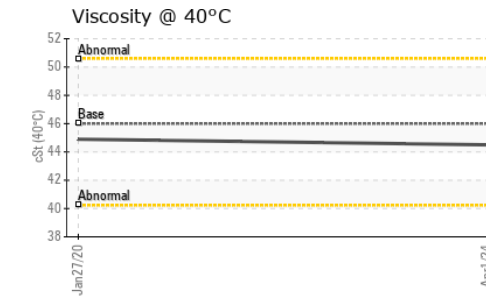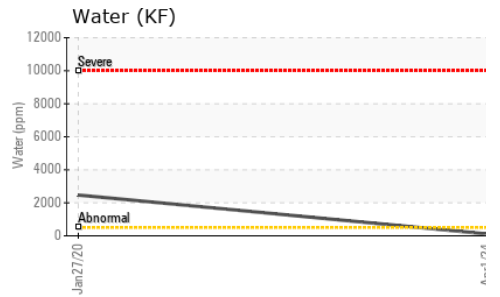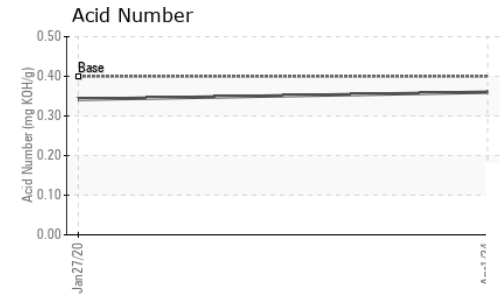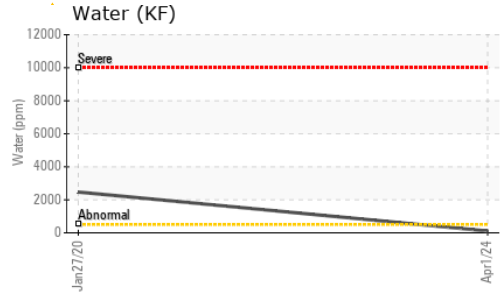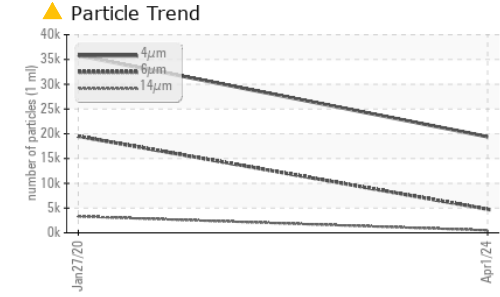





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	HAZY	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.5	44.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

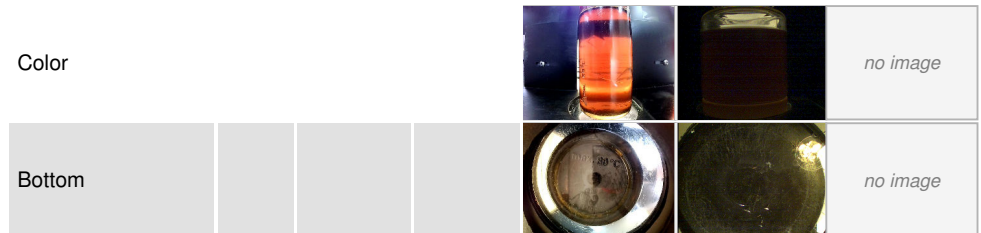

GRAPHS

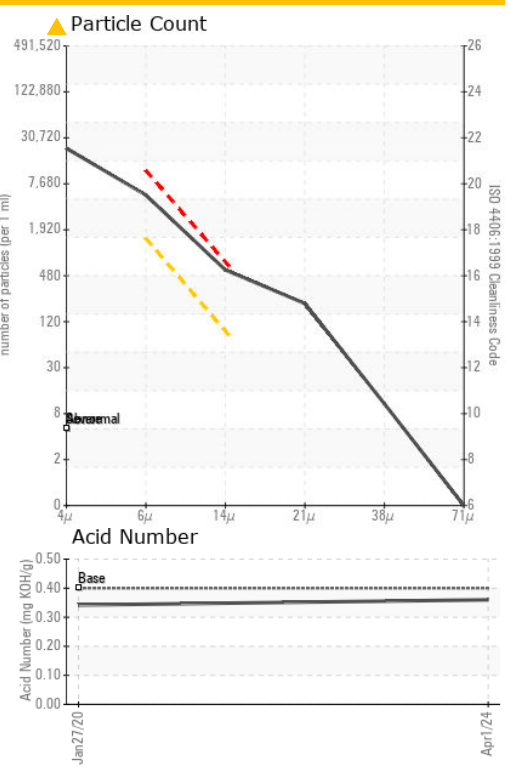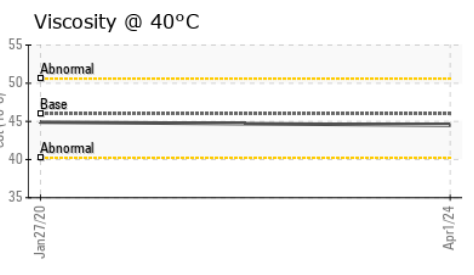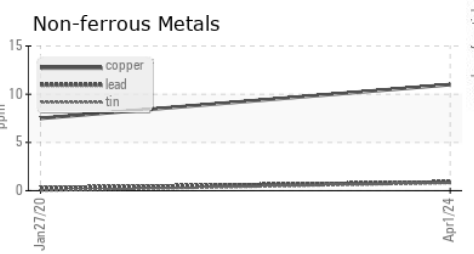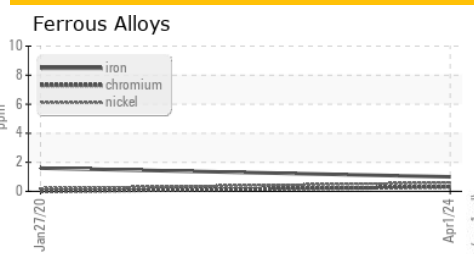

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016810 **Received** : 18 Apr 2024
Lab Number : 06153783 **Tested** : 19 Apr 2024
Unique Number : 10989206 **Diagnosed** : 23 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MGC MILLWORK INC
 6800 SANDS POINT DR
 HOUSTON, TX
 US 77074
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)