

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER SM 7.5T 3290528 (S/N 1054)

Compressor

KAESER SIGMA (OEM) FG-460 (--- QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

						Y
	Jan2024					
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
	1017 (111014		mmoasc		Thotory I	
Sample Number		Client Info		KCPA015875		
Sample Date		Client Info		26 Jan 2024		
Machine Age	hrs	Client Info		2956		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	3		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		1		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		1		
Magnesium	ppm	ASTM D5185m		47		
Calcium	ppm	ASTM D5185m		4		
Phosphorus	ppm	ASTM D5185m	500	3		
Zinc	ppm	ASTM D5185m		30		
Sulfur	ppm	ASTM D5185m		21485		
CONTAMINANTS	S	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		11		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.018		
ppm Water	ppm	ASTM D6304	>500	182		
FLUID CLEANLII	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3221		
Particles >6µm		ASTM D7647	>1300	803		
Particles >14µm		ASTM D7647	>80	74		
Particles >21µm		ASTM D7647	>20	25		
Particles >38µm		ASTM D7647	>4	3		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRAD	ATION _	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 1.5

0.34



OIL ANALYSIS REPORT

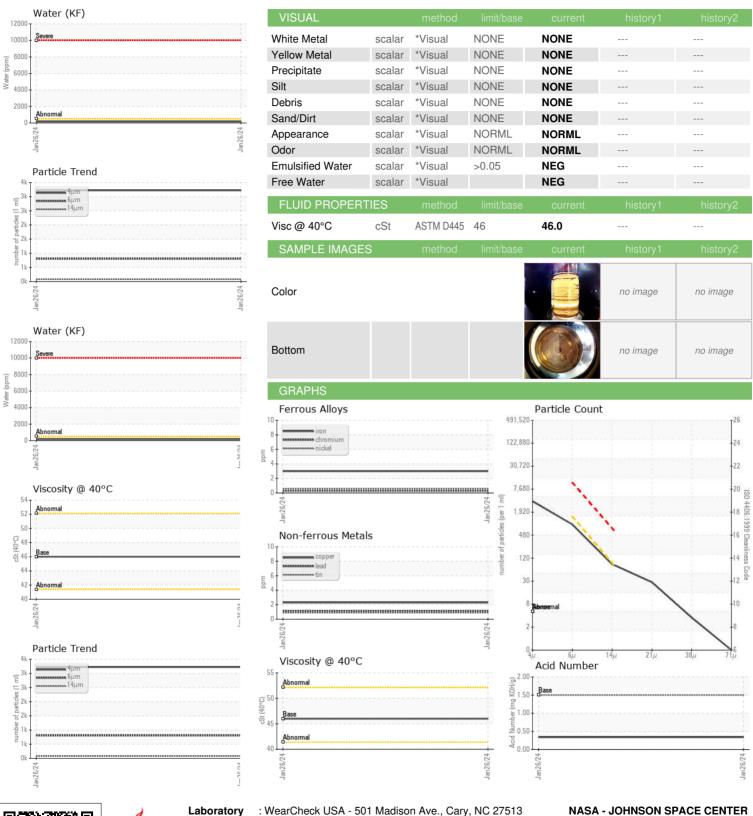



Certificate 12367

Laboratory Sample No.

: KCPA015875 Lab Number : 06153784 Unique Number: 10989207

Received : 18 Apr 2024 **Tested** Diagnosed

: 20 Apr 2024

: 23 Apr 2024 - Don Baldridge Test Package : IND 2 (Additional Tests: KF, PrtCount)

Contact: Service Manager tttrinh@wylehou.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: NASHOU [WUSCAR] 06153784 (Generated: 04/23/2024 11:31:35) Rev: 1

Contact/Location: Service Manager - NASHOU

2101 NASA PKWY

HOUSTON, TX

US 77058

T:

F: