




# OIL ANALYSIS REPORT

## Sample Rating Trend

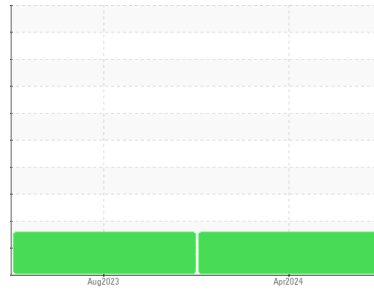

ISO



Machine Id  
**KAESER ASD 40S 6944926 (S/N 1082)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

### DIAGNOSIS

#### ▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### ▲ Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA012581</b>	KCPA003649	---
Sample Date	Client Info			<b>16 Apr 2024</b>	29 Aug 2023	---
Machine Age	hrs	Client Info		<b>27992</b>	24807	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>Changed</b>	N/A	---
Sample Status				<b>ABNORMAL</b>	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	5	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m	>3	<1	0	---
Titanium	ppm	ASTM D5185m	>3	<1	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>3</b>	▲ 15	---
Lead	ppm	ASTM D5185m	>10	<b>1</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>4</b>	1	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		<1	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>1</b>	0	---
Molybdenum	ppm	ASTM D5185m		<1	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m		<1	<1	---
Calcium	ppm	ASTM D5185m		<b>3</b>	0	---
Phosphorus	ppm	ASTM D5185m	500	<b>67</b>	266	---
Zinc	ppm	ASTM D5185m		<b>25</b>	163	---
Sulfur	ppm	ASTM D5185m		<b>1427</b>	1680	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	---
Sodium	ppm	ASTM D5185m		<b>0</b>	2	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	2	---
Water	%	ASTM D6304	>0.05	<b>0.003</b>	0.005	---
ppm Water	ppm	ASTM D6304	>500	<b>29</b>	53.1	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>11242</b>	5773	---
Particles >6µm		ASTM D7647	>1300	▲ <b>2823</b>	● 1383	---
Particles >14µm		ASTM D7647	>80	▲ <b>190</b>	61	---
Particles >21µm		ASTM D7647	>20	▲ <b>57</b>	17	---
Particles >38µm		ASTM D7647	>4	<b>3</b>	1	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>21/19/15</b>	● 20/18/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	<b>0.61</b>	0.73	---


# OIL ANALYSIS REPORT

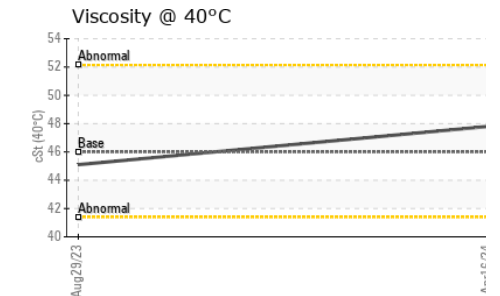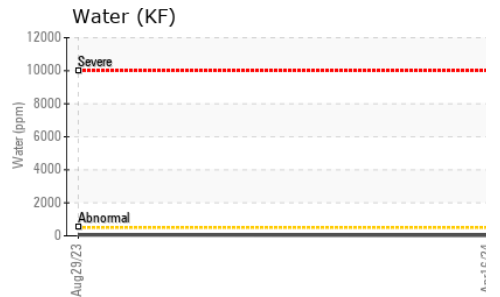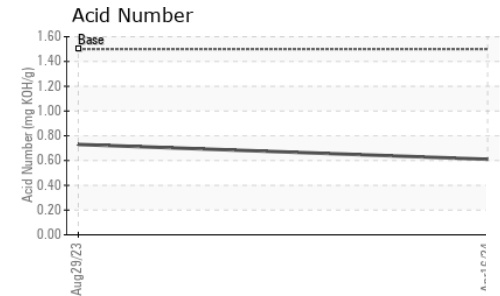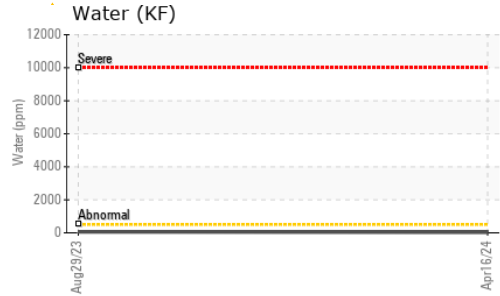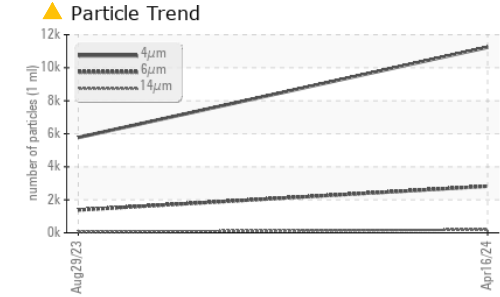





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.8	45.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

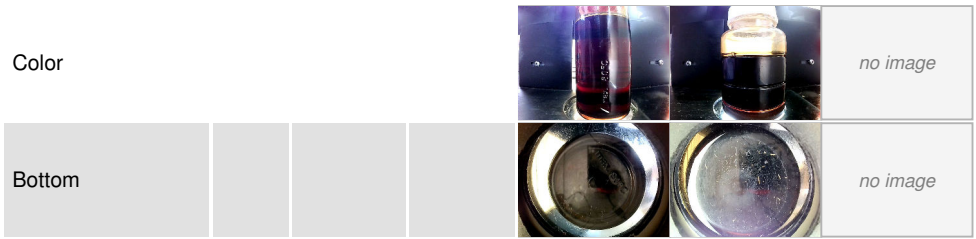

## GRAPHS

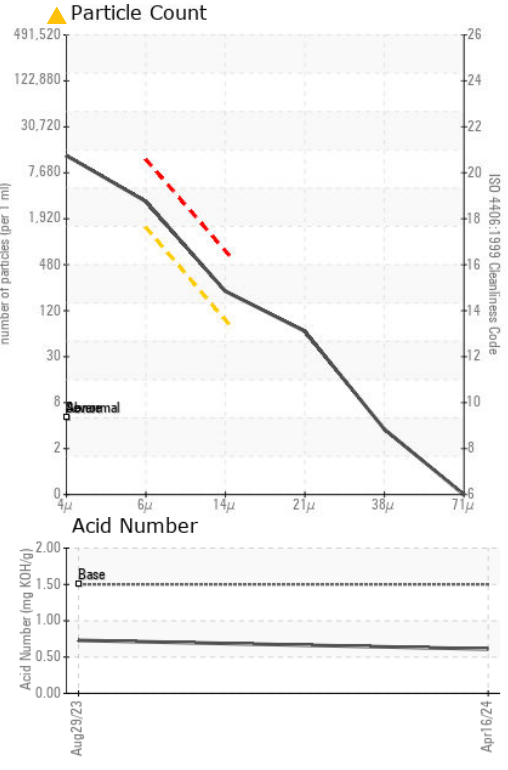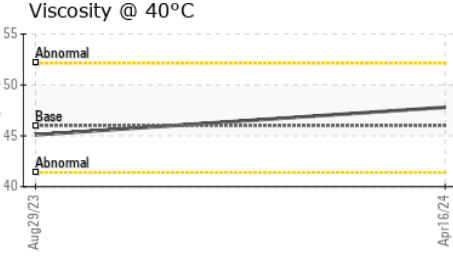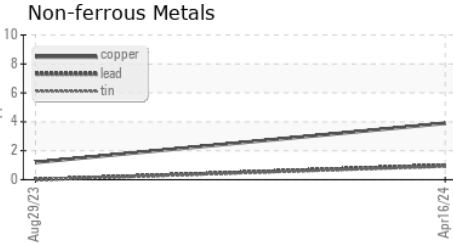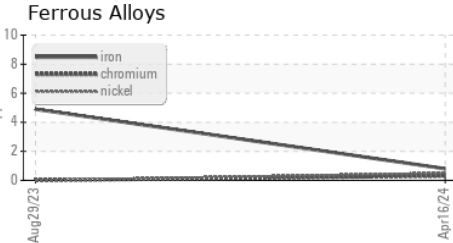

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA012581  
**Lab Number** : 06153793  
**Unique Number** : 10989216  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 18 Apr 2024  
**Tested** : 23 Apr 2024  
**Diagnosed** : 23 Apr 2024 - Don Baldrige

**GEORGE CHIALA FARMS INC**  
 9351 FIARVIEW RD  
 HOLLISTER, CA  
 US 95023  
 Contact: JIM CASILLAS  
 JIM.CASILLAS@GCFARMS.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)