

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

7831450 (S/N 1488) Component Compressor

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06153801	KC111015	
Sample Date		Client Info		09 Apr 2024	20 Jul 2023	
Machine Age	hrs	Client Info		9769	6337	
Oil Age	hrs	Client Info		0	3509	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	<1	<1	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	0	
Lead		ASTM D5185m	>10	_ <1	0	
Copper	ppm		>50	11	7	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m	>10	<1	0	
	ppm					
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	10	0	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	90	36	11	
Calcium	ppm	ASTM D5185m	2	4	0	
Phosphorus	ppm	ASTM D5185m		3	0	
Zinc	ppm	ASTM D5185m		8	7	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		29	5	
Potassium	ppm	ASTM D5185m	>20	8	<1	
Water	%	ASTM D6304	>0.05	0.008	0.006	
ppm Water	ppm	ASTM D6304	>500	84	67.2	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2879	10544	
Particles >6µm		ASTM D7647	>1300	492	🔺 2509	
Particles >14µm		ASTM D7647	>80	38	A 225	
Particles >21µm		ASTM D7647	>20	14	6	
Particles >38µm		ASTM D7647	>4	0	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/16/12	1 /19/15	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.33	0.34	



OIL ANALYSIS REPORT

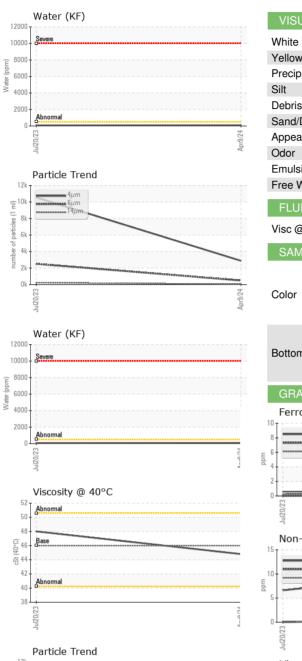



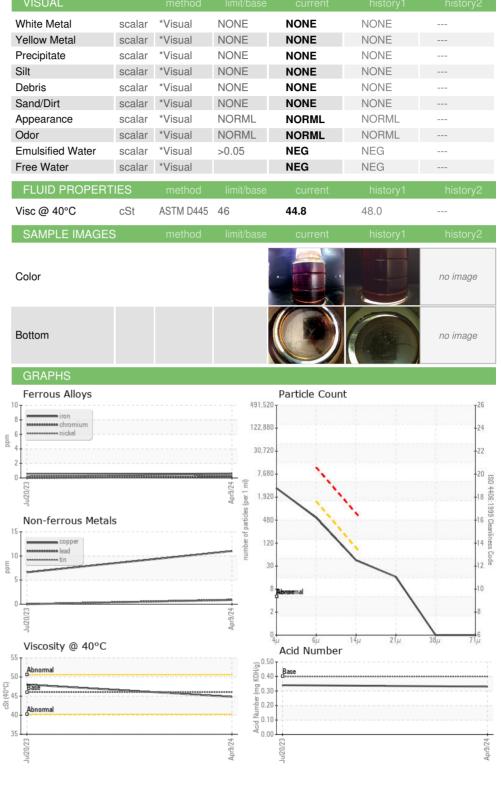



UNIPAR 130 ROYAL ST REEDSVILLE, PA US 17084 Contact: Service Manager

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received

Diagnosed

Tested

: 18 Apr 2024

: 23 Apr 2024

: 23 Apr 2024 - Don Baldridge

Contact/Location: Service Manager - UNIREE

T:

F:

Page 2 of 2

Report Id: UNIREE [WUSCAR] 06153801 (Generated: 04/23/2024 11:25:57) Rev: 1

Certificate 12367

Laboratory

Sample No.

Lab Number : 06153801

Unique Number : 10989224

Test Package : IND 2

: KC06153801

To discuss this sample report, contact Customer Service at 1-800-237-1369.