




# OIL ANALYSIS REPORT

Sample Rating Trend

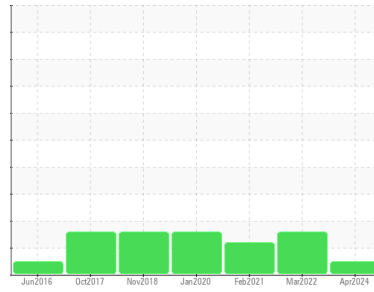

**NORMAL**



Machine Id  
**KAESER ASD 30 5465055 (S/N 1208)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor. We were unable to perform a particle count due to insufficient sample. Sample leaked in transit.

**Wear**

All component wear rates are normal.

**Contamination**

Insufficient sample was received to conduct all the routine laboratory tests. There is no indication of any contamination in the oil.

**Fluid Condition**

The condition of the oils additive package is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA015086</b>	KCP44494	KCP34945
Sample Date	Client Info			<b>03 Apr 2024</b>	25 Mar 2022	24 Feb 2021
Machine Age	hrs	Client Info		<b>36196</b>	31357	27671
Oil Age	hrs	Client Info		<b>1284</b>	8000	4354
Oil Changed	Client Info			<b>Not Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	<1
Aluminum	ppm	ASTM D5185m	>10	0	0	1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	1	6	6
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	11
Barium	ppm	ASTM D5185m	90	3	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	68	0	16
Calcium	ppm	ASTM D5185m	2	4	0	0
Phosphorus	ppm	ASTM D5185m		0	4	6
Zinc	ppm	ASTM D5185m		8	0	58
Sulfur	ppm	ASTM D5185m		<b>21280</b>	7953	16720

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	▲ 32	<1
Sodium	ppm	ASTM D5185m		14	1	7
Potassium	ppm	ASTM D5185m	>20	10	0	1
Water	%	ASTM D6304	>0.05	<b>NEG</b>	0.007	0.012
ppm Water	ppm	ASTM D6304	>500	---	78.3	124.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	295	10362
Particles >6µm		ASTM D7647	>1300	---	89	● 1316
Particles >14µm		ASTM D7647	>80	---	12	● 84
Particles >21µm		ASTM D7647	>20	---	4	● 28
Particles >38µm		ASTM D7647	>4	---	0	1
Particles >71µm		ASTM D7647	>3	---	0	0
Oil Cleanliness		ISO 4406 (c)	>17/13	---	14/11	● 18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	---	0.47	0.354


# OIL ANALYSIS REPORT

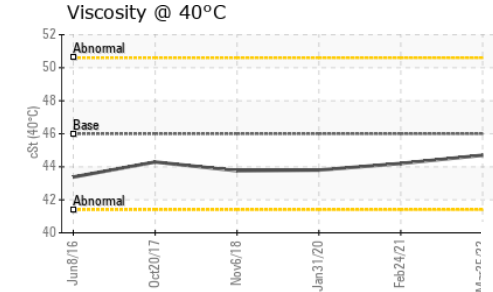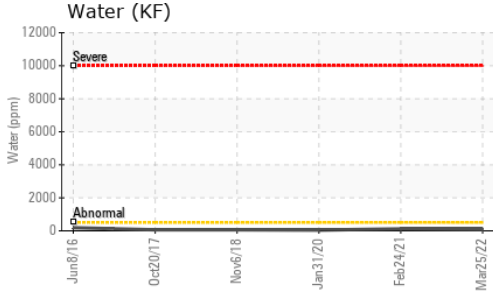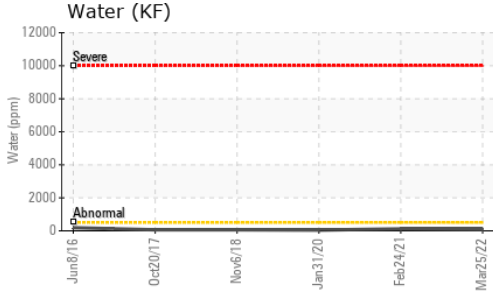





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	---	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

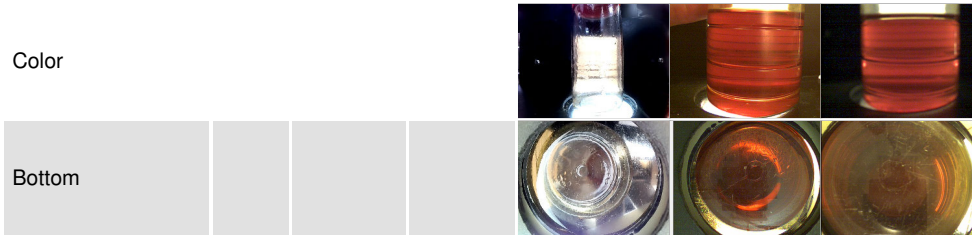

## GRAPHS

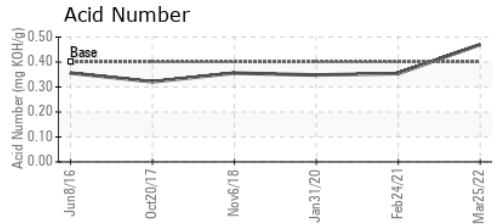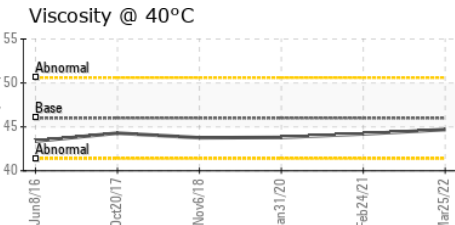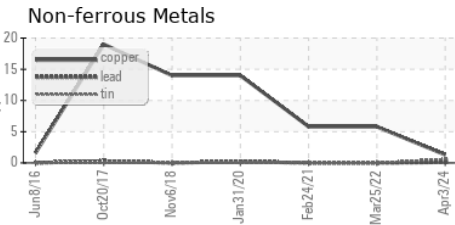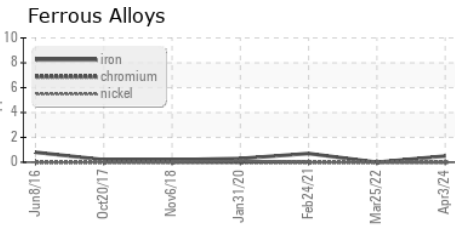

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA015086  
**Lab Number** : 06153867  
**Unique Number** : 10989290  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 18 Apr 2024  
**Tested** : 06 May 2024  
**Diagnosed** : 06 May 2024 - Doug Bogart

**MESH ENGINEERING**  
 268 SUCCESSFUL WAY  
 DAWSONVILLE, GA  
 US 30534  
 Contact: E BROWN  
 ebrown@mesheng.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)