


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

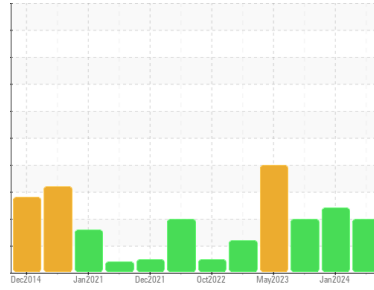

Machine Id  
**BT-F01-B1M (S/N B1 RECYCLE BLOWER MOTOR)**  
Component  
**Drive End Bearing**  
Fluid  
**SHELL TELLUS S2 MX 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

Filter oil if possible using B6=75 filter media or better. No other actions needed at this time. Resample at next normal interval.

REISSUE: This sample is for the Drive end BLOWER bearing, not the motor. The tag provided to the lab is incorrect and points to the MOTOR bearing. All other notes are correct for the BLOWER bearing.

### Wear

Wear is low and acceptable.

### Contamination

Contaminant levels are typical for new oil from the drum.

### Fluid Condition

Fluid health is acceptable for continued use.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PLS0000292</b>	PLS0000789	PLS0000774
Sample Date	Client Info		<b>17 Apr 2024</b>	31 Jan 2024	24 Oct 2023
Machine Age	mths	Client Info	<b>3</b>	3	0
Oil Age	mths	Client Info	<b>0</b>	0	1
Oil Changed	Client Info		<b>N/A</b>	N/A	Changed
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>2	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>13</b>	19	8
Iron	ppm	ASTM D5185m >20	<b>&lt;1</b>	2	0
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>67</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>4</b>	2	0
Phosphorus	ppm	ASTM D5185m	<b>315</b>	20	18
Zinc	ppm	ASTM D5185m	<b>351</b>	7	0
Sulfur	ppm	ASTM D5185m	<b>1049</b>	732	▲ 1609






## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>2</b>	0	1
Potassium	ppm	ASTM D5185m >20	<b>2</b>	0	0

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624	<b>1.8</b>	1.8	1.9
Sulfation	Abs/1mm	*ASTM D7415	<b>10.7</b>	10.7	11.0

# OIL ANALYSIS REPORT

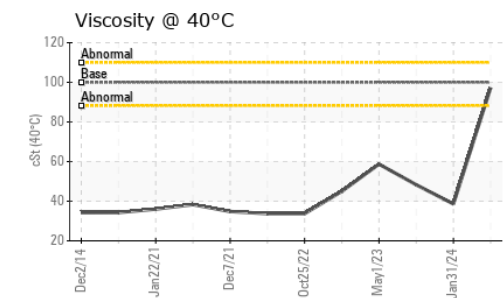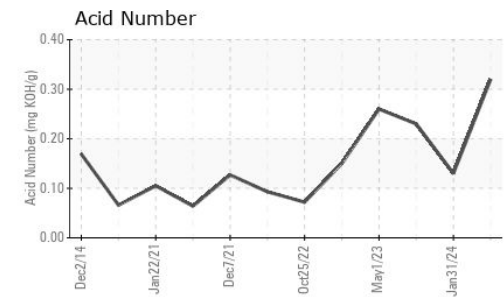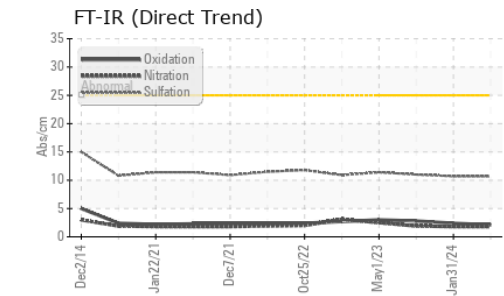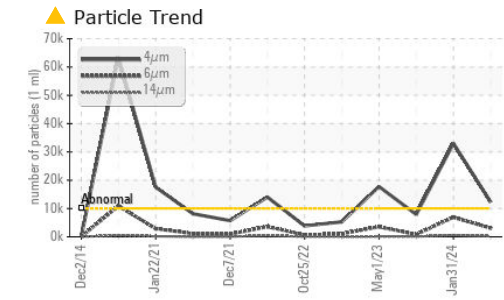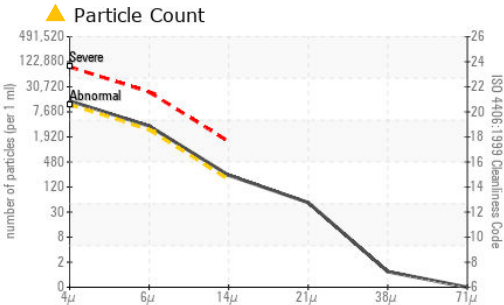

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PLS0000292 **Received** : 19 Apr 2024  
**Lab Number** : 06154201 **Tested** : 06 May 2024  
**Unique Number** : 10989624 **Diagnosed** : 08 May 2024 - Mike Johnson  
**Test Package** : IND 2 ( Additional Tests: FT-IR, PQ, PrtCount )

**HEXION - BAYTOWN PLANT**  
 8450 WEST BAY RD  
 BAYTOWN, TX  
 US 77520  
 Contact: BILL MINER  
 bill.miner@momentive.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F:

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 12276	▲ 33014	7872
Particles >6µm	ASTM D7647	>2500	▲ 3064	▲ 6928	826
Particles >14µm	ASTM D7647	>160	▲ 203	▲ 558	87
Particles >21µm	ASTM D7647	>40	▲ 45	▲ 177	29
Particles >38µm	ASTM D7647	>10	1	● 15	4
Particles >71µm	ASTM D7647	>3	0	1	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 21/19/15	▲ 22/20/16	20/17/14

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/1mm *ASTM D7414		2.1	2.4	2.8
Acid Number (AN)	mg KOH/g ASTM D8045		0.32	0.13	▲ 0.23

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE	NONE
Debris	scalar *Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar *Visual	>2	NEG	NEG	NEG
Free Water	scalar *Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445	100	97.2	38.6	▲ 48.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color



Bottom

