


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

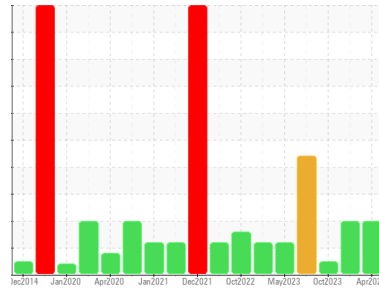

Machine Id
BT-F01-B1 (S/N B1 RECYCLE BLOWER)
Component
Inboard Blower
Fluid
SHELL TELLUS S2 MX 100 (--- GAL)

DIAGNOSIS

Recommendation

Filter oil if possible using B6=75 filter media or better. No other actions needed at this time. Resample at next normal interval. REISSUE: This sample is for the Drive end BLOWER bearing, not the motor.

Wear

Wear is low and acceptable.

Contamination

Contaminant levels are typical for new oil from the drum.

Fluid Condition

Fluid health is acceptable for continued use.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PLS0000292	PLS0000788	PLS0000775
Sample Date	Client Info	17 Apr 2024	31 Jan 2024	24 Oct 2023
Machine Age	mths	3	3	0
Oil Age	mths	0	0	1
Oil Changed	Client Info	N/A	N/A	Changed
Sample Status		ABNORMAL	ABNORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2	
PQ	ASTM D8184	13	12	17	
Iron	ppm	ASTM D5185m >20	<1	0	4
Chromium	ppm	ASTM D5185m >20	0	0	0
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	0	0	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	0	0	0
Lead	ppm	ASTM D5185m >20	<1	0	0
Copper	ppm	ASTM D5185m >20	<1	1	0
Tin	ppm	ASTM D5185m >20	<1	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	<1	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	67	66	33
Calcium	ppm	ASTM D5185m	4	2	0
Phosphorus	ppm	ASTM D5185m	315	293	235
Zinc	ppm	ASTM D5185m	351	355	324
Sulfur	ppm	ASTM D5185m	1049	788	529






CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	0	<1	<1
Sodium	ppm	ASTM D5185m	2	0	<1
Potassium	ppm	ASTM D5185m >20	2	0	1

INFRA-RED

method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	0	0	0
Nitration	Abs/cm	*ASTM D7624	1.8	1.8	1.9
Sulfation	Abs/.1mm	*ASTM D7415	10.7	10.5	10.8

OIL ANALYSIS REPORT

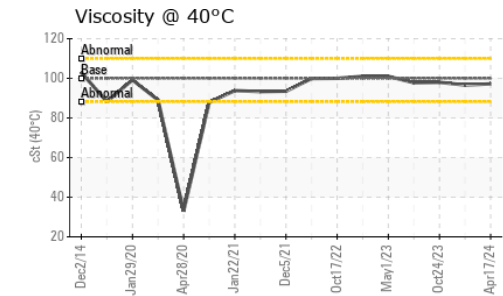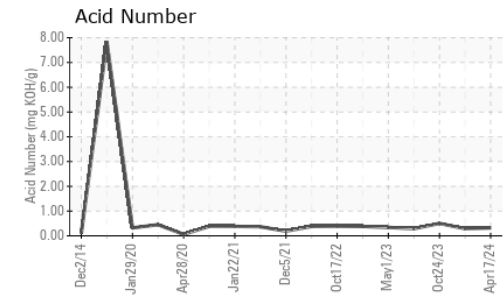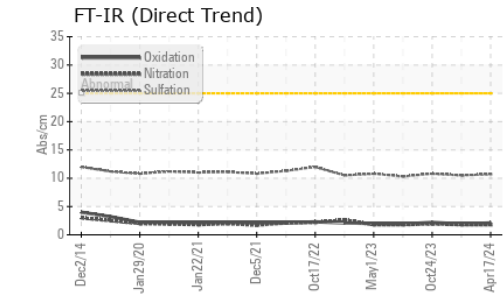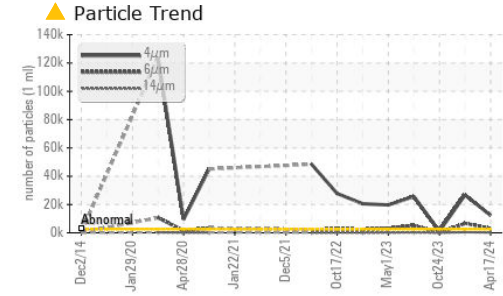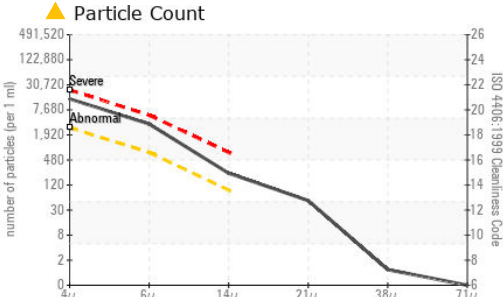

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PLS0000292 **Received** : 19 Apr 2024
Lab Number : 06154201 **Tested** : 06 May 2024
Unique Number : 10989624 **Diagnosed** : 09 May 2024 - Mike Johnson
Test Package : IND 2 (Additional Tests: FT-IR, PQ, PrtCount)

HEXION - BAYTOWN PLANT
 8450 WEST BAY RD
 BAYTOWN, TX
 US 77520
 Contact: BILL MINER
 bill.miner@momentive.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	▲ 12276	▲ 26730	1174
Particles >6µm	ASTM D7647	>640	▲ 3064	▲ 6716	162
Particles >14µm	ASTM D7647	>80	▲ 203	▲ 425	15
Particles >21µm	ASTM D7647	>20	▲ 45	▲ 91	6
Particles >38µm	ASTM D7647	>4	1	4	3
Particles >71µm	ASTM D7647	>3	0	0	3
Oil Cleanliness	ISO 4406 (c)	>18/16/13	▲ 21/19/15	▲ 22/20/16	17/15/11

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414		2.1	1.9	2.2
Acid Number (AN)	mg KOH/g ASTM D8045		0.32	0.29	0.50

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE	NONE
Debris	scalar *Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar *Visual		NEG	NEG	NEG
Free Water	scalar *Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445	100	97.2	96.6	98.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

