


OIL ANALYSIS REPORT

Sample Rating Trend



VIS DEBRIS

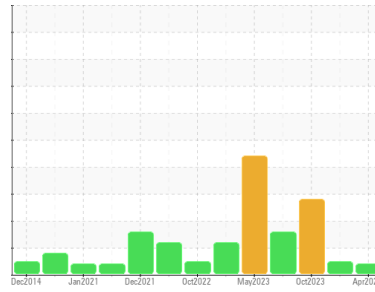

Machine Id
BT-F01-B1M (S/N B1 RECYCLE BLOWER MOTOR)
Component
Non-Drive End Bearing
Fluid
SHELL TURBO T ISO 32 (--- GAL)

DIAGNOSIS

Recommendation

Visible debris in the sample prevented a proper particle count. Filter oil if possible using B6=75 filter media or better. Confirm oil sampling techniques. Resample at next normal interval, or immediately if desiring a proper particle count.

Wear

Wear particles are low and steady.

Contamination

Particle contamination was not conducted due to visible particulate. Review seals and breathers. Review oil sampling techniques. Filtration can help extend machine life.

Fluid Condition

Fluid health indicators are acceptable for continued use.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PLS0000300	PLS0000790	PLS0000773
Sample Date	Client Info			17 Apr 2024	31 Jan 2024	24 Oct 2023
Machine Age	mths	Client Info		3	3	0
Oil Age	mths	Client Info		0	0	1
Oil Changed	Client Info			N/A	N/A	Changed
Sample Status				ABNORMAL	NORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>2	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		34	13	8
Iron	ppm	ASTM D5185m	>20	6	0	0
Chromium	ppm	ASTM D5185m	>20	0	0	0
Nickel	ppm	ASTM D5185m	>20	0	0	0
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	0	<1	0
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>20	<1	<1	<1
Tin	ppm	ASTM D5185m	>20	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	<1	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		<1	<1	0
Calcium	ppm	ASTM D5185m		2	3	0
Phosphorus	ppm	ASTM D5185m		16	19	35
Zinc	ppm	ASTM D5185m		0	7	0
Sulfur	ppm	ASTM D5185m		580	749	▲ 2263


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	0	<1
Sodium	ppm	ASTM D5185m		2	0	1
Potassium	ppm	ASTM D5185m	>20	0	0	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624		1.7	1.8	2.1
Sulfation	Abs/.1mm	*ASTM D7415		10.9	10.7	11.2


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414		2.4	2.4	3.1
Acid Number (AN)	mg KOH/g	ASTM D8045	.05	0.11	0.15	▲ 0.33

OIL ANALYSIS REPORT


FT-IR (Direct Trend)

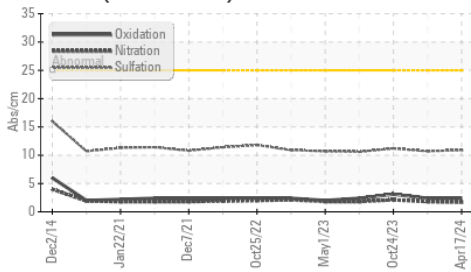


Acid Number

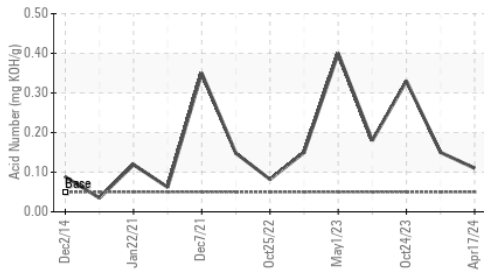

Viscosity @ 40°C

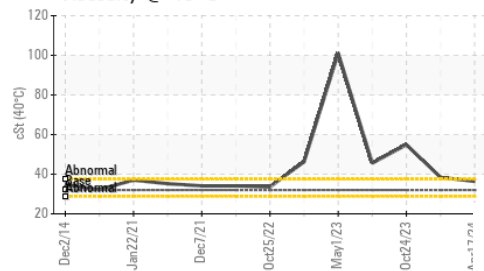


PQ

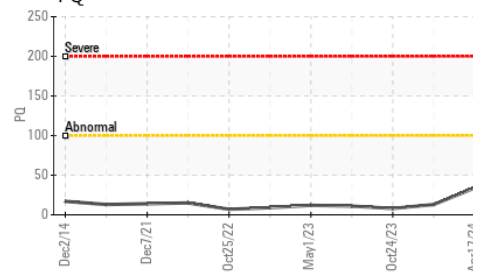






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	36.4	38.4 ▲ 54.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

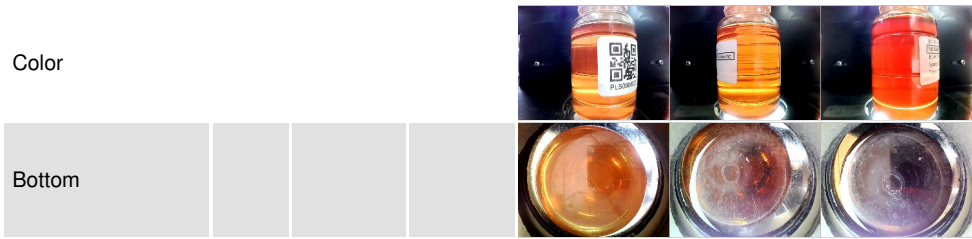

GRAPHS

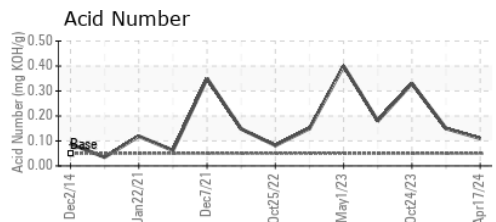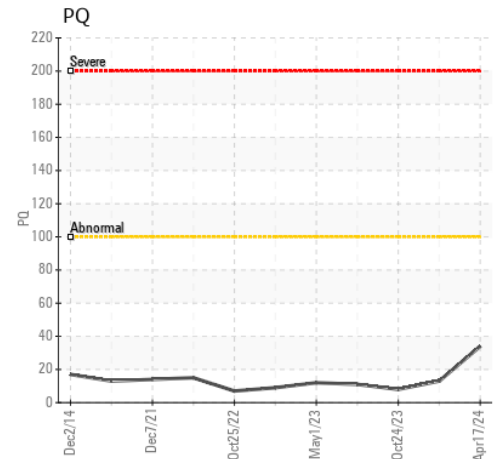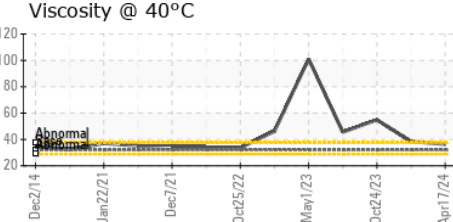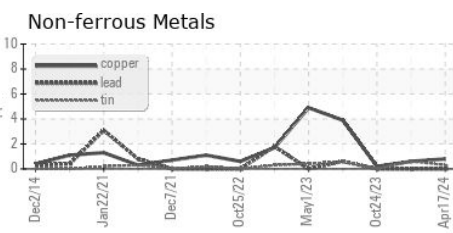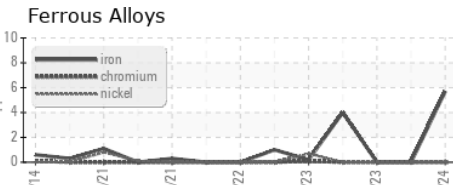

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PLS0000300 **Received** : 19 Apr 2024
Lab Number : 06154205 **Tested** : 07 May 2024
Unique Number : 10989628 **Diagnosed** : 08 May 2024 - Mike Johnson
Test Package : IND 2 (Additional Tests: FT-IR, PQ)

HEXION - BAYTOWN PLANT
 8450 WEST BAY RD
 BAYTOWN, TX
 US 77520
 Contact: BILL MINER
 bill.miner@momentive.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)