




OIL ANALYSIS REPORT

Sample Rating Trend

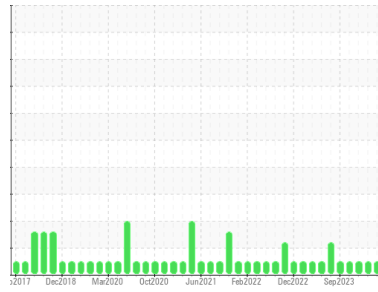

NORMAL



Area

MP-136

Machine Id

B33926 - PUMP VACUUM BUSCH 630 FIRE BRAISED (S/N C-3550)

Component

Pump

Fluid

PETRO CANADA PURITY FG SYNTHETIC 100 (4 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0923593	WC0894919	WC0880564
Sample Date	Client Info		15 Apr 2024	22 Feb 2024	04 Jan 2024
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	Not Changd
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	0	0	0
Chromium	ppm	ASTM D5185m >5	0	0	0
Nickel	ppm	ASTM D5185m >5	0	<1	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >7	0	<1	0
Lead	ppm	ASTM D5185m >12	0	<1	0
Copper	ppm	ASTM D5185m >30	<1	<1	<1
Tin	ppm	ASTM D5185m >9	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m	<1	2	0
Calcium	ppm	ASTM D5185m	0	2	0
Phosphorus	ppm	ASTM D5185m	517	446	277
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	1436	1065	511

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<1	2	3
Sodium	ppm	ASTM D5185m	2	1	0
Potassium	ppm	ASTM D5185m >20	1	3	0

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	956	1689	834
Particles >6µm	ASTM D7647	>2500	323	535	328
Particles >14µm	ASTM D7647	>320	22	24	42
Particles >21µm	ASTM D7647	>80	5	5	8
Particles >38µm	ASTM D7647	>20	0	0	2
Particles >71µm	ASTM D7647	>4	0	0	1
Oil Cleanliness	ISO 4406 (c)	>20/18/15	17/16/12	18/16/12	17/16/13


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.5	0.13	0.16	0.11




OIL ANALYSIS REPORT


Particle Trend

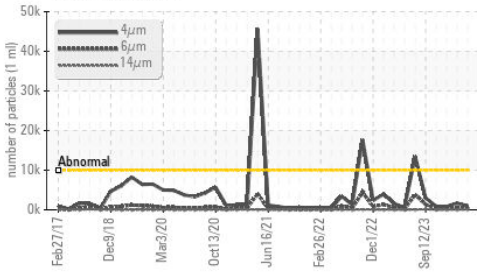


Acid Number

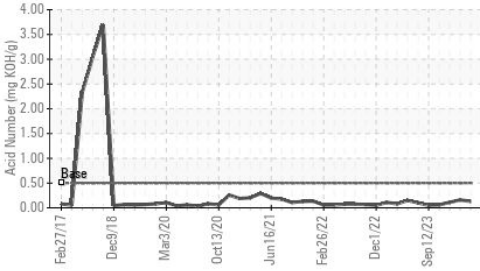

Viscosity @ 40°C

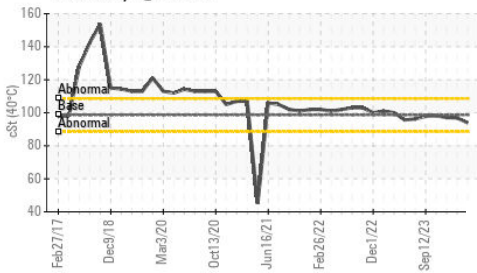


Particle Trend

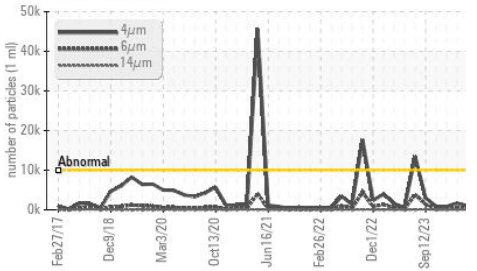

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	98.7	93.9	96.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

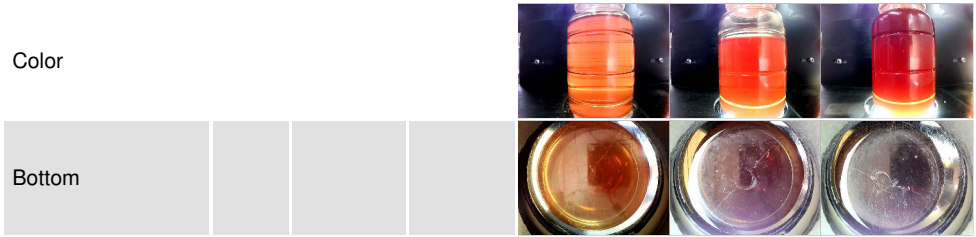


GRAPHS


Ferrous Alloys

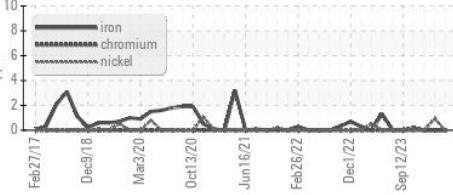


Non-ferrous Metals

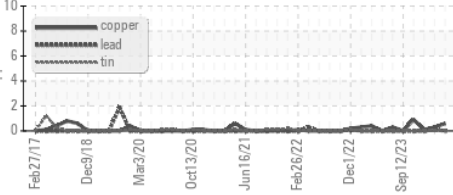


Viscosity @ 40°C

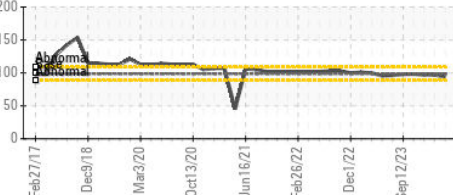

Particle Count

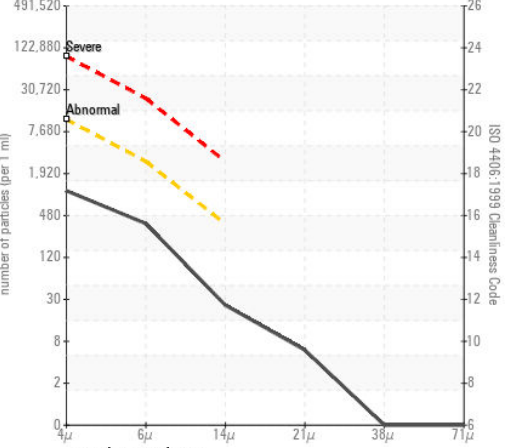

Acid Number

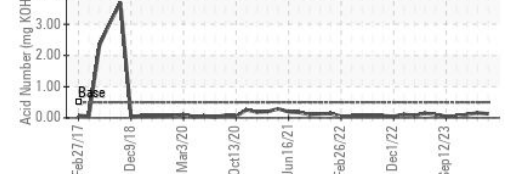

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0923593 **Received** : 19 Apr 2024
Lab Number : 06154338 **Tested** : 22 Apr 2024
Unique Number : 10989761 **Diagnosed** : 23 Apr 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: PrtCount)

HORMEL FOODS - AUSTIN
 1101 NORTH MAIN ST
 AUSTIN, MN
 US 55912
 Contact: RYAN LOWE
 rslowe@hormel.com
 T: (507)437-5674
 F: (507)437-9805

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)