




# OIL ANALYSIS REPORT

## Sample Rating Trend

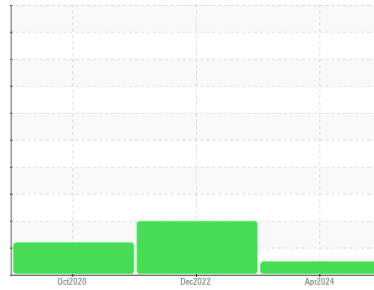

**NORMAL**



Machine Id  
**5792705 (S/N 1639)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA016987</b>	KCP52056	KCP29664
Sample Date	Client Info			<b>08 Apr 2024</b>	09 Dec 2022	24 Oct 2020
Machine Age	hrs	Client Info		<b>26365</b>	22619	13913
Oil Age	hrs	Client Info		<b>3746</b>	3378	7705
Oil Changed	Client Info			<b>Not Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>10</b>	17	18
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>17</b>	7	2
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m		<b>0</b>	<1	3
Zinc	ppm	ASTM D5185m		<b>41</b>	39	11
Sulfur	ppm	ASTM D5185m		<b>21984</b>	20472	13671

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>8</b>	3	1
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	<1	<1
Water	%	ASTM D6304	>0.05	<b>0.013</b>	0.017	0.007
ppm Water	ppm	ASTM D6304	>500	<b>130</b>	173.0	71.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>3198</b>	15759	15753
Particles >6µm		ASTM D7647	>1300	<b>925</b>	▲ 5747	▲ 2896
Particles >14µm		ASTM D7647	>80	<b>60</b>	▲ 476	● 129
Particles >21µm		ASTM D7647	>20	<b>15</b>	▲ 107	● 39
Particles >38µm		ASTM D7647	>4	<b>1</b>	● 7	● 4
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	2
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>19/17/13</b>	▲ 21/20/16	▲ 19/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.37</b>	0.37	0.330


# OIL ANALYSIS REPORT

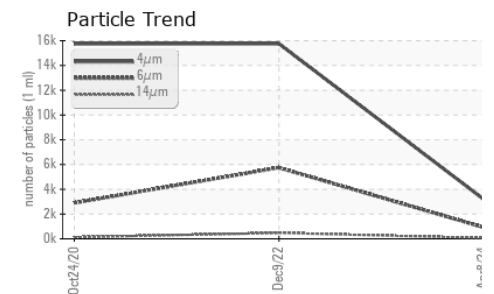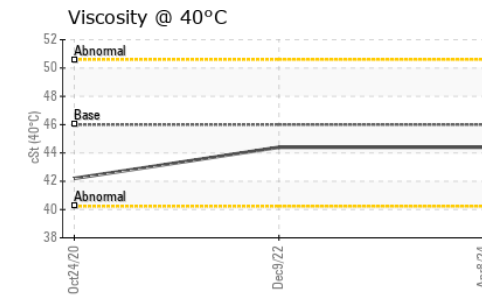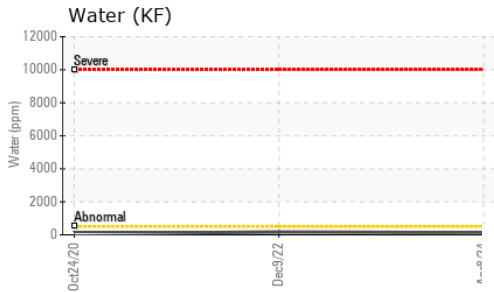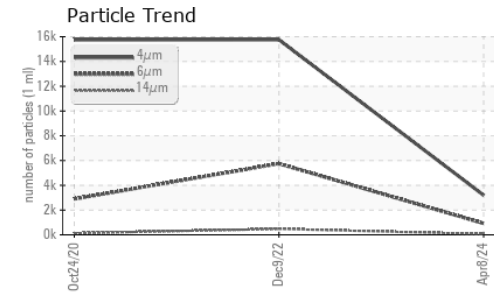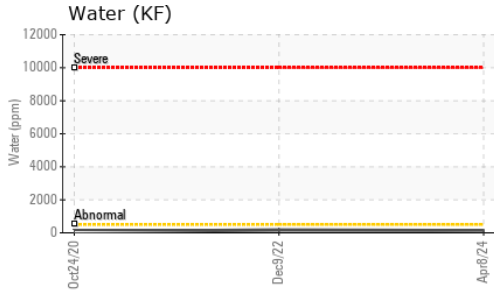




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.4	44.4	42.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

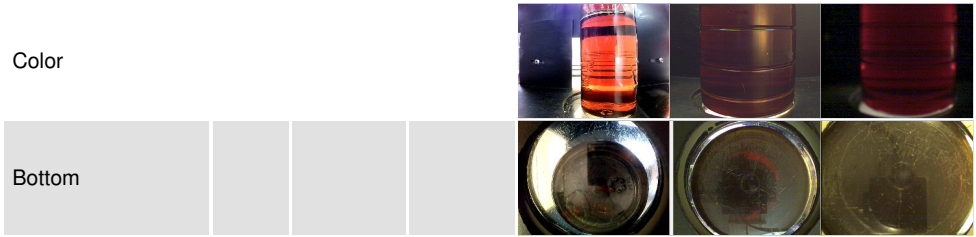

## GRAPHS

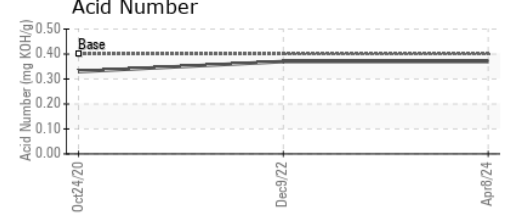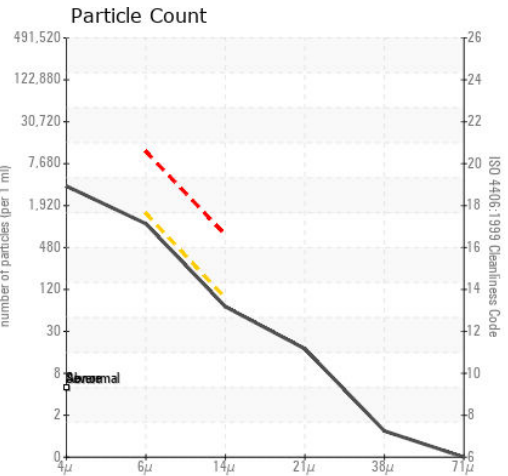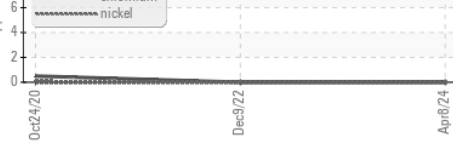

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA016987 **Received** : 19 Apr 2024  
**Lab Number** : 06154352 **Tested** : 22 Apr 2024  
**Unique Number** : 10989775 **Diagnosed** : 22 Apr 2024 - Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**VPG - VOLUNTARY PURCHASING GROUP**  
 230 FM 87  
 BONHAM, TX  
 US 75418  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: