




# OIL ANALYSIS REPORT

Sample Rating Trend

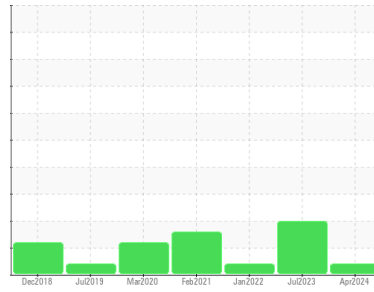

VIS DEBRIS



Machine Id  
**KAESER BSD 50 6208388 (S/N 1808)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA012667</b>	KCPA003238	KCP40844
Sample Date	Client Info		<b>13 Apr 2024</b>	12 Jul 2023	27 Jan 2022
Machine Age	hrs	Client Info	<b>30425</b>	27036	18225
Oil Age	hrs	Client Info	<b>3387</b>	0	5300
Oil Changed	Client Info		<b>Changed</b>	N/A	Changed
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ATTENTION

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>16</b>	10	10
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m 90	<b>0</b>	1	19
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 100	<b>1</b>	0	20
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>0</b>	0	11
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 23500	<b>20868</b>	17236	15858

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	11
Sodium	ppm	ASTM D5185m	<b>4</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Water	%	ASTM D6304 >0.05	<b>0.013</b>	0.005	0.010
ppm Water	ppm	ASTM D6304 >500	<b>137</b>	55.3	104.7




## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>---</b>	8155	6597
Particles >6µm	ASTM D7647	>1300	<b>---</b>	▲ 3093	● 1675
Particles >14µm	ASTM D7647	>80	<b>---</b>	▲ 151	80
Particles >21µm	ASTM D7647	>20	<b>---</b>	▲ 30	19
Particles >38µm	ASTM D7647	>4	<b>---</b>	1	1
Particles >71µm	ASTM D7647	>3	<b>---</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>---</b>	▲ 20/19/14	● 18/13

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.49</b>	0.53	0.41


# OIL ANALYSIS REPORT

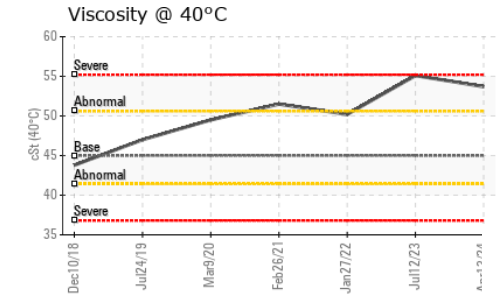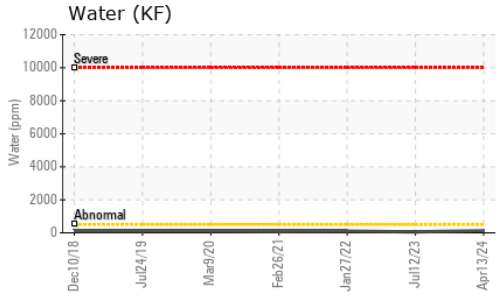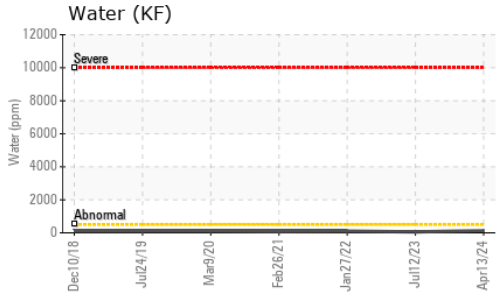





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	53.7	55.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

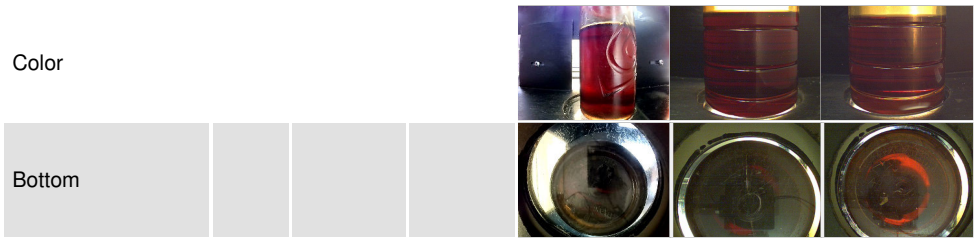

## GRAPHS

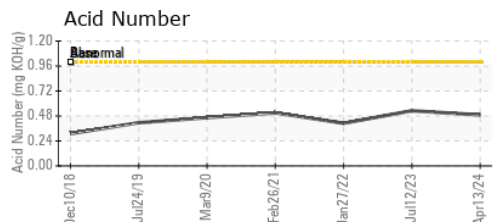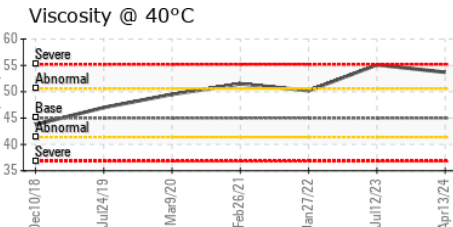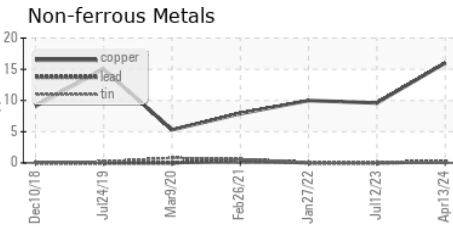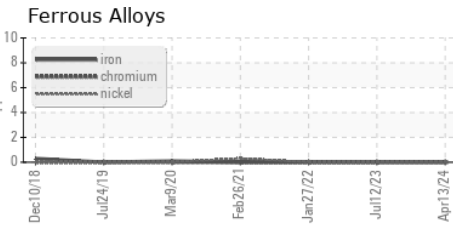

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA012667 **Received** : 19 Apr 2024  
**Lab Number** : 06154355 **Tested** : 22 Apr 2024  
**Unique Number** : 10989778 **Diagnosed** : 22 Apr 2024 - Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**ARAMARK UNIFORMS**  
 1900 EMPIRE CENTRAL  
 DALLAS, TX  
 US 75235  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: