




# OIL ANALYSIS REPORT

Sample Rating Trend

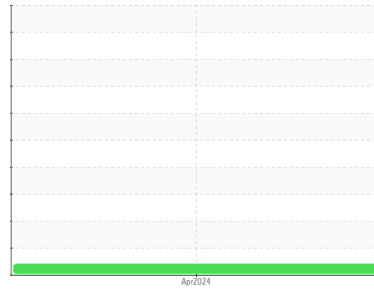

VISCOSITY



Machine Id

## KILL FLOOR HPU

Component

### Hydraulic System

Fluid

### AW HYDRAULIC OIL ISO 46 (2500 GAL)

#### DIAGNOSIS

##### Recommendation

Resample at the next service interval to monitor.  
NOTE: one of two samples received with same ID.

##### Wear

All component wear rates are normal.

##### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

##### Fluid Condition

The oil viscosity is higher than normal. Confirmed.  
The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>USPM36746</b>	---	---
Sample Date	Client Info			<b>17 Apr 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>ATTENTION</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m	>20	<b>1</b>	---	---
Lead	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	5	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	5	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	25	<b>1</b>	---	---
Calcium	ppm	ASTM D5185m	200	<b>52</b>	---	---
Phosphorus	ppm	ASTM D5185m	300	<b>335</b>	---	---
Zinc	ppm	ASTM D5185m	370	<b>441</b>	---	---
Sulfur	ppm	ASTM D5185m	2500	<b>796</b>	---	---






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	---	---
Water	%	ASTM D6304	>0.05	<b>0.001</b>	---	---
ppm Water	ppm	ASTM D6304	>500	<b>10</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>498</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>103</b>	---	---
Particles >14µm		ASTM D7647	>160	<b>11</b>	---	---
Particles >21µm		ASTM D7647	>40	<b>3</b>	---	---
Particles >38µm		ASTM D7647	>10	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>16/14/11</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	<b>0.45</b>	---	---



# OIL ANALYSIS REPORT

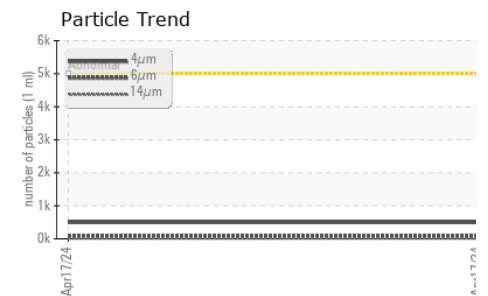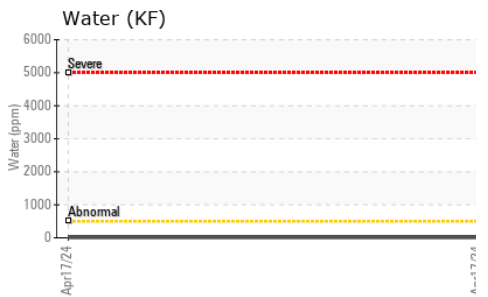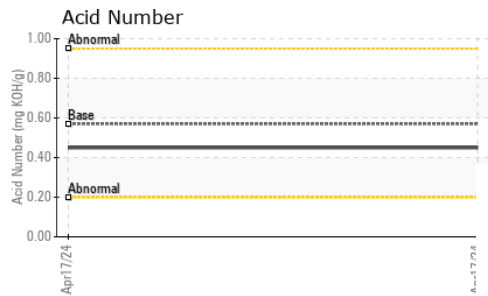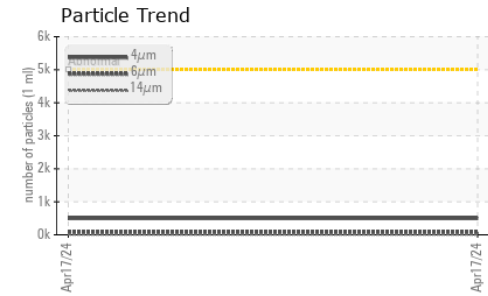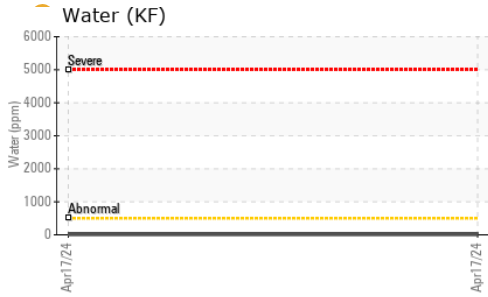

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---






FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	66.0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

**Color**

		no image	no image
<b>Bottom</b>		no image	no image

## GRAPHS

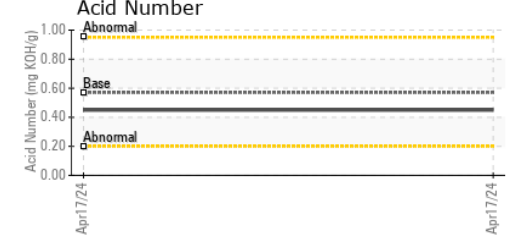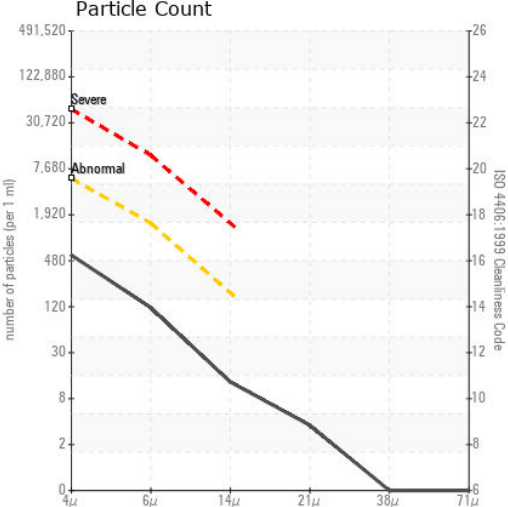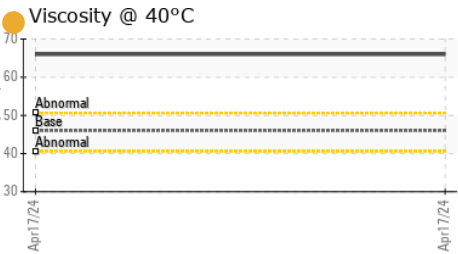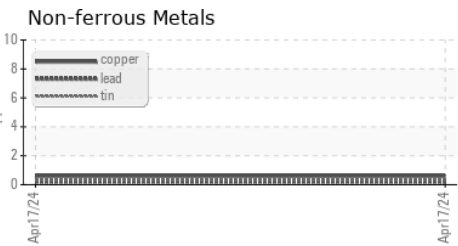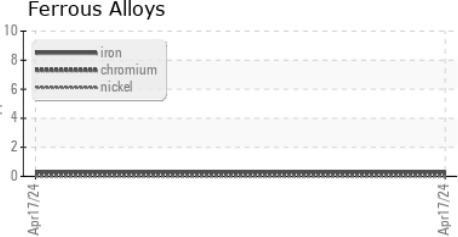

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM36746  
**Lab Number** : 06154399  
**Unique Number** : 10989822  
**Test Package** : IND 2

**Received** : 19 Apr 2024  
**Tested** : 22 Apr 2024  
**Diagnosed** : 22 Apr 2024 - Doug Bogart

**JBS SWIFT and COMPANY - GRAND ISLAND**  
 GRAND ISLAND, NE  
 US  
 Contact: RICK DUVAL

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (402)423-6375  
 F: (402)423-6661