


# **OIL ANALYSIS REPORT**

Sample Rating Trend

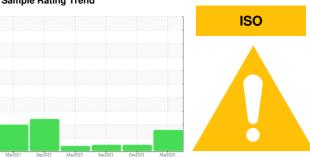

Machine Id

# SC-9 SINGLE SCREW B1 (S/N 437)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

### DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Mar2021	Sep2022 May2023	Sep2023 Dec2023	Mar2024	
SAMPLE INFORMA	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0006393	USP0004306	USP0000279
Sample Date		Client Info		29 Mar 2024	18 Dec 2023	04 Sep 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	2	0	0
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>3	1	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	0	<1
Tin	ppm	ASTM D5185m	>4	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
	ppm	ASTM D5185m		0	0	<1
	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	0	<1
Phosphorus	ppm	ASTM D5185m		0	0	<1
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	3	21
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	2
	ppm	ASTM D5185m	7.10	0	0	1
	ppm	ASTM D5185m	>20	2	0	<1
	%	ASTM D6304	>0.01	0.002	0.006	0.007
	ppm	ASTM D6304	>100	18	65	74.8
FLUID CLEANLINE						
	ESS	method	limit/base	current	history1	history2
Particles >4µm	ESS	method ASTM D7647	limit/base >10000	current ▲ 56880	history1 4799	history2 9486
Particles >4µm Particles >6µm	ESS			▲ 56880	4799	9486
Particles >6µm	ESS	ASTM D7647	>10000 >2500	▲ 56880 ▲ 14249	4799 1471	
Particles >6µm Particles >14µm	ESS	ASTM D7647 ASTM D7647 ASTM D7647	>10000 >2500 >320	▲ 56880 ▲ 14249 ▲ 353	4799 1471 133	9486 1871 52
Particles >6µm Particles >14µm Particles >21µm	ESS	ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>10000 >2500	▲ 56880 ▲ 14249	4799 1471 133 33	9486 1871
Particles >6μm Particles >14μm Particles >21μm Particles >38μm	ESS	ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>10000 >2500 >320 >80 >20	▲ 56880 ▲ 14249 ▲ 353 65	4799 1471 133	9486 1871 52 9
Particles >6µm Particles >14µm Particles >21µm	ESS	ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>10000 >2500 >320 >80	▲ 56880 ▲ 14249 ▲ 353 65	4799 1471 133 33 0	9486 1871 52 9
Particles >6μm Particles >14μm Particles >21μm Particles >38μm Particles >71μm		ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>10000 >2500 >320 >80 >20 >4	▲ 56880 ▲ 14249 ▲ 353 65 2	4799 1471 133 33 0	9486 1871 52 9 0



## **OIL ANALYSIS REPORT**

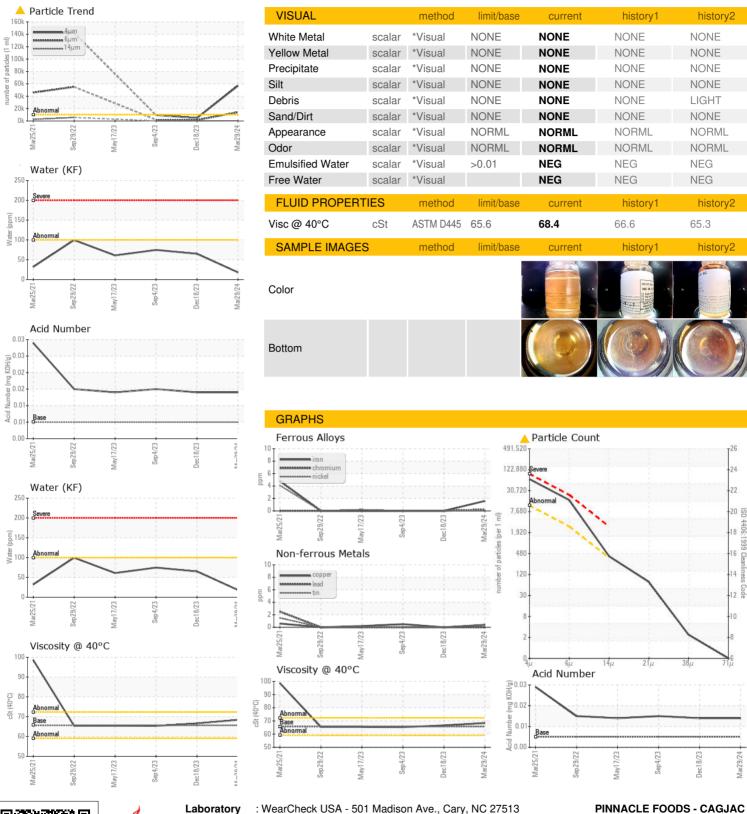



Certificate 12367

Laboratory Sample No. Lab Number

: USP0006393 : 06154430

Received **Tested** Diagnosed

Unique Number : 10989853 Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: 19 Apr 2024

: 22 Apr 2024

: 22 Apr 2024 - Doug Bogart

Report Id: PINJAC [WUSCAR] 06154430 (Generated: 04/22/2024 10:49:19) Rev: 1

Contact/Location: ? ? - PINJAC

JACKSON, TN

US

T:

F:

Contact: