

# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id  
**VILTER JBS R2**  
Component  
**Refrigeration Compressor**  
Fluid  
**FRICK COMPRESSOR OIL #9 (--- GAL)**

**DIAGNOSIS**

**Recommendation**  
Resample at the next service interval to monitor.

**Wear**  
All component wear rates are normal.

**Contamination**  
The amount and size of particulates present in the system are acceptable.

**Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>Y2K0001796</b>	---	---
Sample Date	Client Info			<b>05 Apr 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>2	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>3	<b>1</b>	---	---
Lead	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>8	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>4	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m		<b>2</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>0</b>	---	---
Zinc	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>0</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>11</b>	---	---
Water	%	ASTM D6304	>0.01	<b>0.001</b>	---	---
ppm Water	ppm	ASTM D6304	>100	<b>8</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>549</b>	---	---
Particles >6µm		ASTM D7647	>2500	<b>143</b>	---	---
Particles >14µm		ASTM D7647	>320	<b>8</b>	---	---
Particles >21µm		ASTM D7647	>80	<b>2</b>	---	---
Particles >38µm		ASTM D7647	>20	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>16/14/10</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		<b>0.013</b>	---	---



# OIL ANALYSIS REPORT

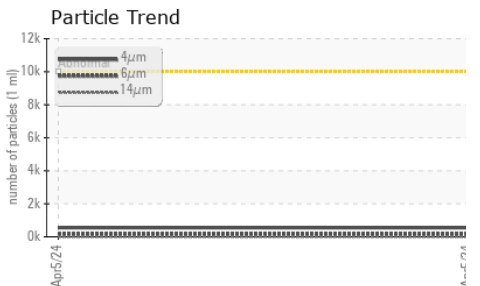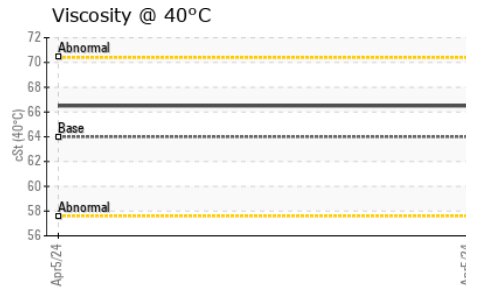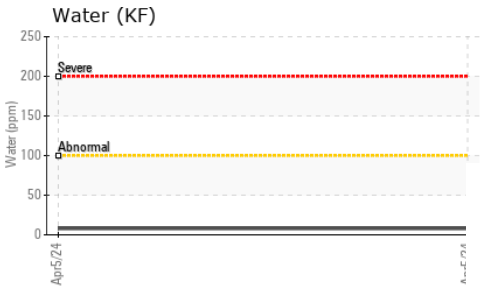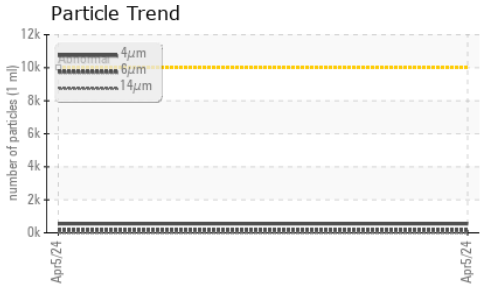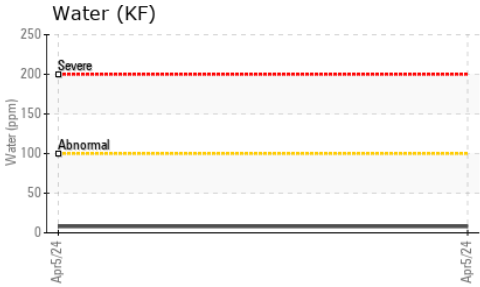





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.01	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	64.0	<b>66.5</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color					no image	no image
Bottom					no image	no image

## GRAPHS

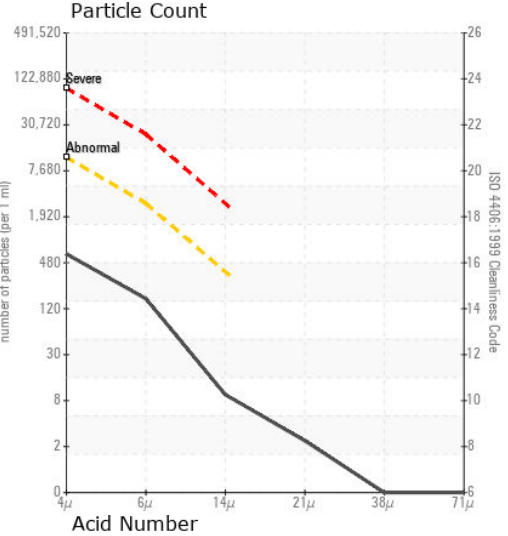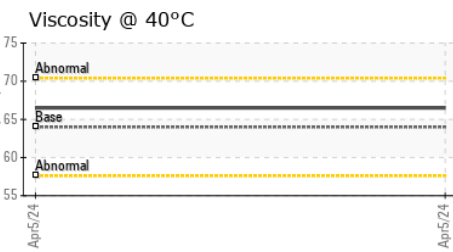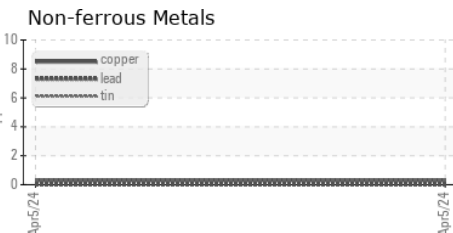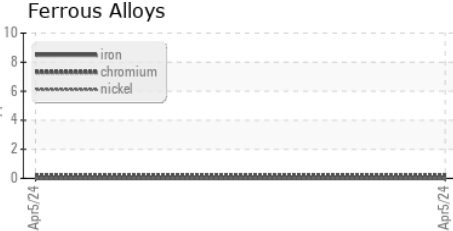

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : Y2K0001796      **Received** : 19 Apr 2024  
**Lab Number** : **06154460**      **Tested** : 22 Apr 2024  
**Unique Number** : 10989883      **Diagnosed** : 23 Apr 2024 - Angela Borella  
**Test Package** : MOB 2 ( Additional Tests: KF, PrtCount )

**Y2K FLUID POWER**  
 3620 N LEWIS AVE  
 SIOUX FALLS, SD  
 US 57104  
 Contact: SERVICE MANAGER  
 sales@y2kfiltration.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)      T: (605)332-0988